

# RULES

## FOR THE CLASSIFICATION AND CONSTRUCTION OF SEA-GOING SHIPS

### PART VI

#### FIRE PROTECTION

ND No. 2-020101-174-E



**St. Petersburg**  
**2023**

# **RULES FOR THE CLASSIFICATION AND CONSTRUCTION OF SEA-GOING SHIPS**

---

Rules for the Classification and Construction of Sea-Going Ships of Russian Maritime Register of Shipping (RS, the Register) have been approved in accordance with the established approval procedure and come into force on 1 January 2023.

The present edition of the Rules is based on the 2022 edition taking into account the amendments and additions developed immediately before publication.

The procedural requirements, unified requirements, unified interpretations and recommendations of the International Association of Classification Societies (IACS) and the relevant resolutions of the International Maritime Organization (IMO) have been taken into consideration.

The Rules are published in the following parts:

Part I "Classification";

Part II "Hull";

Part III "Equipment, Arrangements and Outfit";

Part IV "Stability";

Part V "Subdivision";

Part VI "Fire Protection";

Part VII "Machinery Installations";

Part VIII "Systems and Piping";

Part IX "Machinery";

Part X "Boilers, Heat Exchangers and Pressure Vessels";

Part XI "Electrical Equipment";

Part XII "Refrigerating Plants";

Part XIII "Materials";

Part XIV "Welding";

Part XV "Automation";

Part XVI "Structure and Strength of Fiber-Reinforced Plastic Ships";

Part XVII "Distinguishing Marks and Descriptive Notations in the Class Notation Specifying Structural and Operational Particulars of Ships";

Part XVIII "Additional Requirements for Structures of Container Ships and Ships, Dedicated Primarily to Carry their Load in Containers". The text of the Part is identical to IACS UR S11A "Longitudinal Strength Standard for Container Ships" (June 2015) and S34 "Functional Requirements on Load Cases for Strength Assessment of Container Ships by Finite Element Analysis" (May 2015);

Part XIX "Additional Requirements for Cargo Ships of Less Than 500 Gross Tonnage";

Part XX "Additional Requirements for Yachts";

Supplement to Rules and Guidelines of Russian Maritime Register of Shipping "IACS Procedural Requirements, Unified Requirements, Unified Interpretations and Recommendations".

# **REVISION HISTORY<sup>1</sup>**

(purely editorial amendments are not included in the Revision History)

Amended paras/chapters/sections	Information on amendments	Number and date of the Circular Letter	Entry-into-force date
<a href="#">Para 2.1.3.3</a>	Types of ships have been specified to which the procedure for type approval of pipe penetrations and cable transits where heat-sensitive materials are used given in Appendix 1 to Section 4 of Part IV "Technical Supervision during Manufacture of Products" of the Rules for Technical Supervision during Construction of Ships and Manufacture of Materials and Products for Ships applies	313-14-1908c of 09.03.2023	01.04.2023
<a href="#">Para 2.4.15.2</a>	Requirements have been specified for unambiguous interpretation	—	—
Table 3.1.2.1	Texts of Footnotes <a href="#">4</a> and <a href="#">7</a> have been specified regarding application of fixed fire extinguishing systems using medium and high expansion foam	313-14-1908c of 09.03.2023	01.04.2023
<a href="#">Para 3.3.1.7</a>	Requirements have been specified to the sprinkler systems equivalent to the systems required by SOLAS-74 Chapter II-2, as amended	313-69-1854c of 18.11.2023	01.01.2023
<a href="#">Para 3.7.2.8</a>	Requirements have been specified to the deck foam fire extinguishing system in connection with implementation of IACS UI SC169 (Rev.1 Nov 2021)	313-69-1854c of 18.11.2023	01.01.2023

<sup>1</sup> Amendments and additions introduced at re-publication or by new versions based on circular letters or editorial amendments.

Amended paras/chapters/sections	Information on amendments	Number and date of the Circular Letter	Entry-into-force date
<a href="#">Para 3.8.4.3</a>	Requirements have been specified for installation of by-pass valve located across the time-delay device of fixed carbon dioxide extinguishing systems	313-14-1908c of 09.03.2023	01.04.2023
<a href="#">Para 3.8.5</a>	Requirements have been specified for local carbon dioxide fire extinguishing stations	313-14-1908c of 09.03.2023	01.04.2023
<a href="#">Para 3.11.1.3</a>	Requirements have been specified for calculation of mass of the aerosol generating agent for spaces protected by aerosol fire extinguishing system	313-14-1908c of 09.03.2023	01.04.2023
<a href="#">Para 3.11.5.2</a>	Reference has been specified to IMO circular MSC.1/Circ.1270, as amended by IMO circular MSC.1/Circ.1270/Corr.1	313-14-1908c of 09.03.2023	01.04.2023
<a href="#">Para 3.12.2</a>	Requirements have been specified for type approval of fixed local application fire extinguishing systems for use in machinery spaces in connection with implementation of IMO circular MSC.1/Circ.1387/Corr.1 and IACS UI SC 217 (Corr.2 Aug 2022)	313-14-1908c of 09.03.2023	01.04.2023
<a href="#">Para 3.12.6</a>	Requirements have been specified for arrangement of nozzles of fixed local application fire extinguishing systems for use in machinery spaces in connection with implementation of IMO circular MSC.1/Circ.1387/Corr.1 and IACS UI SC 217 (Corr.2 Aug 2022)	313-14-1908c of 09.03.2023	01.04.2023

Amended paras/chapters/sections	Information on amendments	Number and date of the Circular Letter	Entry-into-force date
Table 5.1.2	In items <a href="#">4.4</a> and <a href="#">6.1</a> requirements have been specified for provision of machinery spaces with mobile and portable foam fire extinguishers	313-14-1908c of 09.03.2023	01.04.2023
<a href="#">Para 6.4.1</a>	Requirements have been specified for fire protection of oil recovery ships	313-14-1908c of 09.03.2023	01.04.2023
<a href="#">Para 6.4.14</a>	Requirements have been specified for arrangement of tanks intended for storage of recovered oil in oil recovery ships	313-14-1908c of 09.03.2023	01.04.2023

## **1 GENERAL**

### **1.1 APPLICATION**

**1.1.1** The requirements of this Part apply to ship's structural fire protection, fire extinguishing systems and fire detection and alarm systems, as well as fire-fighting equipment and outfit.

**1.1.2** The fire protection requirements relating to the structural items of the ship hull, machinery and parts thereof, electrical equipment, pumping and piping, ship's arrangements, fuel oil and lubricating oil tanks, construction and location of boilers, refrigerating plants, ship's spaces, etc. are set out in the relevant parts of the Rules for the Classification and Construction of Sea-Going Ships<sup>1</sup>.

---

<sup>1</sup> Hereinafter referred to as "these Rules".

## **1.2 DEFINITIONS AND EXPLANATIONS**

**1.2.1** The definitions and explanations relating to the general terminology of these Rules are given in Part I "Classification".

The following definitions have been adopted in this Part.

A standard fire test is a test in which the relevant specimens are exposed in a test furnace to temperatures corresponding approximately to the time-temperature curve in accordance with the test method specified in the FTP Code.

A system equivalent to a deck foam system for cargo tanks is a system which shall be capable of extinguishing spill fires, precluding ignition of spilled oil not yet ignited and fire extinction in ruptured tanks.

Adjacent compartments or spaces are those compartments or spaces which are separated from one another by a bulkhead, deck, platform, or any other fixed division without openings or with openings provided with means of closure.

Compartments or spaces continuous to one another at the corners only are not considered as adjacent.

Compartments and spaces separated from one another by removable divisions (i.e. those removable under normal service conditions) or having openings not fitted with means of closing, in the bulkhead or deck that separates them, are considered as one single space.

Atriums are public spaces within a single main vertical zone spanning three or more open decks. Cabin balcony is an open deck space which is provided for exclusive use of the occupants of single cabin and has direct access from such a cabin.

Casualty threshold, in the context of a fire includes:

**.1** loss of the space of origin up to the nearest "A" class boundaries, which may be a part of the space of origin, if the space of origin is protected by a fixed fire extinguishing system; or

**.2** loss of the space of origin and adjacent spaces up to the nearest "A" class boundaries which are not part of the space of origin.

Central control station is a control station where the following control and indicator functions are centralized:

fixed fire detection and fire alarm systems;

automatic sprinkler system, as well as remote starting controls of other fire extinguishing systems;

fire door indicator panels;

fire door closure;

watertight door indicator panels;

watertight door closures;

ventilation fans;

general/fire alarms;

ship communication systems including telephones; and

microphones to public address systems.

Combustible medium is flammable liquids; flammable gases, compressed, liquefied or dissolved under pressure; solid combustible materials and substances, including cargoes, fuel, finishing materials, equipment, insulation, furniture.

Continuous "B" class ceilings or linings are those "B" class ceilings or linings which terminate at an "A" or "B" class division.

Crude oil is any oil occurring naturally in the earth whether or not treated to render it suitable for transportation and includes crude oil from which certain distillate fractions may have been removed and crude oil to which certain distillate fractions may have been added.

Dangerous factors of the fire are fire factors which impact can lead to injury, poisoning or death of the person and/or to material damage;

Treat the dangerous factors of the fire influencing people and property:

flame and sparks;

thermal flow;

increased ambient temperature;

increased concentration of toxic products of burning and thermal decomposition;

lowered concentration of oxygen;

visibility reduction in smoke.

Fire control station is a control station where items of fire detection and fire alarm systems or control of fire extinguishing systems are centralized.

Fire-fighting equipment and systems are those active means of fire protection which are intended for fire extinction and containment of fire spreading throughout the ship.

Fire-fighting outfit is portable fire-fighting equipment (apparatus, appliances, consumable materials) intended for:

fire extinction;

ensuring effective fire-fighting actions of the crew;

ensuring operation of fire extinguishing systems.

Fixed fire extinguishing systems are those systems which are intended to supply fire extinguishing medium to the protected spaces or directly therein and structurally fixed to the ship's hull.

Flammable liquids are liquids, or mixtures of liquids, or liquids containing solids in solution or suspension (e.g. paints, varnishes, lacquers, etc.) which give off flammable vapours at or below 60 °C closed cup test.

Flash point is the temperature in degrees Celsius (closed cup test), at which liquid will give off enough flammable vapours to be ignited as determined by an approved flash point apparatus.

Foam delivery ducts are supply ducts for introducing high expansion foam into the protected space from foam generators located outside the protected space.

FSS Code is the International Code for Fire Safety Systems, as adopted by IMO resolution MSC.98(73).

FTP Code is the International Code for Application of Fire Test Procedures, 2010 adopted by IMO resolution MSC.307(88), as amended by IMO resolution MSC.437(99).

Fuel oil units refer to definition given in 1.2, Part VII "Machinery Installations".

High expansion foam fire extinguishing systems are fixed total flooding extinguishing systems that use either inside air or outside air for aeration of the foam solution. A high expansion foam system consists of both the foam generators and the dedicated foam concentrate approved during the fire testing specified in [3.7.3.1.1](#).

Independent power source of a pump is a pump drive powered by a separate electric motor, hydraulic or diesel engine intended only for this pump operation.

Inside air foam system is a fixed high expansion foam fire extinguishing system with foam generators located inside the protected space and drawing air from that space.

Lower flammable limit (LFL) is the minimum concentration of oil gases and vapours in air capable of igniting from a source of ignition and propagating combustion in the mixture.

Main vertical zones are those sections into which the hull, superstructure, and deckhouses are divided by "A" class divisions, the mean length and width of which on any deck does not in general exceed 40 m.

Motor vehicle without fuel in its tanks is motor vehicle, motor bike, tractor, etc., powered with an internal combustion engine and having empty fuel system and fuel tanks, as well as both battery leads disconnected from the accumulator.



Nominal foam expansion ratio is the ratio of the volume of foam to the volume of foam solution from which it was made, under non-fire conditions, and at an ambient temperature of e.g. around 20 °C.

Outside air foam system is a fixed high expansion foam system with foam generators installed outside the protected space that are directly supplied with fresh air.

Primary deck covering is the first layer of a floor construction, which is applied directly on top of the deck plating and is inclusive of any primary covering, corrosion-resistant compound or adhesive, which is necessary to provide protection or adhesion to the deck plating. Other layers of a floor construction, which are applied directly on top of the deck plating, constitute floor coverings.

Protected space is a space equipped with one of the fire extinguishing systems or with an automatic fire detection system.

Rated volume of a protected space is the gross volume of a space bounded by watertight or gastight bulkheads and decks with the deduction for the volume occupied by main machinery reduction gear, auxiliaries, boilers, condensers, evaporators, tanks, ventilation and exhaust gas piping.

Rooms containing furniture and furnishings of restricted fire risk for the purpose of application on ships carrying more than 36 persons are the rooms (whether cabins, public spaces, offices or other types of accommodation referred to in [1.5.2](#)) in which:

- all furniture, such as desks, wardrobes, dressing tables, bureau, dressers, is constructed entirely of approved non-combustible materials, except that a combustible veneer not exceeding 2 mm in thickness may be used on the working surface of such articles;

- all free-standing furniture, such as chairs, sofas, tables, is constructed with frames of non-combustible materials;

- all draperies, curtains and other suspended textile materials have qualities of resistance to the flame spread not inferior to those of wool of mass 0,8 kg/m<sup>2</sup>, this being determined in accordance with the FTP Code;

- all floor coverings have low flame spread characteristics;

- all exposed surfaces of bulkheads, linings and ceilings have low flame spread characteristics;

- all upholstered furniture has qualities of resistance to ignition and flame spread, this being determined in accordance with the FTP Code;

- all bedding components have qualities of resistance to ignition and flame spread, this being determined in accordance with the FTP Code.

Safe area in the context of a casualty is, from the perspective of habitability, any area(s) which is not flooded or which is outside the main vertical zone(s) in which a fire has occurred such that it can safely accommodate all persons on board to protect them from hazards to life or health and provide them with basic services.

Safety centre is a control station dedicated to the management of emergency situations. Safety systems operation, control and/or monitoring are an integral part of the safety centre.

Sauna is a hot room with temperatures normally varying between (usually 80 — 120 °C) where the heat is provided by a hot surface (e.g. by electrically-heated oven). The hot room may also include the space where the oven is located and adjacent bathrooms.

Smothering is filling of a protected space with a medium not supporting combustion.

Steel or other equivalent material is any non-combustible material, which by itself or due to insulation provided, has structural and integrity properties equivalent to steel at the end of the applicable fire exposure during a standard fire test (e.g., aluminum alloy with appropriate insulation).

Structural fire protection is a complex of the passive means of structural fire protection intended for:

prevention of fire;  
containment of flame and smoke spreading throughout the ship;  
creation of conditions for safe evacuation of people from the ship's spaces and from the ship, as well as for effective fire extinction.

Surface extinction is cooling, wetting or restriction of oxygen access to burning surfaces.

Vehicle carrier is a cargo ship which only carries cargo in ro-ro spaces or vehicle spaces, and which is designed for the carriage of unoccupied motor vehicles without cargo, as cargo.

Water drenching systems are those systems which supply water onto vertical or horizontal ship's structures.

Water mist lance is a tube with a piercing nozzle which is capable of penetrating a container wall and producing water mist inside a confined space (container, etc.) when connected to the fire main.

Water-screen systems are systems which create a water barrier in the form of sufficiently thick curtain of water fed through spray nozzles. Such systems are fitted where the use of "A" class divisions is impracticable.

### **1.3 SCOPE OF SURVEY**

**1.3.1** General regulations for the classification, survey of ships under construction and classification surveys, as well as the requirements for the documentation to be submitted to the Register for review are set out in General Regulations for the Classification and Other Activity and in Part I "Classification".

**1.3.2** Subject to the Register survey during construction of a ship are: structural fire protection, materials used for the interior finishing of ship's spaces, as regards fire hazardous properties thereof, fire extinguishing, fire detection and alarm systems subject to the provisions of the present Part.

As regards fire-fighting outfit, it shall only be checked for correct location and for complete availability in accordance with the requirements of the present Part.

**1.3.3** The following shall be submitted to the Register for approval of active fire-fighting means and passive means of structural fire protection according to the requirements of the present Part:

**.1** documents on fire tests run by competent bodies, confirming the efficiency of newly applied fire extinguishing medium with the recommended standards on composition and application rates, as well as information on storage life and conditions;

**.2** reports of the recognized laboratories on the fire tests of "A" and "B" class fire-fighting divisions, closures of openings and passages (cutouts) in such divisions ("A" and "B" class doors included) ([refer to 1.6](#));

**.3** drawings of fire-fighting divisions together with the protocols of the recognized laboratories on tests, which confirm their compliance with "A" and "B" class divisions;

**.4** reports of the recognized laboratories on tests of the fire hazardous material features ([refer to 1.6](#));

**.5** drawings for individual standard assemblies (equipment) of fire extinguishing systems and fire-fighting outfit;

**.6** required calculations, which confirm the fulfillment of the requirements of the present Part.

## 1.4 FIRE PLANS

**1.4.1** At the central control station, wheelhouse or in conspicuous positions in corridors and lobbies of any ship, there shall be exhibited general arrangement plans clearly showing the following for each deck:

- .1 location of control stations;
- .2 arrangement of fire-resisting and fire-retarding divisions;
- .3 spaces protected by the fire detection and alarm system;
- .4 spaces protected by fixed fire extinguishing systems with indication of the location of instruments and fittings for their control and also the disposition of fire hydrants;
- .5 means of access to different compartments, decks, etc., with indication of escape routes, corridors and doors;
- .6 ventilation system including the controls of fans and showing the disposition of dampers and the identification numbers of the fans serving the groups of spaces, fenced off by fire-resistant boundaries.
- .7 arrangement of fire-fighting outfit;
- .8 location of the documents referred to in [1.4.6](#);
- .9 location of emergency escape breathing devices specified in [5.1.23](#).

**1.4.2** In lieu of the plans, information specified in [1.4.1](#) may be set out in a booklet, a copy of which shall be supplied to each officer, and one copy at all times shall be available on board in an accessible position.

**1.4.3** A duplicate set of the plans or the booklet protected against marine environment shall be permanently stowed outside the deckhouse in a weathertight enclosure painted red and marked as indicated in [Fig. 1.4.3-1](#) in compliance with IMO circular MSC/Circ.451.

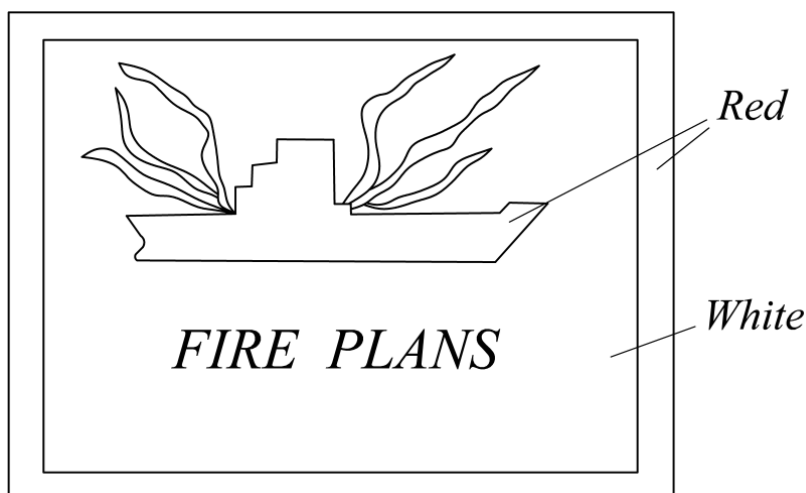


Fig. 1.4.3-1

The enclosure shall be capable of being easily opened, be readily available to the shore side firefighting personnel, be located in a well-illuminated position, if possible including illumination from an emergency source.

In oil tankers, chemical tankers and gas carriers the enclosure of fire control plans shall not be located on exterior bulkheads of superstructures which face cargo area and the surfaces within 3 m from them along the side.

If the enclosure is not adjacent to the gangway, there shall be guide signs as indicated in [Fig. 1.4.3-2](#) showing the way thereto. The dimensions of the signs shall not be less than 300 × 400 mm.

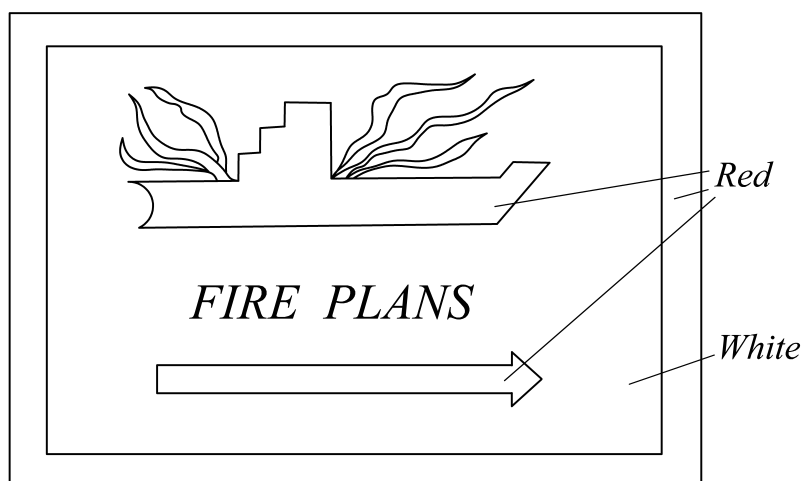


Fig. 1.4.3-2

**1.4.4** Description in such plans and booklets shall be in the state language and in the English/French language. The symbols for items listed in [1.4.1](#) shall be in agreement with IMO resolution A.952(23) "Graphical Symbols for Fire Control Plans", as well as Table 3 of IMO resolution A.1116(30) for items, which signs are not indicated in IMO resolution A.952(23).

For ships not engaged on international voyages, translation into English or French is not required.

The graphical symbols shall be coloured.

**1.4.5** All alterations in the fire protection of a ship shall be entered in the ship's documents stated in [1.4.1](#) and [1.4.2](#).

**1.4.6** To be kept in a separate file in an accessible position are technical instructions for maintenance and use of all ship's installations for extinction and containment of fire.

**1.4.7** In passenger ships carrying more than 36 passengers, plans and booklets shall provide information regarding fire protection, fire detection and fire extinction in accordance with [1.4.1](#) and considering IMO resolution A.756(18).

## 1.5 CATEGORIES OF SHIP'S SPACES

### 1.5.1 Control stations:

.1 spaces in which the ship's radio or main navigational equipment (in particular, steering stand, compass, radar and direction finding equipment). The spaces containing the emergency power source, including accumulator batteries regardless of their capacity, namely:

emergency batteries in separate battery room for power supply from black-out till start of emergency generator;

emergency batteries in separate battery room as reserve source of energy to radiotelegraph installation;

batteries for start of emergency generator; and

in general, all emergency batteries required in 9.3 or 19.1.2, Part XI "Electrical Equipment".

The spaces, in which items of fire detection and fire alarm systems or control of fire extinguishing systems are centralized. Steering gear room containing its emergency control is not considered as a control station. If in the present Part there are no specific requirements for the centralization within a control station of major components of the fixed fire extinguishing systems, then such major components may be placed in spaces, which are not considered as control stations;

.2 control stations ([refer to 1.5.1.1](#)), which may also be considered as machinery spaces, such as emergency diesel generators rooms;

.3 spaces containing equipment for the control of submersion, emersion and heeling;

.4 control stations for fire and rescue operations ([refer to 6.6.2](#));

.5 compression chamber control station and diving operation control station whose functions may be combined in one control station (refer to 4.8.2 and 4.8.4, Part VI "Machinery Installations, Mechanical Equipment and Systems" of the Rules for the Classification and Construction of Manned Submersibles and Ship's Diving Systems).

### 1.5.2 Accommodation spaces:

.1 spaces used as cabins, corridors, offices, medical rooms, cinema halls, games and entertainment halls, barbers shops, pantries which are not used for taking meals and do not contain equipment for cooking hot meals (however such pantries may have the following appliances: coffee machines, toasters, dish washing machines, microwave ovens, induction heaters and similar appliances each consuming not more than 5 kW; electric stoves and kitchen stoves for food heating consuming not more than 2 kW and having a surface temperature of not more than 150 °C), and other similar spaces;

.2 public spaces: the accommodation spaces used as halls, dining rooms, lounges and similar permanently enclosed spaces;

.3 sanitary spaces: the public spaces used as shower-rooms, bathrooms, toilets, small laundries, indoor swimming pools, etc.

### 1.5.3 Service spaces:

.1 service spaces used as galleys (spaces containing electric stoves and kitchen stoves with a capacity of more than 5 kW), pantries containing equipment for cooking hot meals (such pantries may have the following appliances: toasters, microwave ovens and similar appliances each consuming not more than 5 kW; electric stoves and kitchen stoves for food heating consuming up to 5 kW), various workshops not forming part of machinery spaces and similar spaces as well as trunks leading to such spaces;

.2 service spaces used as storerooms:

.2.1 storerooms for explosives;

.2.2 storerooms for flammable materials and substances: paint lockers, spaces for flammable liquids, flammable liquefied and compressed gases, sheltered garages, fuel distribution systems, etc.;

.2.3 storerooms other than mentioned in [1.5.3.2.1](#) and [1.5.3.2.2](#);

.2.4 working spaces defined in [1.5.8](#);

.3 cargo control rooms (refer to definitions in 1.2, Part VII "Machinery Installations").

**1.5.4 Cargo spaces:**

.1 cargo tanks intended for the carriage of liquids in bulk, slop tanks included;

.2 spaces for dry cargoes other than ship stores: dry cargo and refrigerated cargo holds and 'tween decks, including those intended also for carriage of containers and portable tanks, dangerous goods in packaged form or in bulk, motor vehicles without fuel in their tanks; storage spaces for ready produce, utilizable refuse, fishing equipment, packages, etc., as well as produce discharge trunks, cargo lifts and access trunks leading to such spaces;

.3 ro-ro cargo spaces not normally subdivided in any way and extending to either a substantial length or the entire length of the ship, spaces in which motor vehicles with fuel in their tanks for their own propulsion, and/or goods packaged (in tare or in bulk, on rail or road cars, vehicles (including road or rail tanks), trailers, containers, pallets, demountable tanks or similar enlarged units, or other tanks) are normally loaded and unloaded in a horizontal direction. Such spaces are divided into:

.3.1 closed ro-ro cargo spaces which are not spaces specified in [1.5.4.3.2](#) and [1.5.4.5](#);

.3.2 open ro-ro cargo spaces either open at both ends, or open at one and provided with adequate natural ventilation effective over their entire length through permanent openings in the side plating or deckhead or from above while the total square of openings shall be at least 10 % of the square of side plating of spaces;

.4 vehicle spaces intended for carriage of motor vehicles with fuel in their tanks for their own propulsion, which divide into:

.4.1 enclosed spaces, for vehicles which are not open spaces for vehicles neither weather decks;

.4.2 open vehicle spaces, open similar to [1.5.4.3.2](#);

.5 weather deck is a deck fully open for environmental exposure from above and at least from two sides.

**1.5.5 Machinery spaces** – refer to definition of 1.2, Part VII "Machinery Installations".

**1.5.6 Machinery spaces of category A** – refer to definition given in 1.2, Part VII "Machinery Installations".

**1.5.7 Pump rooms on tankers and combination carriers:**

.1 cargo pump rooms containing cargo pumps and entrances and trunks to such spaces; pump rooms adjacent to cargo tanks and slop tanks ([refer to 2.4.7](#));

.2 pump rooms where pumps transporting water and liquid fuel are located.

**1.5.8 Working spaces** are spaces on special purpose ships, which are neither machinery spaces nor part of them such as workshops, laboratories and other similar spaces, as well as trunks leading to such spaces, where:

.1 fuel oil or flammable liquids are used or combustible materials are processed;

.2 neither flammable liquids are used, nor combustible materials are processed.

Working spaces shall comply with the requirements of the present Part for service spaces if not specified otherwise.

**1.5.9 Special category spaces** are enclosed spaces located above or below the bulkhead deck into and out of which motor vehicles can be driven under their own propulsion and to which passengers have access. These spaces may be located on more than one deck if total overall clear height for the motor vehicles does not exceed 10 m.

**1.5.10 Special electrical spaces** — refer to 1.2, Part XI "Electrical Equipment".

## 1.6 SUBDIVISION AND TESTING OF MATERIALS AND PRODUCTS ACCORDING TO THE FIRE TEST PROCEDURES CODE

**1.6.1** The FTP Code is applied to materials and products subject to testing and assessment in accordance with the provisions of the Code and approved by the Register, as required by these Rules.

**1.6.2** Where reference to the FTP Code is made in the text of any requirement of these Rules, it means that the material or product shall be tested in compliance with an applicable fire test procedure or procedures, stipulated by Code, except cases specified by the same Code.

**1.6.3** In accordance with applicable parts of the FTP Code materials and products shall be tested mentioned in these Rules as:

**.1** non-combustible materials (refer to [2.1.1.5](#), [2.1.2](#), [2.2.2.5](#) and [2.3.4](#)). Non-combustible material is a material, which neither burns nor gives off flammable vapours in the amount sufficient for self-ignition when heated to 750 °C approximately. Any other material is a combustible material. However, products made only of glass, concrete, ceramics, natural stone, masonry units, common metals and metal alloys are considered being non-combustible and may be installed without testing;

**.2** not generating excessive quantities of smoke and toxic products (refer to [2.1.1.7](#) and [2.1.2.6](#)) or not hazardous as regards generation of toxic or explosive products at elevated temperatures ([refer to 2.1.1.6](#));

**.3** "A" or "B" class divisions, such as: decks, bulkheads, doors, continuous ceilings and linings, windows, fire dampers, places of piping and cabling passage (refer to [2.1.2](#) and [2.1.3](#));

**.4** fire doors control systems capable of operating in case of fire ([refer to 2.2.4.1.15](#));

**.5** low flame-spread surfaces (refer to [2.1.1.5](#), [2.1.1.6](#), [2.1.1.8](#), [2.1.2.6](#) and [2.1.2.8](#)). Low flame-spread means that the surface restricts the spread of flame to a sufficient extent;

**.6** draperies, curtains and other vertically supported textile materials, which meet the requirements as regards flame spread resistance not inferior to those of wool having a mass of 0,8 kg/m<sup>2</sup> ([refer to 2.1.1.9](#));

**.7** upholstered furniture meeting the requirements as regards ignition and flame-spread resistance ([refer to 2.1.1.9](#));

**.8** bedding components (blankets, covers, pillows, mattresses), which meet the requirements as regards ignition and flame-spread resistance ([refer to 2.1.1.9](#)).

**1.6.4** When testing and approving the materials and products in accordance with the FTP Code additional requirements specified in the appropriate parts of the FTP Code.



## **1.7 ALTERNATIVE DESIGN AND ARRANGEMENTS**

### **1.7.1 General.**

**1.7.1.1** Fire safety design and arrangements may deviate from the requirements of the present Part, provided, that the design and arrangements meet the fire safety objectives and the functional requirements.

**1.7.1.2** If the design and arrangements deviate from the prescriptive requirements of the present Part, engineering analysis, evaluation and approval of the alternative design and arrangements shall be carried out in accordance with the requirements of the present Chapter.

### **1.7.2 Engineering analysis.**

**1.7.2.1** The engineering analysis submitted to the Register shall be prepared based on the Guidelines on Alternative Design and Arrangements for Fire Safety (refer to IMO circular MSC/Circ.1002), and shall include, as a minimum, the following elements:

- .1** determination of the ship type and space(s) concerned;
- .2** identification of prescriptive requirement(s) with which the ship or the space(s) will not comply;
- .3** identification of the fire and explosion hazards of the ship or the space(s) concerned including:
  - .3.1** identification of the possible ignition sources;
  - .3.2** identification of the potential for the spread of fire of each space concerned;
  - .3.3** identification of the smoke and toxic products generation potential for each space concerned;
  - .3.4** identification of the potential for the spread of fire, smoke or of toxic products generation from the space(s) concerned to other spaces;
- .4** determination of the required fire safety performance criteria for the ships or the space(s) concerned addressed by the prescriptive requirement(s), which shall:
  - .4.1** be based on the fire safety objectives and on the functional requirements of the present Part;
  - .4.2** provide a degree of safety not less than that achieved by using the prescriptive requirements;
  - .4.3** be quantifiable and measurable;
- .5** detailed description of the alternative design and arrangements, including a list of the assumptions used in the design and any proposed operational restrictions or conditions;
- .6** technical justification demonstrating that the alternative design and arrangements meet the required fire safety performance criteria.

### **1.7.3 Evaluation of the alternative design and arrangements.**

**1.7.3.1** The engineering analysis required in [1.7.2](#) shall be evaluated and approved by the Register taking into account the Guidelines developed by IMO.

**1.7.3.2** A copy of the documentation, as approved by the Register, indicating that the alternative design and arrangements comply with the requirements of the present Chapter shall be carried on board a ship.

### **1.7.4 Re-evaluation due to change of conditions.**

**1.7.4.1** If the assumptions and operational restrictions that were stipulated in the alternative design and arrangements are changed, the engineering analysis shall be carried out again under the changed condition and shall be approved by the Register.

## 2 STRUCTURAL FIRE PROTECTION

### 2.1 GENERAL

#### 2.1.1 Requirements for materials.

**2.1.1.1** The hull, superstructures, structural bulkheads decks and deckhouses shall be manufactured of steel or other equivalent material. For the purpose of using the definition of steel or other equivalent material, given in [1.2.1](#), "applicable fire exposure" shall correspond to the standards of fire integrity and insulation, specified in the appropriate bulkheads and decks fire integrity tables. For example, if for such divisions as decks or side and end bulkheads of deckhouses fire integrity equal to "B-0" is allowed, then "applicable fire exposure" shall be equal to half an hour.

If aluminum alloys are used, the requirements of [2.1.1.3](#) shall be met.

**2.1.1.2** Casings and crowns of machinery spaces of category A shall be of steel and insulated as required by Tables [2.3.3-1](#) and [2.4.2-2](#) as appropriate.

The floor plating of normal passageways in machinery spaces of category A shall be made of steel.

**2.1.1.3** If any part of the division is manufactured of aluminum alloys, the following requirements shall be complied with:

**.1** parts of "A" or "B" class divisions, made of aluminum alloy, except the divisions, which are not loadbearing, shall be insulated so, that the temperature of the structural core of the specimen does not rise more than 200 °C above the ambient temperature at any time during the applicable fire exposure at the standard fire test;

**.2** special attention shall be given to insulation of aluminum alloy components of columns, stanchions and other structural members required to support lifeboat and life raft stowage, launching and embarkation areas and "A" and "B" class divisions to ensure that:

**2.1** such members required to support lifeboat and life raft stowage, launching and embarkation areas and "A" type divisions comply with the temperature rise limitation requirement, as specified in [2.1.1.3.1](#), at the end of an hour;

**2.2** such members required to support "B" class divisions comply with the temperature rise limitation requirement, as specified in [2.1.1.3](#), at the end of half an hour.

**2.1.1.4** In accommodation spaces, service spaces and control stations of all types of ships the total mass of combustible materials of each enclosed space shall be calculated based on the following formula:

$$M_{rel} = M_t / S \quad (2.1.1.4)$$

where  $M_{rel}$  = the total mass of combustible materials per unit area of the space, in kg/m<sup>2</sup>;  
 $M_t$  = the total mass of combustible materials of the space, in kg;  
 $S$  = the floor area of the space, in m<sup>2</sup>.

The following combustible materials shall be included to the calculations:

**.1** construction materials as cables insulation except for halogen-free cables (HF type), plastic pipes, veneers and combustible materials permitted to be used according to the present Part;

**.2** outfitting, which may be installed during construction or provided by the shipowner or crew, including furniture, bedding components and electrical appliances.

Maximum values for the total mass of combustible materials per unit area  $M_{rel}$ , in kg/m<sup>2</sup>, shall not exceed the values specified in [Table 2.1.1.4.2](#). Space categories shall correspond to the ones specified in [2.2.1.3](#), [2.2.1.5](#), [2.3.3](#) or [2.4.2](#), depending on the ship type;

Table 2.1.1.4.2

Ship type Space category	Passenger ship carrying more than 36 passengers	Passenger ship carrying not more than 36 passengers	Cargo ships
Stairways, corridors	5	5	5
Control stations	5	5	5
Accommodation spaces	15 — minor fire risk, 35 — moderate and greater fire risk	35	35
Service spaces surrounded by "A" class divisions	45	45	45

**.3** on fishing vessels of 24 m in length and over, the total mass of combustible materials per unit area of the space in control stations, accommodation spaces and service spaces, except for saunas and refrigerated storerooms, shall not exceed 45 kg/m<sup>2</sup>.

**2.1.1.5** Insulation materials shall be non-combustible, except for use in cargo spaces, postal and baggage storerooms and refrigerated storerooms of service spaces.

In the spaces where oily products may be present the insulation surface shall be oily vapours- impermeable, which may be provided by coating insulation with galvanized steel sheets, reinforced aluminium foil, aluminium foil laminated fiberglass cloth or by other means.

Vapour barriers and adhesives used in conjunction with anti-condensation insulation of cooling water piping of the conditioning systems and cooling systems, as well as insulation of piping valves, fittings and joints may be combustible but they shall be kept to the minimum, as far as practicable, while their exposed surfaces shall be low flame-spread.

Insulating materials shall not contain asbestos.

**2.1.1.6** Primary deck coverings, if applied within accommodation and service spaces and control stations or on cabin balconies of passenger ships shall be of an approved material, which has low flame spread characteristics and shall not give rise to smoke, toxic or explosive hazards at elevated temperatures, this being determined in accordance with the FTP Code.

Where a floor covering is required to be low flame-spread, all layers shall comply with the requirement of [1.6.3.5](#). If the floor covering has a multilayer construction, the tests shall be conducted for each layer or for combinations of some layers of the floor coverings; at that, the Register approval is applicable to the tested combinations of layers.

Primer or similar thin film of paint on deck plating need not comply with the requirements of [1.6.3.5](#).

**2.1.1.7** Paints, varnishes and other finishings used on exposed surfaces inside service and accommodation spaces, control stations and stairways enclosures shall not generate excessive quantity of smoke and toxic vapours, this being determined in accordance with the FTP Code.

This requirement applies to the finish materials of bulkheads, decks, floor coverings, linings and ceilings, but is not applicable to cables insulation, plastic piping and furniture.

Finish materials and primary deck coverings ([refer to 2.1.1.6](#)) with the total heat release not more than 0,2 MJ and peak heat release rate not more than 1,0 kW (both values are determined in accordance with Part 5 of the FTP Code) are considered as complying with the requirements of [1.6.3.2](#) without tests.

On board oil tankers, chemical tankers and oil recovery ships the use of aluminum coatings containing greater than 10 % aluminum by weight in the dry film is prohibited in cargo tanks, cargo tank deck area, pump rooms, cofferdams or any other area where cargo vapour may accumulate.

On passenger ships, paints, varnishes and other finishes used on exposed surfaces of cabin balconies, excluding natural hard wood decking systems, shall not be capable of producing excessive quantities of smoke and toxic products, this being determined in accordance with the FTP Code.

Adhesives used for "A", "B" and "C" class divisions shall be of an approved material, which has low flame spread characteristics, this being determined in accordance with Part 5 of the FTP Code.

**2.1.1.8** In accordance with the FTP Code, the following surface shall have low flame spread characteristics:

**.1** on passenger ships:

**.1.1** exposed surfaces in corridors and stairway enclosures, as well as bulkheads and plating, ceiling linings in accommodation and service spaces (except saunas) and control stations;

**.1.2** surfaces and grounds in concealed and inaccessible spaces in accommodation and service spaces and control stations;

**.1.3** exposed surfaces of cabin balconies excluding natural hard wood decking systems;

**.2** on fishing vessels of 24 m in length and over and on cargo ships of 500 gross tonnage and upwards:

**.2.1** exposed surfaces in corridors and stairway enclosures and of ceilings in accommodation and service spaces (except saunas) and control stations;

**.2.2** surfaces and grounds in concealed and inaccessible spaces in accommodation and service spaces and control stations;

The above requirements apply to finish materials of bulkheads, decks, decking systems, linings of bulkheads and ceilings, but are not applicable to plastic piping, electrical cables and furniture.

**2.1.1.9** On passenger ships carrying more than 36 passengers in accommodation spaces, the furniture and furnishings of which constitute restricted fire risk, draperies, curtains and other suspended textile materials, upholstered furniture and bedding components shall be satisfactorily tested in compliance with the FTP Code ([refer to 1.6.3.6 — 1.6.3.8](#)). For other types of ships, the said requirements are recommended only.

**2.1.1.10** On passenger ships, "A", "B" and "C" class divisions in accommodation and service spaces and cabin balconies, which are faced with combustible materials, facings, mouldings, decorations and veneers shall comply with the requirements of the present paragraph and [2.1.1.6 – 2.1.1.8](#). However, traditional wooden benches and wooden linings of bulkheads and ceilings are allowed in saunas and such materials may not be taken into calculation required by the paragraph.

On cargo ships, non-combustible bulkheads, ceilings and linings fitted in accommodation and service spaces may be faced with combustible materials, facings, mouldings, decorations and veneers provided such spaces are bounded by non-combustible bulkheads, ceilings and linings in accordance with the requirements of the present paragraph and [2.1.1.6 – 2.1.1.8](#).

Combustible materials used on the surfaces and linings shall have calorific value not exceeding 45 MJ/m<sup>2</sup> taking into consideration their thickness. Requirements of this article are not applicable to the surfaces of furniture fixed to linings or bulkheads.

Calorific value  $Q$ , in MJ/m<sup>2</sup>, taking into consideration the thickness of covering material, is determined by the formula

$$Q = Q_g p s \quad (2.1.1.10)$$

where  $Q_g$  = the maximum specific heat of combustion determined in accordance with ISO 1716 "Construction Materials. Determination of the Calorific Potential", in MJ/kg;  
 $p$  = the density of material, in kg/m<sup>3</sup>;  
 $s$  = the thickness of material, in m.

Where combustible materials are used in accordance with the present paragraph, they shall comply with the following requirements:

.1 the total volume of combustible facings, mouldings, decorations and veneers in any accommodation or service spaces shall not exceed a volume equivalent to 2,5 mm veneer of the combined area of the walls and ceiling linings. The furniture fixed to linings, bulkheads or decks may be not included into the calculation of the total volume of combustible materials;

.2 in case of ships fitted with an automatic sprinkler system complying with the provisions of the FSS Code, the above volume may include some combustible materials used for erection of "C" class divisions.

On fishing vessels of 45 m in length and over and/or 500 gross tonnage and upwards and on non-self-propelled ships without regard of their gross tonnage, it is permissible to fit in accommodation and service spaces the non-combustible bulkheads, linings and ceilings with combustible covering less than 2 mm thick except corridors, stairway enclosures as well as control stations where thickness of covering shall not exceed 1,5 mm.

The furnishings specified in the present paragraph and applied on cabin balconies may not be taken into calculation required by the paragraph.

**2.1.1.11** All waste receptacles shall be constructed of non-combustible materials with no openings in the sides and bottom.

Containers constructed of combustible materials may be used in galleys, pantries, bars, garbage handling or storage spaces and incinerator rooms provided they are intended purely for the carriage of wet waste, glass bottles or metal cans and are suitably marked.

#### **2.1.2 Fire-fighting divisions.**

**2.1.2.1** "A" class divisions are those divisions which are formed by bulkheads or decks complying with the following requirements:

- .1 they shall be constructed of steel or other equivalent material;
- .2 they shall have respective stiffening elements;
- .3 they shall be so constructed as to be capable of preventing the passage of smoke and flame up to the end of the 60-min standard fire test;
- .4 they shall be so insulated with approved non-combustible material that the average temperature of the unexposed side will not rise more than 140 °C above the original temperature, nor will the temperature, at any one point, including any joint, rise more than 180 °C above the original temperature.

Depending on the time during which the above-indicated temperature rise is ensured in the course of the standard fire test, the following symbols are given to divisions: "A-60" — during 60 min; "A-30" — during 30 min; "A-15" — during 15 min; "A-0" — during 0 min.

**2.1.2.2** When approving the structural fire protection the danger of heat transfer through joints and ends of insulation shall be taken into account. Insulation of steel and aluminium decks and bulkheads shall extend for at least 450 mm beyond boundaries of structures forming the given space. If a space is divided by the "A" class deck or bulkhead with an insulation of different size, then an insulation of greater size shall extend over the deck and bulkhead for at least 450 mm from the less insulated structure.

Measures taken to prevent heat transfer through joints and ends of insulation of decks and bulkheads are shown in Figs. [2.1.2.2-1](#) and [2.1.2.2-2](#). The Register may approve some other variants of such measures, provided the efficacy of the proposed structure is verified by the results of tests conducted in accordance with the FTP Code.

Where the lower part of insulation is cut off to provide drainage, the structure shall comply with [Fig. 2.1.2.2-3](#).

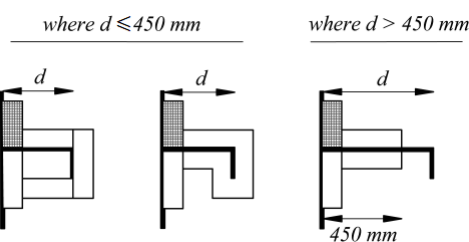


Fig. 2.1.2.2-1

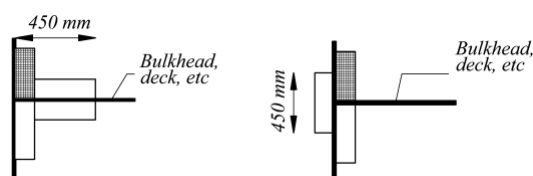


Fig. 2.1.2.2-2

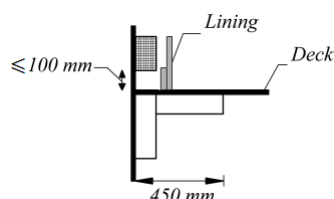


Fig. 2.1.2.2-3

Note.  $d$  — height of the stiffener at the longitudinal member.

**2.1.2.3** Lightweight (honeycomb and other) structures made of steel or other equivalent material may be used as internal divisions of "A" class in the accommodation and service spaces, provided they are not load-bearing structures and successfully passed prescribed tests in accordance with the FTP Code. Such lightweight structures shall not be used as the components of the main fire protection zones and stairways enclosures in passenger ships.

**2.1.2.4** The following elements may be fitted without tests:

**.1** "A-0" class bulkheads, if made of steel and having the dimensions not less than the following: plate thickness — 4 mm;

stiffeners  $60 \times 60 \times 5$  mm located at a distance of 600 mm from each other or having similar construction;

**.2** "A-0" class decks if made of steel and having the dimensions not less than the following: plate thickness — 4 mm;

stiffeners  $95 \times 65 \times 7$  mm located at a distance of 600 mm from each other or having similar construction.

**2.1.2.5** "B" class divisions are those divisions which are formed by bulkheads, decks, ceilings or linings which comply with the following requirements:

**.1** they are made of approved non-combustible materials.

Use of combustible veneer is permitted (refer to [2.1.1.8](#) and [2.1.1.10](#));

**.2** divisions shall be so constructed as to remain capable of preventing the passage of flame up to the end of the 30-minute standard fire test;

**.3** divisions shall have an insulation value such that the average temperature on the unexposed side during the fire test will not rise more than  $140^\circ\text{C}$  above the original temperature, nor will the temperature at any one point, including any joint, rise more than  $225^\circ\text{C}$  above the original temperature when either side is exposed to the fire test.



According to the time during which the above-mentioned temperature rise is ensured in the course of the standard fire test, the following symbols are given to divisions: "B-30" — during 30 min; "B-15" — during 15 min.; "B-0" — during 0 min.

**2.1.2.6** Materials used in the "A" and "B" class divisions, which according to the present Part shall have particular characteristics (be non-combustible, low flame-spread or not generating excessive quantities of smoke and toxic agents), shall comply with the requirements of the FTP Code (refer to [1.6.3.1](#), [1.6.3.2](#) and [1.6.3.5](#)).

**2.1.2.7** Continuous "B" class ceilings and linings with the relevant decks or bulkheads may be considered as fully or partially ensuring insulation and fire integrity of structures, as required by the respective fire integrity tables.

**2.1.2.8** "C" class divisions are the divisions made of approved non-combustible materials. They do not need meet any requirements relative to the passage of smoke and flame or the limiting of temperature rise. It is not required that gluing materials in these structures be non-combustible, however, these materials shall be low flame-spread.

**2.1.2.9** Divisions consisting of non-combustible core and combustible veneers may be accepted as "B" or "C" class divisions, provided that the non-combustible core is tested and complies with the requirements of [1.6.3.1](#), and the "B" class division is tested and complies with the requirements of [2.1.2.4](#), and the veneers, if applicable, are tested and comply with the requirements of [1.6.3.2](#) and [1.6.3.5](#).

**2.1.3 Closures of openings in fire-fighting divisions.**

**2.1.3.1** Fire integrity of doors shall be equal to fire integrity of the divisions where they are installed, which is determined in accordance with the FTP Code and applicable provisions of IMO circular MSC.1/Circ.1319 for large fire doors. Doors and doorframes in "A" class divisions shall be made of steel or other equivalent material. Doors in "B" class divisions shall be non-combustible.

**2.1.3.2** The doors designed in compliance with the requirements of 7.5.2 and 7.12, Part III "Equipment, Arrangements and Outfit" and fitted according to 7.12 of the above mentioned Part, and, in certain cases (e.g., for providing gastightness), if specially agreed with the Register, may be fitted in "A" class bulkheads. As doors fitted in watertight bulkheads of cargo and passenger ships and subject to fire integrity and water tightness requirements, watertight doors may serve but not need to be fire-tested notwithstanding the fire integrity of the division in which they are fitted.

However, such doors fitted above the bulkhead deck on passenger ships shall be tested to the FTP Code in accordance with the fire integrity of the division they are fitted.

If it is not practical to ensure self-closing for the said doors which shall be self-closing, means of indication on the bridge showing whether these doors are open or closed and a notice "To be kept closed at sea" can be alternative of the self-closing.

Where a watertight door is located adjacent to a fire door, both doors shall be capable of independent operation, remotely if required by 7.12, Part III "Equipment, Arrangements and Outfit" and from both sides of each door.

**2.1.3.3** If the "A" class divisions are penetrated, then such penetrations (cutouts) shall be tested in accordance with the FTP Code, considering the provisions of [2.2.1.4](#). The requirements of 12.1.12 and 12.1.13, Part VIII "Systems and Piping" are applied to ventilation ducts.

Tests may not be conducted if the pipes penetrations are made of steel or other equivalent material with a thickness of 3 mm or greater and a length of not less than 900 mm (preferably 450 mm at each side of the division) and do not have any openings. Such penetrations shall be insulated similar to the division itself.

In case where pipe penetrations and cable transits are constructed without structural sockets and consist of removable sleeves welded or bolted to the division and/or of soft or intumescent filling material, these sleeves shall be of minimum 3 mm thickness and of minimum 60 mm length and filling material shall be adequately secured by bonded materials or mechanical means in order to prevent damage or fall out. Such penetrations shall not impair fire integrity and structural strength of the divisions.

Type approval of pipe penetrations and cable transits where heat-sensitive materials are used and which are subject to fire integrity and water tightness requirements and which are designed to be fitted in bulkheads and decks of passenger ships and special purpose ships, which fire protection shall be arranged equivalent to that of passenger ships, shall include a prototype test of watertightness in accordance with the procedure specified in Appendix 1 to Section 4, Part IV "Technical Supervision during Manufacture of Products" of the Rules for Technical Supervision during Construction of Ships and Manufacture of Materials and Products for Ships. Fire tests and tests of watertightness for such penetrations and transits designed to be fitted in bulkheads and decks of cargo ships and special purpose ships, which fire protection shall be arranged equivalent to that of cargo ships may be performed independently of each other.

**2.1.3.4** If "B" class divisions are penetrated for the passage of electric cables, pipes, ducts, trunks, etc., or for the fitting of the ventilation terminals, lighting fixtures and similar devices, arrangements shall be provided to ensure fire integrity of a division. Ventilation ducts shall comply with the requirements of 12.1.13, Part VIII "Systems and Piping". Pipes other than steel or copper that penetrate "B" class divisions shall be protected by the following:

.1 fire tested penetration device, adequate to the fire integrity of the division penetrated and the type of pipes used; or

.2 steel sleeve, having a thickness of not less than 1,8 mm and a length of not less than 900 mm for pipe diameters of 150 mm or greater and not less than 600 mm for pipe diameters of less than 150 mm (preferably equally divided at each side of the division). Pipes shall be connected to the ends of the sleeve by flanges or couplings; or the clearance between the sleeve and the pipe shall not exceed 2,5 mm; or any clearance between the pipe and the sleeve shall be made tight by means of non-combustible or other suitable material.

**2.1.3.5** Uninsulated metallic pipes penetrating "A" or "B" class divisions shall be made of materials having a melting temperature exceeding 950 °C for "A-0" class divisions and 850 °C for "B-0" class divisions.

**2.1.3.6** In ships other than passenger ships carrying more than 36 passengers external boundaries, which shall be made of steel or other equivalent material, may be penetrated for the fitting of windows and side scuttles, provided there is no requirement in the present Part for such boundaries to be of "A" class. In such boundaries, which are not required to be of "A" class, doors on agreement with the Register may be made of materials the ventilation ducts than the ones of the boundary.

**2.1.3.7** Balancing openings or ducts between two enclosed spaces are prohibited except for the openings permitted by [2.2.4.3](#) and [2.3.8](#).

**2.1.4 Measures for prevention of spread of fire and smoke.**

**2.1.4.1** For machinery spaces provision shall be made to control the opening and closing of skylights, arrangements for closing openings in funnels, which normally ensure exhaust ventilation as well as closing of ventilation flaps.

The controls shall be located outside the serviced space where they would not be isolated in case of fire in the space.

**2.1.4.2** For the protection of openings in the boundaries of A category machinery spaces the following measures shall be taken:

.1 the number of skylights, doors, ventilation openings, openings in funnels to permit exhaust ventilation and other openings shall be reduced to a minimum required for ventilation, as well as proper and safe operation of ship;



- .2 skylights shall be made of steel and shall have no glass panels;
  - .3 provision shall be made to control the closing of power operated doors or actuating release mechanism of doors other than watertight power operated doors. The controls shall be located outside the serviced space where they would not be isolated in case of fire in the space;
  - .4 windows shall not be fitted in machinery spaces boundaries. However, this does not preclude the use of glass in control stations within the machinery spaces;
  - .5 in passenger ships the requirements of [2.2.4.1](#) shall be met additionally.
- Skylights of cargo pump rooms, specified in [1.5.7.1](#), shall be made of steel and shall be closed from a position located outside the pump room.
- 2.1.4.3** In accommodation and service spaces, as well as in control stations stairways and lift trunks shall be protected in the following way:
- .1 in cargo ships stairways which penetrate only a single deck shall be protected at least at one level by at least "B-0" class divisions and self-closing doors. Lifts which penetrate only a single deck shall be surrounded by "A-0" class divisions with steel doors at both levels. Stairways and lift trunks which penetrate more than a single deck shall be surrounded by at least "A-0" class divisions and protected by self-closing doors at all levels. Stairway enclosures may be arranged so as to allow to go from one stair to a superimposed stair within such enclosure ([Fig. 2.1.4.3.1-1](#)), or to enclose the stairs only with doors at each end of the stair ([Fig. 2.1.4.3.1-2](#)), or to enclose the stairs only in combination with fully closed steel stairs and doors fitted at the end of each stair ([Fig. 2.1.4.3.1-3](#));
  - .2 on ships having accommodation for 12 persons or less, where stairways penetrate more than a single deck and where there are at least two escapes direct to the open deck at every accommodation level, stairways and lift trunks may be protected by "B-0" class divisions;
  - .3 in passenger ships the stairways and lift trunks shall be protected in compliance with [2.2.2.4](#);
  - .4 the construction of stairways shall comply with the requirements of 8.5.4, Part III "Equipment, Arrangements and Outfit".

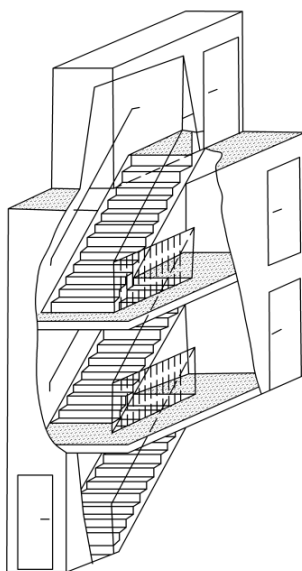


Fig. 2.1.4.3.1-1

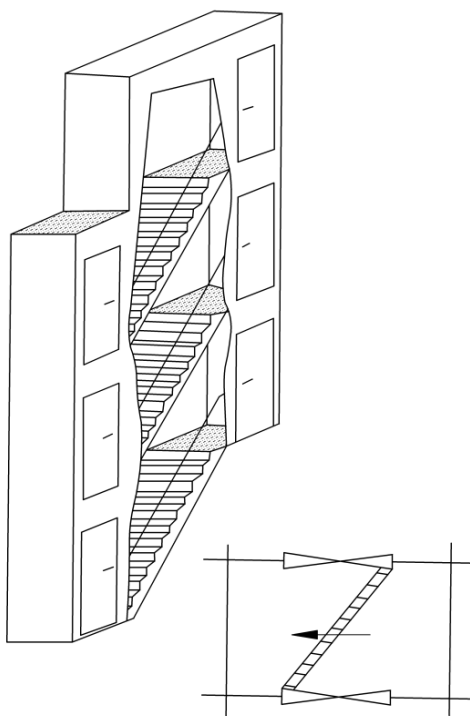


Fig. 2.1.4.3.1-2

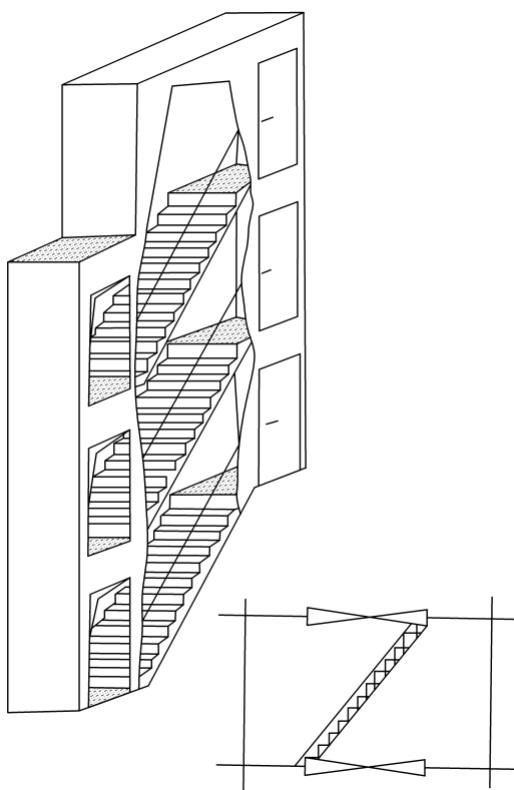


Fig. 2.1.4.3.1-3

**2.1.4.4** Air spaces enclosed behind ceilings, panellings, or linings shall be divided by close-fitting draught stops spaced not more than 14 m apart.

In the vertical direction, such air spaces, including those behind linings or stairways, trunks, etc. shall be closed at each deck.

**2.1.4.5** In machinery spaces from which two stairways are provided in accordance with 4.5, Part VII "Machinery Installations" one of them shall be protected by enclosure along its whole length meeting requirement [2.2.1.3](#) category (2) or requirements [2.2.1.5](#), [2.3.3](#), [2.4.2](#), [2.5.3](#) or [2.6.3](#) category (4) as appropriate. Self-closing fire doors of the same type of fire integrity shall be fitted in the enclosure.

Stairways shall be arranged to avoid transfer of heat to the enclosure through uninsulated fixing points.

**2.1.4.6** In addition to watertight door separating the machinery space of category A from the shaft tunnel, from the side of the latter a light steel fire-screen door shall be fitted to be operated from each side.

**2.1.4.7** Permanent openings in the side shell, ends and ceiling of enclosed spaces for the carriage of vehicles, enclosed ro-ro spaces, as well as special category spaces shall be so situated that a fire in these spaces does not endanger stowage areas and embarkation stations for lifeboats and liferafts, accommodation spaces, service spaces and control stations in superstructures and deckhouses above the mentioned spaces.

**2.1.5 Additional requirements to spaces of separate categories.**

In addition to the requirements of [Section 2](#), the following requirements to structural fire protection shall be complied with.

**2.1.5.1** Saunas shall comply with the following requirements:

.1 the perimeter of the sauna shall be of "A-60" class boundaries except spaces inside of the perimeter and spaces of categories (5), (9) and (10) as specified in [2.2.1.3](#), or spaces of categories (5), (7) and (10) as specified in [2.2.1.5.1](#), [2.3.3](#), [2.4.2](#), [2.5.3](#) or [2.6.3](#), depending on the purpose of ship;

.2 saunas may include changing rooms, showers and toilets. Bathrooms with direct access to saunas may be considered as part of them. In such cases, the door between sauna and the bathroom need not comply with fire safety requirements;

.3 the traditional wooden lining on the bulkheads and ceiling are permitted in the sauna. The ceiling above the oven shall be lined with non-combustible plate with an air gap of at least 30 mm. The distance from the hot surfaces to combustible materials shall be at least 500 mm or the combustible materials shall be protected (e.g., by a non-combustible plate with an air gap of at least 30 mm);

.4 the traditional wooden benches are permitted in saunas;

.5 the sauna door shall have no locks and open outwards by pushing;

.6 electrically heated ovens shall be provided with a timer and meet the requirements of Section 15, Part XI "Electrical Equipment", while cables and wires shall meet the requirements of 16.8 of the same Part.

**2.1.5.2** Galleys shall comply with the following requirements:

.1 galleys utilizing sources of power other than electricity shall not be adjacent to storerooms for flammable materials and substances or to fuel oil and lubricating oil tanks;

.2 galley decks shall be covered with ceramic tiles or similar non-combustible covering;

.3 exhaust ventilation ducts from galley ranges shall meet the requirements of 12.2.4, 12.2.7 or 12.3.6, Part VIII "Systems and Piping".

**2.1.5.3** Storerooms for flammable materials and substances shall comply with the following requirements:

.1 storerooms for flammable materials shall not be generally situated in common with accommodation spaces in superstructure or deckhouse. Access to the storerooms shall be provided from the open deck directly or through a corridor and/or a stairway leading only to these storerooms;

**.2** all electrical equipment of the storeroom shall be explosion proof in compliance with 2.9, Part XI "Electrical Equipment".

**2.1.5.4** Oxygen and acetylene cylinders for electric and gas welding operations shall be kept in separate storerooms, complying with the following requirements:

**.1** acetylene cylinders storeroom shall be independent of the oxygen cylinder storeroom;

**.2** storerooms shall be located on or above the uppermost continuous deck and shall not be adjacent to accommodation spaces, control stations, galleys, storerooms for flammable materials, as well as to fuel oil and lubricating oil tanks;

**.3** divisions separating the storerooms from adjacent spaces shall be of "A-60" class;

**.4** such spaces shall have direct access from the open deck, the doors shall open outwards and be fitted with locks providing their reliable closure to prevent unauthorized access;

**.5** the warning plates: "Danger of explosion!" and "No smoking!" shall be provided on the storerooms doors.

**2.1.5.5** Cargo spaces specified in [1.5.4.3](#), [1.5.4.4](#) and [1.5.9](#), in which motor vehicles with fuel in their tanks are carried, shall comply with the following requirements:

**.1** entrances to the cargo spaces from accommodation, machinery and special electrical spaces shall be equipped with self-closing permanently closed doors. The coamings height of these doors shall not be less than 450 mm;

**.2** warning plates prohibiting smoking shall be provided near the entrances to the cargo spaces;

**.3** the cargo spaces shall comply with the requirements of 12.6, Part VIII "Systems and Piping" and 19.3, Part XI "Electrical Equipment".

**2.1.5.6** Spaces for electric and gas welding operations shall comply with the following requirements:

**.1** spaces shall be located on or above the uppermost continuous deck with access to the space from the open deck through a steel door opening outwards fitted with a lock; herewith welding stations may be located in the workshop of the engine room as well as on the open deck in lockable metal cabinets;

**.2** the spaces shall be separated from any adjacent space by "A" class division considering requirements of Tables [2.2.1.3-1](#), [2.2.1.3-2](#), [2.2.1.5-1](#), [2.2.1.5-2](#), [2.3.3-1](#), [2.3.3-2](#), [2.4.2-1](#), [2.4.2-2](#), [2.5.3-1](#), [2.5.3-2](#), [2.6.3-1](#), [2.6.3-2](#);

**.3** spaces shall be equipped with mechanical ventilation providing not less than 20 air changes per hour.

**2.1.5.7** Fan rooms serving engine rooms shall meet the following requirements:

**.1** a fan room solely serving the engine room or multiple spaces containing an engine room may be treated as machinery space having little or no fire risk, in this case boundaries between the fan room and engine room casing shall be of "A-0" fire integrity;

**.2** a fan room solely serving the engine room may be considered as part of the engine room, in this case the requirements for fire integrity of the horizontal boundary between fan room and engine room need not apply;

**.3** for both of the cases described above, for any space(s) adjacent to the fan room superstructure, the fire integrity of the separating bulkhead(s) shall meet the applicable fire integrity requirements contained in these Rules.

**2.1.5.8** Independent back-up dynamic positioning control system shall be arranged in a special space separated by "A-60" class bulkhead from the main control station in accordance with 8.9.3, Part XV "Automation".

**2.1.5.9 Incinerators and waste stowage spaces.**

As regards structure, equipment and insulation, the incinerator rooms shall be considered as category "A" machinery spaces; waste stowage spaces, garbage grinding and compacting spaces – as service spaces. The following is subject to consideration:

.1 requirements for structural fire protection in compliance with [2.2.1.3](#), [2.2.1.5](#), [2.3.3](#), [2.4.2](#) and [2.6.3](#) may not be applied, if the spaces are arranged as far as practicable; at least 3 m from entrances, air inlets or openings to accommodations, service spaces and control stations, not less than 5 m measured horizontally from the nearest hazardous area or vent outlet from a hazardous area; not less than 2 m shall separate the incinerator and the waste material stowage area, unless physically separated by a structural fire barrier;

.2 in case the spaces are located on weather deck, they shall be accessible with two means of fire extinguishment; either fire hoses or fire extinguishers in compliance with [para 5](#), Table 5.1.2; fire monitors, or fixed fire-extinguishing system.

**2.1.5.10 Ballast Water Management Rooms (BWMR)** shall meet the following requirements:

.1 BWMR as specified in 8.7.2, Part VIII "Systems and Piping" shall be treated as follows for the purpose of applying the requirements of fire protection:

.1.1 machinery spaces of category A when BWMR contain oil-fired inert gas generators (i.e., BWMS categories 3b and 3c as according to Table 8.7.2, Part VIII "Systems and Piping");

.1.2 other machinery spaces of category (7) in compliance with [2.2.1.5.1](#), [2.3.3](#), [2.4.2](#), [2.5.3](#), of category (10) or (11) in compliance with [2.2.1.3](#) depending on the ship type when BWMR are fitted with other systems that are not given in [2.1.5.10.1.1](#);

.1.3 machinery spaces in compliance with [2.1.5.10.1.1](#) и [2.1.5.10.1.2](#) and storerooms in compliance with [2.1.5.10.2](#) in case where the storage of liquid or solid chemicals for BWMS is foreseen in BWMR;

.1.4 category (8) spaces in compliance with 2.4.2 in case when BWMR are located in the cargo area of a tanker in compliance with IACS UR M74 (Rev.2 June 2021) available on the IACS website [www.iacs.org.uk](http://www.iacs.org.uk);

.2 spaces where the storage of liquid or solid chemicals for BWMS is intended shall be categorized as:

.2.1 storerooms of category (5) in compliance with [2.2.1.5](#), [2.3.3](#) and [2.5.3](#) (service spaces (low risk)) having areas less than 4 m<sup>2</sup> and not having provisions for the storage of flammable liquids;

.2.2 storerooms of category (9) in compliance with [2.2.1.5](#), [2.3.3](#) and [2.5.3](#) (service spaces (high risk));

.2.3 storerooms of category (13) in compliance with [2.2.1.3](#);

.2.4 other spaces of category (14) in compliance with [2.2.1.3](#) in which flammable liquids are stowed;

.2.5 pump rooms of category (8) in compliance with [2.4.2](#);

.3 the ship's shell plating shall not form any boundary of the integral tanks storing chemical substances. Tanks containing chemicals shall be segregated from control stations, accommodation and service spaces, machinery spaces not related to the BWMS and from drinking water and stores for human consumption by means of a cofferdam, void space, cargo pump-room, empty tank, oil fuel storage tank, BWMR or other similar space. On-deck stowage of permanently attached deck tanks or installation of independent tanks in otherwise empty hold spaces shall be considered as satisfying the above requirements;

.4 for BWMS storing, introducing or generating chemicals, the BWMR and chemical substance storage rooms shall not be located in the accommodation area. Any ducts of the exhaust ventilation or other openings from these rooms shall be located not less than 3 m from entrances, air inlets and openings to accommodation spaces. This requirement is not applied in case the BWMR is located in the machinery space of category A.

The requirements of [2.1.5.10.3](#) and [2.1.5.10.4](#) may be reduced if the chemicals are neither toxic nor flammable. Herewith, the risk assessment of the used substances shall be carried out based on data from the IMO reports issued during the basic and final approval procedures of the BWMS that make use of active substances (Procedure for Approval of Ballast Water Management Systems that Make Use of Active Substances (G9) adopted by IMO resolution MEPC.169(57)), and "safety hazard" as listed in Chapter 17 of the International Code for the Construction and Equipment of Ships Carrying Dangerous Chemicals in Bulk (IBC Code) for the used substances;

**.5** ozone-based BWMS, i.e. categories 7a and 7b given in Table 8.7.2, Part VIII "Systems and Piping" shall be located in dedicated compartment, separated from any other space by gastight boundaries. Access to the BWMR from any other enclosed space shall be through airlock only that meets the requirements of 8.7.1.4, Part VIII "Systems and Piping".

Access to the specified BWMR may be provided through the machinery spaces of category A only when:

**.5.1** access is provided through airlock only; or

**.5.2** an alarm repeater is provided in the BWMR, which repeats any alarm activated in the machinery space of category A;

**.6** a sign shall be affixed on the door of BWMR providing personnel with a warning that ozone may be present and with the necessary instructions to be followed before entering the room;

**.7** BWMR containing equipment for BWMS of the following types shall be equipped with tested gastight and self-closing doors:

**.7.1** BWMS storing, introducing or generating chemical substances;

**.7.2** de-oxygenation based on inert gas generator;

**.7.3** electrolysis;

**.7.4** ozone injection.

Doors leading to the open deck need not to be self-closing.

The requirements may be reduced if BWMS does not generate hazardous gases specified in Table 8.7.2, Part VIII "Systems and Piping" and 2.3 of IACS UR M74 (Rev.2 June 2021) available on the IACS website [www.iacs.org.uk](http://www.iacs.org.uk);

**.8** BWMR containing equipment related to ozone-based BWMS shall be provided with a fire extinguishing system suitable for machinery spaces of category A according to [Table 3.1.2.1](#) and capable of manual release;

**.9** where a fixed fire extinguishing system is provided in the BWMR, it shall be compatible with the BWMS and the chemical products that are used, produced or stored in the BWMR. Specific attention shall be paid to potential chemical reactions between the fire extinguishing medium and chemical products used for water treatment. Especially, water-based fire extinguishing systems shall be avoided in case of sulfuric acid storage.

In case a foam fire extinguishing system is installed in the BWMR, its efficiency shall not be impaired by chemicals used by the BWMS;

**.10** automatic shutdown of the BWMS upon release of the fixed fire extinguishing system shall be arranged considering the need for cooldown necessary for safe shutdown of the equipment;

**.11** where BWMS that includes air or O<sub>2</sub> storage is located in a room covered by a fixed gas fire extinguishing system, air or O<sub>2</sub> storage shall be taken into account for the gas capacity calculation, unless the discharge pipe from safety valves for air or O<sub>2</sub> storage are led directly to outside the room;

**.12** there shall be at least one portable fire extinguisher that complies with the requirements of [5.1.9](#) and suitable for electrical fires in the BWMR containing UV-type BWMS.



## 2.2 PASSENGER SHIPS

### 2.2.1 General.

**2.2.1.1** The requirements of this Chapter are additional to those set out in [2.1](#).

**2.2.1.2** For ships carrying more than 36 passengers, the hull, superstructure and deckhouses shall be divided into main vertical zones by "A-60" class divisions. Steps and recesses shall be kept to a minimum, but where they are necessary they shall also be "A-60" class divisions. Where a class [2.2.1.3 \(5\)](#), [2.2.1.3 \(9\)](#) or [2.2.1.3 \(10\)](#) space is on one side of the division the class may be reduced to "A-0".

For ships carrying not more than 36 passengers, the hull, superstructure and deckhouses in way of accommodation and service spaces shall be divided into main vertical zones by "A" class divisions. These divisions shall have insulation values in accordance with Tables [2.2.1.5-1](#) and [2.2.1.5-2](#).

As far as practicable, the bulkheads forming the boundaries of the main vertical zones above the bulkhead deck shall be in line with watertight subdivision bulkheads situated immediately below the bulkhead deck. The length and width of main vertical zones may be extended to a maximum of 48 m in order to bring the ends of main vertical zones to coincide with subdivision watertight bulkheads or in order to accommodate a large public space extending for the whole length of the main vertical zone provided that the total area of the main vertical zone is not greater than 1600 m<sup>2</sup> on any deck.

If a stairway serves two main vertical zones, then maximum length of one main vertical zone shall be measured from the far side of the main vertical zone stairway enclosure. In this case, all boundaries of the stairway enclosure are to be insulated as main vertical zone bulkheads and access doors leading to the stairway are to be provided from these zones (refer to [Figs. 2.2.1.2-1 to 2.2.1.2-4](#)). However, the stairway is not to be included in calculating size of the main vertical zone if it is treated as its own main vertical zone.

Bulkheads forming the boundaries of main vertical zones shall extend from deck to deck and to the shell or other boundaries.

Where the main vertical zone is divided by horizontal "A" class divisions into horizontal zones for the purpose of providing an appropriate barrier between sprinklered and non-sprinklered zones of the ship, the divisions shall extend between adjacent main vertical zone bulkheads and to the shell or exterior boundaries of the ship and shall be insulated in accordance with the fire insulation classes given in [Table 2.2.1.5-2](#).

On ships designed for special purposes, such as automobile or railroad car ferries, where the provision of main vertical zone bulkheads would defeat the purpose for which the ship is intended, equivalent means for controlling and limiting a fire, such as water screens complying with the requirements of [3.5](#), shall be provided. Service spaces and storerooms if they are not protected in compliance with the applicable requirements shall not be located on decks of ships specified in [1.5.4.3](#).

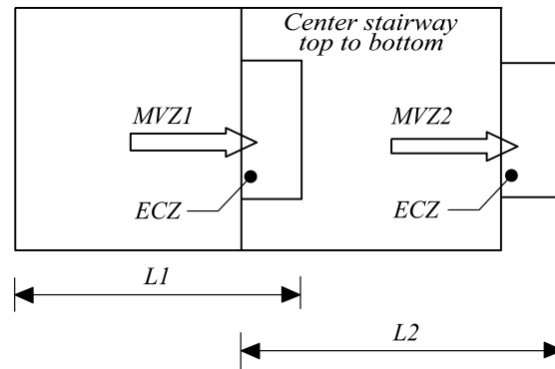


Fig. 2.2.1.2-1  
ECS serves one MVZ

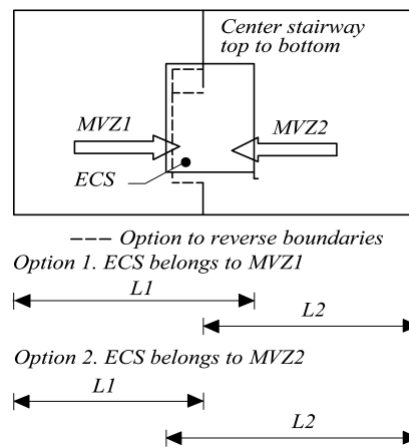


Fig. 2.2.1.2-2  
ECS serves two MVZ

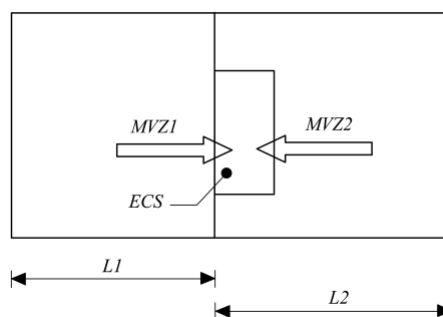


Fig. 2.2.1.2-3  
ECS serves two MVZ (ECS belongs to MVZ2)



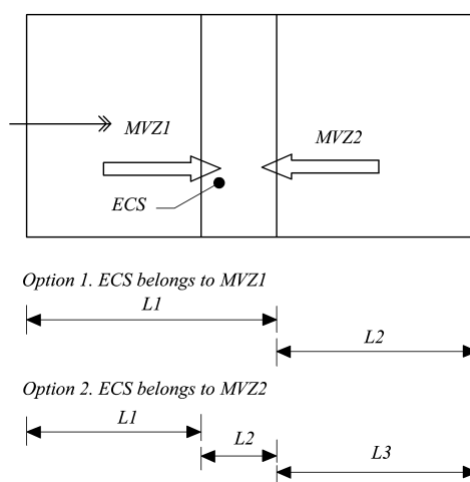



Fig. 2.2.1.2-4  
ECS serves two MVZ

Notes :  
 MVZ: Main vertical zone  
 ECS: Escape stairway  
 Direction of escape.

#### 2.2.1.2.1 Protection of atriums:

.1 atriums shall be within enclosures formed of "A" class divisions having a fire rating determined in accordance with Tables [2.2.1.3-2](#) and [2.2.1.5-1](#), as applicable;

.2 decks separating spaces within atriums shall have a fire rating determined in accordance with Tables [2.2.1.3-2](#) and [2.2.1.5-1](#), as applicable.

**2.2.1.3** The minimum fire integrity of all bulkheads and decks separating adjacent spaces in ships carrying 36 passengers and more shall be as prescribed in Tables [2.2.1.3-1](#) and [2.2.1.3-2](#).

Table 2.2.1.3-1

**Bulkheads not bounding either main vertical zones or horizontal zones**

Spaces	(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)
Control stations	(1)	B-0 <sup>1</sup>	A-0	A-0	A-0	A-0	A-60	A-60	A-60	A-0	A-0	A-60	A-60	A-60
Stairways	(2)		A-0 <sup>1</sup>	A-0	A-0	A-0	A-0	A-15	A-15	A-0 <sup>2</sup>	A-0	A-15	A-30	A-15
Corridors	(3)			B-15	A-60	A-0	B-15	B-15	B-15	B-15	A-0	A-15	A-30	A-0
Evacuation stations and external escape routes	(4)				A-0	A-60 <sup>3,4</sup>	A-60 <sup>3,4</sup>	A-60 <sup>3,4</sup>	A-0 <sup>4</sup>	A-0 <sup>3</sup>	A-60 <sup>3</sup>	A-60 <sup>3</sup>	A-60 <sup>3</sup>	A-60 <sup>3</sup>
Open deck spaces	(5)				—	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0
Accommodation spaces of minor fire risk	(6)					B-0	B-0	B-0	C	A-0	A-0	A-30	A-0	A-30
Accommodation spaces of moderate fire risk	(7)						B-0	B-0	C	A-0	A-15	A-60	A-15	A-60
Accommodation spaces of greater fire risk	(8)							B-0	C	A-0	A-30	A-60	A-15	A-60
Sanitary and similar spaces	(9)								C	A-0	A-0	A-0	A-0	A-0
Tanks, voids and auxiliary machinery spaces having minor or no fire risk	(10)									A-0 <sup>1</sup>	A-0	A-0	A-0	A-0
Auxiliary machinery spaces, cargo spaces, special category spaces, cargo and other oil tanks and other similar spaces of moderate fire risk	(11)										A-0 <sup>1</sup>	A-0	A-0	A-15
Machinery spaces and main galleys	(12)											A-0 <sup>1</sup>	A-0	A-60
Storerooms, workshops, pantries, etc.	(13)												A-0 <sup>1</sup>	A-0
Other spaces in which flammable liquids are stored	(14)													A-30

<sup>1</sup> If adjacent spaces marked with footnote 1 have the same fire integrity, it is not necessary to divide such spaces with a bulkhead or deck. For instance for spaces of category (12) it is not necessary to divide a galley and buffets which are part thereof with bulkheads provided the bulkheads and buffet decks have the same fire resistance equal to that of structures bordering the galley. However, it is necessary to erect a bulkhead between the galley and machinery space although both spaces have the same category (12).

<sup>2</sup> Where public toilets are installed completely within the stairway enclosure, the public toilet bulkhead within the stairway enclosure can be of "B" class fire integrity.

<sup>3</sup> The ship's side, to the waterline in the lightest seagoing condition, superstructure and deckhouse sides situated below and adjacent to the liferafts and evacuation slides may be reduced to "A-30" class.

<sup>4</sup> Where spaces of categories (6), (7), (8) and (9) are located completely within the outer perimeter of the muster station, the bulkheads of these spaces are allowed to be of "B-0" class fire integrity. Control positions for audio, video and light installations may be considered as part of the muster station.

Notes: 1. The need to apply the requirements of [Table 2.2.1.3-1](#) for the spaces of category (5) in respect of the bounded superstructures and deckhouses, as well as requirements of [Table 2.2.1.3-2](#) for the spaces of category (5) in respect of the spaces bounded by the upper deck shall be determined by the ship designer and agreed with the Register.

2. Where the contents and use of a space are such that there is a doubt as to its classification, it shall be treated as a space within the relevant category having the most stringent boundary requirements.

3. Notwithstanding the provisions of [2.2.2](#) there are no special requirements for material or fire integrity of boundaries where only a dash appears in the tables.

4. Small enclosed spaces inside the room are treated as separate spaces if square of doorways to adjacent spaces is less than 30 % of openings (doorways). Fire integrity of bulkheads and decks surrounding such spaces shall comply with the requirements set forth in tables of the paragraph.

Table 2.2.1.3-2

### Decks not forming steps in main vertical zones nor bounding horizontal zones

Spaces below		Spaces above													
		(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)
Control stations	(1)	A-30	A-30	A-15	A-0	A-0	A-0	A-15	A-30	A-0	A-0	A-0	A-60	A-0	A-60
Stairways	(2)	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-30	A-0	A-30
Corridors	(3)	A-15	A-0	A-0 <sup>1</sup>	A-60	A-0	A-0	A-15	A-15	A-0	A-0	A-0	A-30	A-0	A-30
Evacuation stations and external escape routes	(4)	A-0	A-0	A-0	A-0	–	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0
Open deck spaces	(5)	A-0	A-0	A-0	A-0	–	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0
Accommodation spaces of minor fire risk	(6)	A-60	A-15	A-0	A-60	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0
Accommodation spaces of moderate fire risk	(7)	A-60	A-15	A-15	A-60	A-0	A-0	A-15	A-15	A-0	A-0	A-0	A-0	A-0	A-0
Accommodation spaces of greater fire risk	(8)	A-60	A-15	A-15	A-60	A-0	A-15	A-15	A-30	A-0	A-0	A-0	A-0	A-0	A-0
Sanitary and similar spaces	(9)	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0
Tanks, voids and auxiliary machinery spaces having minor or no fire risk	(10)	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0	A-0 <sup>1</sup>	A-0	A-0	A-0	A-0
Auxiliary machinery spaces, cargo spaces, special category spaces, cargo and other oil tanks and other similar spaces of moderate fire risk	(11)	A-60	A-60	A-60	A-60	A-0	A-0	A-15	A-30	A-0	A-0	A-0 <sup>1</sup>	A-0	A-0	A-30
Machinery spaces and main galleys	(12)	A-60	A-60	A-60	A-60	A-0	A-60	A-60	A-60	A-0	A-0	A-30	A-30 <sup>1</sup>	A-0	A-60
Storerooms, workshops, pantries, etc.	(13)	A-60	A-30	A-15	A-60	A-0	A-15	A-30	A-30	A-0	A-0	A-0	A-0	A-0	A-0
Other spaces in which flammable liquids are stored	(14)	A-60	A-60	A-60	A-60	A-0	A-30	A-60	A-60	A-0	A-0	A-0	A-0	A-0	A-0

1 Refer to [Footnote 1](#) to Table 2.2.1.3-1.  
Note. Refer to notes to [Table 2.2.1.3-1](#).

For the purpose of determining the class of structures between adjacent spaces, such spaces are classified according to their fire risk as follows.

(1) Control stations — spaces accommodating emergency sources of electrical power and lighting; wheelhouse and navigation room; spaces accommodating ship radio equipment; fire stations; main machinery control room if it is located outside the space accommodating such machinery; spaces accommodating centralized fire alarm system; spaces accommodating central control stations and emergency loud speaking system equipment.

(2) Stairways: interior stairways, lifts, fully enclosed trunks for evacuation and escalators for passengers and crew (except those, which are fully located in machinery spaces) and their enclosures.

A stairway which is enclosed at only one level shall be regarded as part of the space from which it is not separated by a fire door.

(3) Corridors:

corridors and lobbies for passengers and crew.

(4) Evacuation stations and external escape routes; survival craft stowage area; open deck spaces and enclosed promenades forming lifeboat and liferaft embarkation and launching stations; muster stations, internal and external; external stairs and open decks used for escape routes; the ship's side to the waterline in the lightest seagoing condition, superstructure and deckhouse sides situated below and adjacent to the liferaft's and evacuation slide's embarkation areas.

(5) Open deck spaces:

open deck spaces and enclosed promenades clear of lifeboat and liferaft embarkation and launching stations. To be considered in this category, enclosed promenades shall have no fire risk. This means that furnishings shall be restricted to deck furniture. In addition, such places shall be naturally ventilated by permanent openings;

air spaces (spaces outside superstructures and deckhouses).

(6) Accommodation spaces of minor fire risk: cabins, offices, dispensaries and public spaces containing furniture and furnishings of restricted fire risk and having a deck area of less than 50 m<sup>2</sup> ([refer to 1.2](#)).

(7) Accommodation spaces of moderate fire risk:

accommodation spaces as in category (6) containing furniture and furnishings other than of restricted fire risk;

public spaces containing furniture and furnishings of restricted fire risk and having a deck area of 50 m<sup>2</sup> and greater;

isolated lockers and small storerooms in accommodation spaces having areas less than 4 m<sup>2</sup> (in which flammable liquids are not stowed);

cleaning gear lockers, laboratories (in which flammable liquids are not stowed);

drying rooms (having a deck area of 4 m<sup>2</sup> or less);

diet kitchens (containing no open flame);

specie rooms;

motion picture projection rooms and film rooms;

drug-stores;

operating rooms;

spaces accommodating electrical distribution boards with an area less, than 4 m<sup>2</sup>.

(8) Accommodation spaces of greater fire risk:

public spaces containing furniture and furnishings of other than restricted fire risk and having a deck area of 50 m<sup>2</sup> and greater, sale shops;

barber shops, beauty parlours and saunas.

(9) Sanitary and similar spaces:

communal sanitary facilities, showers, baths, water closets, etc.;

small laundry rooms;

indoor swimming pool area;  
isolated serving pantries containing no cooking appliances in accommodation spaces.  
Individual sanitary spaces shall be considered a portion of the spaces in which they are located.

(10) Tanks, voids and auxiliary machinery spaces having little or no fire risk:  
water tanks forming part of the ship's structure;  
voids and cofferdams;  
auxiliary machinery spaces which do not contain machinery having a pressure lubrication system and where storage of combustibles is prohibited, such as: ventilation and air-conditioning rooms; windlass room; steering gear room; spaces accommodating stabilizer equipment; electrical propulsion motor room; rooms containing section switchboards and purely electrical equipment, except oil transformers (with capacity over 10 kVA); shaft alleys and pipe tunnels; spaces for pumps and refrigeration machinery (not handling or using flammable liquids);  
closed trunks serving the spaces listed above;  
other closed trunks such as pipe and cable trunks;  
spaces separated from engine room where urea or sodium hydroxide solution tanks for selective catalytic reduction (SCR) systems, exhaust gas recirculation (EGR) systems or exhaust gas cleaning systems (EGCS) are installed.

(11) Auxiliary machinery spaces, cargo spaces, cargo and other oil tanks and other similar spaces of moderate fire risk:  
cargo oil tanks;  
cargo holds, trunkways and hatchways;  
refrigerated chambers;  
fuel oil tanks (where installed in a separate space with no machinery);  
shaft alleys and pipe tunnels allowing storage of combustibles;  
auxiliary machinery spaces as in category (10) which contain machinery having a pressure lubrication system or where storage of combustibles is permitted;  
fuel oil filling stations;  
spaces containing turbine and reciprocating steam engine driven auxiliary generators and small internal combustion engines up to 110 kW driving generators, sprinkler, drencher or fire pumps, bilge pumps, etc.;  
closed trunks serving the spaces listed above;  
spaces accommodating oil transformers (with capacity over 10 kVA).

(12) Machinery spaces and main galleys:  
engine and boiler rooms (other than electric propulsion motor rooms);  
auxiliary machinery spaces other than those in categories (10) and (11) which contain internal combustion machinery or other oil-burning, heating or pumping units;  
main galleys and annexes;  
trunks and casings to the spaces listed above;  
incinerator and combined incinerator/waste stowage spaces, and the flue uptakes from such spaces ([refer to 2.1.5.9](#)).

(13) Storerooms, workshops, pantries, etc.:  
main pantries, not annexed to galleys;  
main laundry;  
large drying rooms (having a deck area of more than 4 m<sup>2</sup>);  
miscellaneous stores;  
mail and baggage rooms;  
garbage rooms and garbage chutes connected thereto;  
workshops (not part of machinery spaces, galleys, etc.);  
lockers and storerooms having areas of more than 4 m<sup>2</sup> and not having provisions for the storage of flammable liquids.

(14) Other spaces in which flammable liquids are stowed:

paint rooms;

storerooms containing flammable liquids (including dyes, medicines, etc.);

laboratories (in which flammable liquids are stowed).

**2.2.1.4** On ships carrying not more than 36 passengers, where a space is protected by an automatic sprinkler system or fitted with a continuous "B" class ceiling, openings in decks not forming steps in main vertical zones nor bounding horizontal zones shall be closed reasonably tight and such decks shall meet the "A" class requirements.

**2.2.1.5** The minimum fire integrity of all bulkheads and decks separating adjacent spaces in ships carrying not more than 36 passengers shall be as prescribed in Tables [2.2.1.5-1](#) and [2.2.1.5-2](#) with regard to the following:

**.1** for determining the appropriate fire integrity standards to be applied to divisions between adjacent spaces, such spaces are classified according to their fire risk as shown in categories (1) – (11) below:

(1) control stations: spaces accommodating emergency sources of electrical power and lighting; wheelhouse and navigation room; spaces accommodating ship radio equipment; fire stations; main machinery control room if it is located outside machinery spaces; spaces accommodating centralized fire alarm system;

(2) corridors and lobbies;

(3) accommodation spaces as defined in [1.5.2](#), except corridors;

(4) stairways:

interior stairways, lifts, totally enclosed emergency escape exits trunks and escalators (other than those wholly contained within machinery spaces) and enclosures thereto.

In this connection, a stairway which is enclosed only at one level shall be regarded as part of the space from which it is not separated by a fire door;

(5) service spaces (low risk):

lockers and storerooms not having provisions for the storage of flammable liquids and having areas less than 4 m<sup>2</sup>, drying rooms and laundries, spaces accommodating electrical distribution boards with an area less than 4 m<sup>2</sup>;

Table 2.2.1.5-1

**Fire integrity of bulkheads separating adjacent spaces**

Spaces		(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)
Control stations	(1)	A-0 <sup>1</sup>	A-0	A-60	A-0	A-15	A-60	A-15	A-60	A-60	*	A-60
Corridors and lobbies	(2)		C <sup>2</sup>	B-0 <sup>2</sup>	A-0 <sup>3</sup> B-0 <sup>2</sup>	B-0 <sup>2</sup>	A-60	A-0	A-0	A-15 A-0 <sup>4</sup>	*	A-30
Accommodation spaces	(3)			C <sup>2</sup>	A-0 <sup>3</sup> B-0 <sup>2</sup>	B-0 <sup>2</sup>	A-60	A-0	A-0	A-15 A-0 <sup>4</sup>	*	A-30 A-0 <sup>4</sup>
Stairways	(4)				A-0 <sup>3</sup> B-0 <sup>2</sup>	A-0 <sup>3</sup> B-0 <sup>2</sup>	A-60	A-0	A-0	A-15 A-0 <sup>4</sup>	*	A-30
Service spaces (low risk)	(5)					C <sup>2</sup>	A-60	A-0	A-0	A-0	*	A-0
Machinery spaces of category A	(6)						*	A-0	A-0	A-60	*	A-60
Other machinery spaces	(7)							A-0 <sup>5</sup>	A-0	A-0	*	A-0
Cargo spaces	(8)								*	A-0	*	A-0
Service spaces (high risk)	(9)									A-0 <sup>5</sup>	*	A-30
Open decks	(10)										—	A-0
Special category spaces	(11)											A-30

<sup>1</sup> Bulkheads separating the wheelhouse and chartroom from each other may be "B-0" class. No fire rating is required for those partitions separating the navigation bridge and the safety centre when the latter is within the navigation bridge.

<sup>2</sup> "B-0" or "C" class bulkheads, where appearing in the table as main fire-fighting bulkheads required by [2.2.1.2](#) shall be read as "A-0" class.

<sup>3</sup> For clarification of the applicable fire integrity standard, refer to [2.2.2.1](#), [2.2.2.2](#) and [2.2.2.4](#).

<sup>4</sup> Where each of the adjacent spaces is protected by an automatic sprinkler system, the lower of the two values given in the tables may be used.

<sup>5</sup> Where the spaces are used for the same purpose, no divisions may be fitted between them.

**Notes :** 1. Where an asterisk appears in the tables the division shall be of steel or equivalent material, but is not required to be of "A" class. However, if in the deck except for the decks in a space of category (10), there are penetrations for electric cables, piping and ventilation ducts, such penetrations shall be flame and smoke tight. Divisions between control stations (emergency generators) and open decks may have air intake openings without closing appliances, except cases when fixed gas fire-fighting system is installed.

2. Refer to Notes [2](#) and [4](#) to Table 2.2.1.3-1.

Table 2.2.1.5-2

**Fire integrity of decks separating adjacent spaces**

Spaces below		Spaces above										
		(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)
Control stations	(1)	A-0	A-0	A-0	A-0	A-0	A-60	A-0	A-0	A-0	*	A-60
Corridors and lobbies	(2)	A-0	*	*	A-0	*	A-60	A-0	A-0	A-0	*	A-30
Accommodation spaces	(3)	A-60	A-0	*	A-0	*	A-60	A-0	A-0	A-0	*	A-30 A-0 <sup>1</sup>
Stairways	(4)	A-0	A-0	A-0	*	A-0	A-60	A-0	A-0	A-0	*	A-30
Service spaces (low risk)	(5)	A-15	A-0	A-0	A-0	*	A-60	A-0	A-0	A-0	*	A-0
Machinery spaces of category A	(6)	A-60	A-60	A-60	A-60	A-60	*	A-60 <sup>2</sup>	A-30	A-60	*	A-60
Other machinery spaces	(7)	A-15	A-0	A-0	A-0	A-0	A-0	*	A-0	A-0	*	A-0
Cargo spaces	(8)	A-60	A-0	A-0	A-0	A-0	A-0	A-0	*	A-0	*	A-0
Service spaces (high risk)	(9)	A-60	A-30 A-0 <sup>1</sup>	A-30 A-0 <sup>1</sup>	A-30 A-0 <sup>1</sup>	A-0	A-60	A-0	A-0	A-0	*	A-30
Open decks	(10)	*	*	*	*	*	*	*	*	*	—	A-0
Special category spaces	(11)	A-60	A-30	A-30 A-0 <sup>1</sup>	A-30	A-0	A-60	A-0	A-0	A-30	A-0	A-30

<sup>1</sup> Refer to [Footnote 4](#) to Table 2.2.1.5-1.

<sup>2</sup> Where other machinery spaces of category (7) are the spaces of low fire risk, i.e. they do not contain machinery operating in fuel oil or having a pressure lubrication systems, "A-0" class divisions are permitted.

Notes : 1. [Refer to Note 1](#) to Table 2.2.1.5-1. Where the requirements of [2.2.1.2](#) are applicable, an asterisk means "A-0" class, except categories (8) and (10).

2. Refer to Notes [2](#) and [4](#) to Table 2.2.1.3-1.



(6) machinery spaces of category A:  
spaces as defined in 1.2, Part VII "Machinery Installations";  
incinerator and combined incinerator/ waste stowage spaces, and the flue uptakes from such spaces ([refer to 2.1.5.9](#)).

(7) other machinery spaces:  
machinery spaces excluding spaces referred to in (6) and spaces accommodating electrical equipment (automatic telephone stations, spaces for air conditioning ducts);  
spaces separated from engine room where urea or sodium hydroxide solution tanks for selective catalytic reduction (SCR) systems, exhaust gas recirculation (EGR) systems or exhaust gas cleaning systems (EGCS) are installed.

(8) cargo spaces: all spaces, which are not special category spaces used for the carriage of cargo (including cargo tanks for oily products), as well as ventilation and hatch trunks servicing such spaces;

(9) service spaces (high risk): galleys, pantries containing appliances for hot food preparation, paint rooms, lockers and storerooms with an area of 4 m<sup>2</sup> and over, spaces for storage of flammable liquids, saunas, workshops and similar spaces, which are not part of machinery spaces;

waste stowage spaces and garbage chutes connected thereto.

(10) open decks:  
open deck spaces and enclosed promenades having no fire risk. To be considered in this category, enclosed promenades shall have no fire risk. This means that furnishings shall be restricted to deck furniture. In addition, such spaces shall be naturally ventilated by means of permanent openings;

air spaces (spaces outside superstructures and deckhouses).

(11) special category spaces as defined in [1.5.9](#) and ro-ro spaces in compliance with [1.5.4.3](#);

.2 the doors from the cabins to individual sanitary spaces may be of combustible materials.

## **2.2.2 Accommodation and service spaces within a main vertical zone.**

**2.2.2.1** For ships carrying more than 36 passengers all bulkheads which are not required to be "A" class divisions shall be "B" class or "C" class divisions as prescribed in [Table 2.2.1.3-1](#).

For ships carrying not more than 36 passengers all bulkheads within accommodation and service spaces which are not required to be "A" class divisions shall be "B" class or "C" class divisions as prescribed in [Table 2.2.1.5-1](#).

All such divisions may be faced with combustible materials in accordance with the provisions of [2.1.1.10](#).

**2.2.2.2** For ships carrying not more than 36 passengers all corridor bulkheads where not required to be "A" class divisions shall be "B" class divisions which shall extend from deck to deck except:

.1 when continuous "B" class ceilings or linings are fitted on both sides of the bulkhead, the portion of the bulkhead behind the continuous ceiling or lining shall be of material which, in thickness and composition, is acceptable in the construction of "B" class divisions but which shall be required to meet "B" class integrity standards only in so far as is reasonable and practicable in the opinion of the Register;

.2 on ships equipped with an automatic sprinkler system complying with the provisions of the FSS Code, corridor bulkheads may end by the corridor ceilings provided that such bulkheads and ceilings are of "B" class in accordance with [2.2.1.5](#). All doors and door frames in such bulkheads shall be made of non-combustible materials and they shall have the same fire integrity as the bulkhead in which they are fitted.

**2.2.2.3** Bulkheads required to be "B" class divisions, except corridor bulkheads required by [2.2.2.2](#), shall extend from deck to deck and to the shell or other boundaries unless the continuous "B" class ceilings or linings, having at least the same fire integrity as the adjacent bulkhead, are fitted on both sides of it, in which case the bulkhead may terminate at the continuous ceiling or lining. If an air gap between the cabins results in an opening in the continuous "B-15" class ceiling, the bulkheads on both sides of the air gap shall be of "B-15" class.

**2.2.2.4** Stairways in accommodation and service spaces shall be protected as follows:

Stairways and lifts shall be protected in the following way:

**.1** stairways shall be enclosed by "A" class divisions with positive closing appliances of all openings, except that a stairway connecting only two decks need not be enclosed, provided the integrity of the deck is ensured by proper bulkheads or self-closing doors. When a stairway is enclosed in 'tween deck, then this enclosure shall be protected in compliance with Tables [2.2.1.3-2](#) or [2.2.1.5-2](#);

**.2** stairways in public spaces may not have enclosures, provided they are located wholly within the public space;

**.3** lift trunks shall be so fitted as to prevent the penetration of smoke and flame from one 'tween-deck compartment to another and shall be provided with closing appliances to prevent draught and smoke penetration. Lifts machinery located within stairways enclosure shall be arranged in a separate space, surrounded by steel boundaries, except that small passages for lift cables are permitted. Lifts, which open into spaces other, than corridors, public spaces, special category spaces, stairways and external spaces shall not open (stop) into stairways serving as the means of escape;

**.4** stairway enclosures shall have direct communications with the corridors and be of sufficient area to comply with 8.5.4.2, Part III "Equipment, Arrangements and Outfit". Within the perimeter of such stairway, enclosures, only public toilets, lockers of non-combustible material providing storage for safety equipment and open information counters are permitted. Only corridors, public toilets, special category spaces, other escape stairways required by Part III "Equipment, Arrangements and Outfit" and external areas are permitted to have direct access to these stairway enclosures. Public spaces may also have direct access to stairway enclosures except for the backstage of a theatre;

**.5** one of the means of escape from a watertight compartment or a main fire vertical zone as required in 8.5.2.1, Part III "Equipment, Arrangements and Outfit" shall consist of enclosed stairways which provide a continuous shelter according to the requirements of [2.2.1.3](#) or [2.2.1.5](#);

**.6** protection of escape routes from the stairways enclosures to the life boats and life rafts embarkation stations shall be provided either directly, or by protected interior passageways, having fire integrity and insulation values for the stairways enclosures as specified by Tables [2.2.1.3-1](#), [2.2.1.3-2](#), [2.2.1.5-1](#), [2.2.1.5-2](#), as applicable;

**.7** on passenger ships, non-load bearing partial bulkheads which separate adjacent cabin balconies shall be capable of being opened by the crew from each side for the purpose of fighting fires.

**2.2.2.5** In all spaces, except for refrigerated provision storerooms, cargo spaces, mail baggage cabins and saunas, the ceilings, bulkheads, linings, draught stops and grounds shall be made of non-combustible materials.

**2.2.2.5.1** Partial bulkheads and decks on passenger ships:

**.1** partial bulkheads or decks used to subdivide a space for utility or artistic treatment shall be of non-combustible materials;

**.2** linings, ceilings and partial bulkheads or decks used to screen or to separate adjacent cabin balconies shall be of non-combustible materials.

**2.2.2.6** In the case of ships fitted with an automatic sprinkler system, combustible materials used for erection of "C" class divisions may be added to the total volume of combustible materials mentioned in [2.1.1.10](#).

**2.2.2.7** The construction of ceiling and bulkheading shall be such that it will be possible, without impairing the efficiency of the fire protection, for the fire patrols to detect any smoke originating in concealed and inaccessible places, except where there is no risk of fire originating in such places.

**2.2.2.8** The furniture in stairway enclosures shall consist of seats only. It shall be fixed to six seats on each deck in each stairway enclosure, be of restricted fire risk determined in accordance with the FTP Code and shall not create obstacles for passengers at the routes of escape. The Register may permit additional seating in the main reception area within the stairway enclosure if it is fixed, non-combustible and do not create obstacles for passengers at the routes of escape. The furniture shall not be permitted in passenger and crew corridors forming escape routes in cabin areas. In addition to the above lockers of non-combustible material, providing storage for fire-fighting equipment and life-saving appliances required by these Rules may be permitted. Drinking water automation devices and ice cube machines may be permitted in corridors provided they are properly fixed and do not restrict the width of the escape routes. This applies as well to decorative flower or plant arrangements, statues or other objects of art such as painting and tapestries in corridors and stairways enclosures.

**2.2.2.9** Linings, ceilings and partial bulkheads used to screen or to separate adjacent cabin balconies shall be of non-combustible materials.

**2.2.2.10** Furniture and furnishings on cabin balconies shall comply with the requirements for rooms containing furniture and furnishings of restricted fire risk (refer to definitions in [1.2](#)) unless such balconies are protected by a fixed pressure water-spraying and fixed fire detection and fire alarm systems complying with the requirements of [3.4.1](#) and [4.2.1.1.5](#).

**2.2.3 Motor vehicles spaces, ro-ro spaces, special category spaces.**

**2.2.3.1** When the special category spaces cannot be protected by main vertical fire zones, their protection shall be ensured by subdivision into horizontal zones. These zones may cover more than one deck, but their overall height calculated as a sum of distances between adjacent decks without regard of framing height shall not exceed 10 m.

Fire doors and passages (cutouts) in decks and bulkheads of "A" class, forming boundaries, which separate horizontal areas from each other as well as the remain part of the ship shall meet the requirements applicable to fire doors and penetrations (cutouts) in horizontal areas ([refer to 2.2.4](#)).

**2.2.3.2** In ships carrying more than 36 passengers the boundary bulkheads and decks of special category spaces shall be "A-60" class. However, where category [2.2.1.3 \(5\)](#), [2.2.1.3 \(9\)](#) or [2.2.1.3 \(10\)](#) space is on one side of the division the class may be reduced to "A-0". If fuel oil tanks are located under special category spaces, the fire integrity of decks between such spaces may be of "A-0" class.

In ships carrying not more than 36 passengers the boundary bulkheads of special category spaces shall be as required for category (11) spaces in [2.2.1.5-1](#) and the horizontal boundaries as required for category (11) spaces in [Table 2.2.1.5-2](#).

In passenger ships carrying not more than 36 passengers, the bulkheads and decks forming boundaries of enclosed and open ro-ro spaces shall have fire integrity required for spaces of category (8) according to [2.2.1.5-1](#), while the horizontal boundaries shall have fire integrity required for spaces of category (8) according to [2.2.1.5-2](#).

**2.2.3.3** Indicators shall be provided on the navigating bridge which shall indicate when any fire door of special category spaces is closed.

**2.2.3.4** Special category spaces shall have means of escape leading to the lifeboat and liferaft embarkation places complying with the requirements of 8.5.1, 8.5.2.3, Part III "Equipment, Arrangements and Outfit" as well as the requirements of [2.1.4.7](#) and [2.2.2.4.1](#) of this Part.

One of escape routes from machinery spaces where the crew is normally engaged shall not have a direct access to the special category spaces.

**2.2.4 Doors, windows and side scuttles.**

**2.2.4.1** Except hatches between the cargo spaces, special category spaces, storerooms and baggage rooms, as well as between such spaces and open decks, all openings shall be provided with permanent closing appliances, having at least such fire integrity as the divisions, in which they are fitted.

Construction of doors and doorframes in the bulkheads of "A" class with locking devices shall provide the same fire integrity and smoke and flame tightness as the bulkheads, in which those doors are fitted as determined in compliance with the FTP Code. Doors approved without the sill being part of the frame shall be installed such that the gap under the door does not exceed 12 mm. A non-combustible sill shall be installed under the door such that floor coverings do not extend beneath the closed door. Each door fitted in "A" class division shall be capable of being opened and closed manually from both sides of the bulkhead by one person only.

Fire doors in main vertical bulkheads, galley boundaries and stairway enclosures other than power-operated watertight doors and those which are normally locked, shall satisfy the following requirements:

**.1** the doors shall be self-closing and be capable of closing with an angle of inclination of up to 3,58 opposing closure;

**.2** the approximate time of closure for hinged fire doors shall be no more than 40 s and no less than 10 s from the beginning of their movement with the ship in the upright position. The approximate uniform rate of closure for sliding fire doors shall be no more than 0,2 m/s and no less than 0,1 m/s from the beginning of their movement with the ship in the upright position;

**.3** the doors shall be capable of remote release from the continuously manned central control station, either simultaneously or in groups and shall be capable of release also individually from a position at both sides of the door. Release switches shall have an on-off function to prevent automatic resetting of the system;

**.4** hold-back hooks not subject to central control station release are prohibited;

**.5** a door closed remotely from the central control station shall be capable of being re-opened at both sides of the door by local control. After such local opening, the door shall automatically close again;

**.6** indication shall be provided at the fire door indicator panel in the continuously manned central control station whether each of the remote-released doors is closed;

**.7** the release mechanism shall be so designed that the door will automatically close in case of disruption of the control system or main source of power;

**.8** local power accumulators for power-operated doors shall be provided in the immediate vicinity of the doors to enable the doors to be operated after disruption of the control system or main source of electrical power at least ten times (fully opened and closed) using the local controls;

**.9** disruption of the control system or main source of electrical power of one door shall not impair the safe functioning of other doors;

**.10** remote-released sliding or power-operated doors shall be equipped with an alarm that sounds for at least 5 s but no more than 10 s after the door is released from the central control station and before the door begins to move and continues sounding until the door is completely closed;

**.11** a door designed to re-open upon contacting an object in its path shall re-open not more than 1 m far from the point of contact;

**.12** double-leaf doors equipped with a latch necessary to their fire integrity shall have a latch that is automatically activated by the operation of the doors when released by the control system;

**.13** doors giving direct access to special category spaces which are power-operated and automatically closed need not be equipped with the alarms and remote-release mechanisms required in [2.2.4.1.3](#) and [2.2.4.1.10](#);

**.14** the components of the local control system shall be accessible for maintenance and adjusting; and

**.15** power-operated doors shall be provided with a control system of an approved type which shall be able to operate in case of fire, this being determined in accordance with the FTP Code. This system shall satisfy the following requirements:

the control system shall be able to operate the door at the temperature of at least 200 °C for at least 60 min, served by the power supply;

the power supply for all other doors not subject to fire shall not be impaired;

at temperatures exceeding 200 °C the control system shall be automatically isolated from the power supply and shall be capable of keeping the door closed up to at least 945 °C.

**2.2.4.2** Except watertight doors, weathertight doors (semi watertight doors), doors leading to the open decks, and doors required to be adequately gastight, all "A" class doors located in stairways, public spaces and main vertical zone bulkheads in escape routes shall be equipped with a self-closing hose port of material, construction and fire integrity which is equivalent to the door into which it is fitted, and shall be 150 × 150 mm square opening with the door closed and shall be inset into the lower edge of the door, opposite the door hinges, or in the case of sliding doors, nearest the opening.

**2.2.4.3** Doors and doorframes in "B" class divisions and their locking devices shall ensure the same fire integrity as the divisions where they are installed in accordance with the FTP Code, except that ventilation openings may be permitted in the lower portion of such doors. If such ventilation openings are located in the door or under it, their total net area shall not exceed 0,05 m<sup>2</sup>. Alternatively, pressure-balancing ventilation duct made of non-combustible material is allowed to be arranged between the cabin and the corridor, and located below sanitary room if an area of its cross section does not exceed 0,05 m<sup>2</sup>. All such openings shall be fitted with grills made of non-combustible material. Doors shall be non-combustible. Doors approved without the sill being part of the frame shall be installed such that the gap under the door does not exceed 25 mm. Cabin doors in "B" class divisions shall be of the self-closing type and shall have no hold-backs.

**2.2.4.4** For ships carrying not more than 36 passengers, windows facing survival craft and escape slide, embarkation areas and windows situated below such areas shall have fire integrity at least equal to "A-0" class.

For ships carrying more than 36 passengers, windows facing survival craft and life-saving appliances, embarkation and assembly stations, external stairs and open decks used for escape routes, and windows situated below life raft and escape slide embarkation areas shall have fire integrity as required in [Table 2.2.1.3-1](#). Where automatic dedicated sprinkler heads are provided for windows, "A-0" windows may be accepted as equivalent. In which case:

**.1** dedicated sprinkler heads shall be located above windows in addition to the conventional ceiling sprinklers; or

**.2** these shall be conventional ceiling sprinkler heads arranged in such a manner that a window is protected by an average application rate of at least 5 l/min per 1 m<sup>2</sup>, and the square of a window shall be included into calculation of the area of coverage; or

**.3** these may be water-mist nozzles complying with the requirements of IMO resolution A.800(19).



Windows located in the ship's side below the lifeboat embarkation areas shall have the fire integrity at least equal to "A-0" class.

All windows and side scuttles in bulkheads within accommodation and service spaces, and control stations, except those subject to provisions of [2.2.4.5](#) and [2.2.4.8](#), shall be fitted so as to ensure that fire integrity of the bulkheads they are fitted in is not impaired, which is determined in accordance with the FTP Code. Despite the requirements of Tables [2.2.1.3-1](#), [2.2.1.3-2](#), [2.2.1.5-1](#) and [2.2.1.5-2](#), windows and side scuttles in the outer bulkheads of accommodation spaces, service spaces and control stations shall have frames made of steel or other equivalent material and meet the requirements of 7.2.2.4, Part III "Equipment, Arrangements and Outfit".

**2.2.4.5** The requirements for "A" class fire integrity of ship external boundaries do not apply to glassed bulkheads, windows and side scuttles, provided that [2.2.4.4](#) does not contain the requirement that such boundaries shall be of "A" class. The requirements for "A" class fire integrity of the outer boundaries of a ship shall not apply to exterior doors, except for those in superstructures and deckhouses facing life-saving appliances, embarkation and external muster station areas, external stairs and open decks used for escape routes. Stairway enclosure doors need not meet this requirement.

**2.2.4.6** In passenger ships carrying not more than 36 passengers, it is allowed to use combustible materials for manufacture of doors separating cabins from internal individual sanitary spaces such as showers.

**2.2.4.7** Doors to machinery spaces of category A, other than power-operated watertight doors shall be arranged to ensure their positive closing by power operated closings arrangements or by fitting self-closing doors capable of being closed with an angle of inclination of up to 3,58 opposite to the door closure and equipped with locking device and remotely controlled release mechanism. Doors for the emergency escape trunks may not to be equipped with locking devices and remotely controlled release mechanisms.

Doors closure controls, required by [2.1.4.2.3](#), shall be located in one place or centralized at possibly less number of places. These places shall have free access from the open deck.

**2.2.4.8** The requirements for "B" class fire integrity of ship external boundaries do not apply to glassed bulkheads, windows and side scuttles. Such requirements for "B" class fire integrity do not apply to exterior doors in superstructures and deckhouses.

## **2.2.5 External areas on passenger ships.**

**2.2.5.1** Fire risk of external areas on passenger ships is evaluated in accordance with the provisions of IMO circular MSC.1/Circ.1274.

## **2.2.6 Casualty threshold, safe return to port and safe areas.**

**2.2.6.1** Passenger ships having length, as defined in 1.2.1 of Load Line Rules for Sea-Going Ships, of 120 m or more or having three or more main vertical zones, shall comply with the requirements of [2.2.6](#) in order to meet functional requirements and performance standards for safe areas in case of casualty that does not exceed the casualty threshold.

**2.2.6.2** When fire damage does not exceed the casualty threshold, the ship shall be capable of returning to port while providing a safe area as defined in [1.2](#). To be deemed capable of returning to port the fixed fire extinguishing systems, including the fire main system, and the fire detection and fire alarm system shall remain operational in the remaining part of the ship not affected by fire.

**2.2.6.3** The fire main system shall remain operational in all main vertical zones not directly affected by the casualty. Water feed for fire-fighting purposes shall be available to all areas of the ship.

**2.2.6.4** The automatic sprinkler system or any other fixed fire extinguishing system designed to protect an entire space shall be operational in all spaces not directly affected by the casualty.

**2.2.6.5** The fire detection and fire alarm system, including smoke detection system, shall be operational in all spaces not directly affected by the casualty.

**2.2.6.6** Means of access to life-saving appliances shall be provided from each safe area, taking into account that a main vertical zone may not be available for internal transit.

**2.2.6.7** In addition to the requirements of [2.2.6.2](#), the following systems, machinery and equipment shall remain operational in the remaining part of the ship not affected by fire:

- .1 propulsion and essential auxiliary machinery;
- .2 steering systems and steering-control systems;
- .3 power-operated watertight doors;
- .4 fuel oil systems for propulsion and essential auxiliary machinery;
- .5 ballast and bilge systems;
- .6 internal communication between the bridge, engineering spaces, safety centre, fire-fighting and damage control teams, and as required for passenger and crew notification and mustering; internal communication shall be provided by effective fixed or portable means;
- .7 flooding detection systems;
- .8 navigation lights in accordance with the requirements of International Regulations for Preventing Collisions at Sea;
- .9 GMDSS radio equipment (radio communication by GMDSS radio equipment shall be provided or, if the main GMDSS radio equipment is out of service due to casualty, the distress alert initiating shall be provided on the VHF frequencies including two-way VHF radiotelephone apparatus for communications with aircrafts);
- .10 navigational equipment essential for navigation, indicating the ship location and collision risk assessment.

**2.2.6.8** The systems, machinery and equipment specified in [2.2.6.2](#) and [2.2.6.7](#) shall remain operational in case of flooding of any watertight compartment.

**2.2.6.9** If systems are needed to fight with fire and flooding which are not specified in [2.2.6.2](#) and [2.2.6.7](#) they shall comply with the requirement of [2.2.6.7](#).

**2.2.6.10** Ventilation of safe area(s) shall comply with the requirements of [2.2.6.7](#) and [2.2.6.8](#).

Ventilation design shall reduce the risk that smoke and hot gases could affect the use of the safe area(s).

**2.2.6.11** Power supply of electrical equipment specified in [2.2.6.7](#) and [2.2.6.13](#) shall be provided to ensure their simultaneous operation.

**2.2.6.12** The safe area(s) shall generally be internal space(s); however, the use of an external space as a safe area may be allowed taking into account any restriction due to the area of operation and relevant expected environmental conditions.

**2.2.6.13** The safe area(s) shall provide all occupants with the following basic services to ensure that the health of passengers and crew is maintained:

- .1 sanitation;
- .2 fresh water;
- .3 food;
- .4 alternate space for medical care;
- .5 shelter from the weather;
- .6 means of preventing heat stress and hypothermia;
- .7 light;
- .8 ventilation.

**2.2.7 Systems to remain operational after a fire casualty.**

**2.2.7.1** Passenger ships having length, as defined in 1.2.1 of Load Line Rules for Sea-Going Ships, of 120 m or more, or having three or more main vertical zones shall comply with the requirements of [2.2.7](#) to provide the systems operability if the casualty threshold is exceeded.

**2.2.7.2** In case any one main vertical zone is unserviceable due to fire, the fire main system shall be so arranged and segregated as to remain operational for at least 3 h based on the assumption of no damage outside the unserviceable main vertical zone. In particular, the fire main system shall remain operational in all main vertical zones not directly affected by the casualty. The fire main system is not required to remain operational within the unserviceable main vertical zones.

**2.2.7.3** Cabling and piping within a trunk constructed to an "A-60" class shall remain intact and serviceable while passing through the unserviceable main vertical zone. An equivalent degree of protection for cabling and piping may be approved by the Register.

**2.2.7.4** In addition to [2.2.7.2](#) the following systems, machinery and equipment shall be so arranged and segregated as to remain operational for at least 3 h based on the assumption of no damage outside the unserviceable main vertical zone:

- .1 bilge systems for removal of fire-fighting water;
- .2 lighting along escape routes, at assembly stations and at embarkation stations of life-saving appliances;
- .3 low location lighting of escape routes with electrical power supply;
- .4 internal communications (in support of fire-fighting as required for passenger and crew notification and evacuation); internal communication shall be provided by effective fixed or portable means;
- .5 GMDSS radio equipment (radio communication by GMDSS radio equipment shall be provided or, if the main GMDSS radio equipment is out of service due to casualty, the distress alert initiating shall be provided on the VHF frequencies including two-way VHF radiotelephone apparatus for communications with aircrafts).

**2.2.7.5** The systems, machinery and equipment specified in [2.2.7.4](#) are not required to remain operational within the unserviceable main vertical zones.

**2.2.7.6** Power supply of electrical equipment for evacuation from ship including life-saving appliances, as well as of systems, machinery and equipment specified in [2.2.7.4](#) shall be provided to ensure their simultaneous operation.

**2.2.8 Safety centre on passenger ships (refer also to IMO circular MSC.1/Circ.1368).**

**2.2.8.1** Passenger ships shall have on board a safety centre, as defined in [1.2](#), complying with the requirements of [2.2.8](#).

**2.2.8.2** The safety centre shall either be a part of the navigation bridge or be located in a separate room adjacent to and having direct access to the navigation bridge.

**2.2.8.3** Means of communication between the safety centre, the storage room(s) for fire extinguishing system(s) and fire equipment lockers shall be provided.

**2.2.8.4** According to MSC.1/Circ.1368 the functionality, i.e. activation, control, monitoring or combination thereof, of the following safety systems shall be available from the safety centre: fire detection and fire alarm system, sprinkler and equivalent systems, water-based systems for machinery spaces, fixed local application fire extinguishing systems as well as fire pumps and emergency fire pumps.

**2.2.8.5** In addition to [2.2.8.3](#) means of communication between the safety centre, the central control station, the navigation bridge, the engine control room shall be provided.

**2.2.8.6** According to IMO circular MSC.1/Circ.1368 in addition to [2.2.8.4](#) the functionality, i.e. activation, control, monitoring or combination thereof, of the safety systems listed below shall be available from the safety centre:

- .1 all powered ventilation systems;
- .2 atrium smoke extraction system;
- .3 indication of closing watertight and fire doors;
- .4 general emergency alarm system;
- .5 public address system;
- .6 low location lighting of escape routes with electrical power supply;



- .7 indicators for shell doors, loading doors and other closing appliances;
- .8 flooding detection system;
- .9 television surveillance systems;
- .10 alarm for crew mustering.

## **2.3 CARGO SHIPS**

**2.3.1** The requirements of this Chapter are additional to those set out in [2.1](#) and apply to cargo ships of 500 gross tonnage and upwards.

**2.3.2** In way of accommodation and service spaces and control stations one of the following methods of protection shall be adopted:

method IC: construction of internal subdivision bulkheads of non-combustible "B" or "C" class divisions, generally without installation in the accommodation and service spaces of the automatic sprinkler fire extinguishing system and fire detection and fire alarm system;

method IIC: the fitting of an automatic sprinkler system and fire detection and fire alarm system in all spaces in which fire might be expected to originate, generally with no restriction on the type of internal bulkheads; or

method IIIC: the fitting of a fixed fire detection and fire alarm system of approved type complying with requirements of [4.1](#) and [4.2](#) in spaces where fire might develop, generally with no restriction on the class of internal subdivision bulkheads, except that in no case shall the area of any accommodation space bounded by "A" or "B" class division exceeds 50 m<sup>2</sup>. Consideration may be given by the Register to increasing this area for public spaces.

The requirements on using non-combustible materials for the construction and insulation of bulkheads bounding machinery spaces, control stations, service spaces, etc. as well as protection of above mentioned trunks and stairways enclosures are common for all three methods described above.

**2.3.3** The minimum fire integrity of the bulkheads and decks separating adjacent spaces shall be as prescribed in Tables [2.3.3-1](#) and [2.3.3-2](#).

For determining the appropriate fire integrity standards to be applied to divisions between adjacent spaces, the spaces are classified according to their fire risk as follows:

(1) control stations: spaces accommodating emergency sources of electrical power and lighting; wheelhouse and navigation room; spaces accommodating ship radio equipment; fire stations; main machinery control room if it is located outside machinery space; spaces accommodating centralized fire alarm system;

(2) corridors and lobbies;

(3) accommodation spaces in accordance with [1.5.2](#), except corridors;

(4) stairways:

interior stairways, lifts, totally enclosed emergency escape trunks and escalators (other than those wholly contained within the machinery spaces) and enclosures thereto.

A stairway which is enclosed only at one level shall be regarded as part of the space from which it is not separated by a fire door;

(5) service spaces (low risk):

storerooms not having provisions for the storage of flammable liquids and having areas less than 4 m<sup>2</sup>, drying rooms, laundries and refrigerated provision storerooms insulated with non-combustible materials; spaces accommodating electrical distribution boards having an area of less than 4 m<sup>2</sup>;

(6) machinery spaces of category A:

spaces as defined in 1.2, Part VII "Machinery Installations";

incinerator and combined incinerator/waste stowage spaces, and the flue uptakes from such spaces ([refer to 2.1.5.9](#)).

Table 2.3.3-1

**Fire integrity of bulkheads separating adjacent spaces**

Spaces		(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)
Control stations	(1)	A-0 <sup>1</sup>	A-0	A-60	A-0	A-15	A-60	A-15	A-60	A-60	*	A-60
Corridors and lobbies	(2)		C	B-0	A-0 <sup>2</sup> B-0	B-0	A-60	A-0	A-0	A-0	*	A-30
Accommodation spaces	(3)			C <sup>3,4</sup>	A-0 <sup>2</sup> B-0	B-0	A-60	A-0	A-0	A-0	*	A-30
Stairways	(4)				A-0 <sup>2</sup> B-0	A-0 <sup>2</sup> B-0	A-60	A-0	A-0	A-0	*	A-30
Service spaces (low risk)	(5)					C	A-60	A-0	A-0	A-0	*	A-0
Machinery spaces of category A	(6)						*	A-0	A-0 <sup>5</sup>	A-60	*	A-60 <sup>6</sup>
Other machinery spaces	(7)							A-0 <sup>7</sup>	A-0	A-0	*	A-0
Cargo spaces	(8)								*	A-0	*	A-0
Service spaces (high risk)	(9)									A-0 <sup>7</sup>	*	A-30
Open decks	(10)										—	A-0
Ro-ro cargo spaces and spaces for motor vehicles	(11)											A-30

<sup>1</sup> Bulkheads separating the wheelhouse, chartroom and radio room from each other may be "B-0" class.

<sup>2</sup> For clarification as to which applies, refer to [2.1.4.3](#) and [2.3.5](#).

<sup>3</sup> No special requirements are imposed upon bulkheads in methods IIC and IIIC fire protection.

<sup>4</sup> In case of method IIIC bulkheads of "B-0" class shall be provided between spaces or groups of spaces of 50 m<sup>2</sup> and over in area.

<sup>5</sup> For cargo spaces intended for carriage of dangerous goods [refer to 7.2.12](#).

<sup>6</sup> "A-0" class may be used if no dangerous goods are intended to be carried.

<sup>7</sup> Where spaces are used for the same purpose, divisions between them need not be fitted.

**Notes :** 1. Where an asterisk appears in the tables the division shall be of steel or equivalent but is not required to be of "A" class. However, if in the deck except for the decks in a space of category (10), there are penetrations for electric cables, piping and ventilation ducts, such penetrations shall be flame and smoke tight. Divisions between control stations (emergency generators) and open decks may have air intake openings without closing appliances, except cases when fixed gas fire-fighting system is installed.

2. [Refer to Note 4](#) to Table 2.2.1.3-1.

Table 2.3.3-2

**Fire integrity of decks separating adjacent spaces**

Spaces below		Spaces above										
		(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)
Control stations	(1)	A-0	A-0	A-0	A-0	A-0	A-60	A-0	A-0	A-0	*	A-60
Corridors and lobbies	(2)	A-0	*	*	A-0	*	A-60	A-0	A-0	A-0	*	A-30
Accommodation spaces	(3)	A-60	A-0	*	A-0	*	A-60	A-0	A-0	A-0	*	A-30
Stairways	(4)	A-0	A-0	A-0	*	A-0	A-60	A-0	A-0	A-0	*	A-30
Service spaces (low risk)	(5)	A-15	A-0	A-0	A-0	*	A-60	A-0	A-0	A-0	*	A-0
Machinery spaces of category A	(6)	A-60	A-60	A-60	A-60	A-60	*	A-60 <sup>1</sup>	A-30	A-60	*	A-60
Other machinery spaces	(7)	A-15	A-0	A-0	A-0	A-0	A-0	*	A-0	A-0	*	A-0
Cargo spaces	(8)	A-60	A-0	A-0	A-0	A-0	A-0	A-0	*	A-0	*	A-0
Service spaces (high risk)	(9)	A-60	A-0	A-0	A-0	A-0	A-60	A-0	A-0	A-0 <sup>2</sup>	*	A-30
Open decks	(10)	*	*	*	*	*	*	*	*	*	—	A-0
Ro-ro cargo spaces and vehicle spaces	(11)	A-60	A-30	A-30	A-30	A-0	A-60	A-0	A-0	A-30	A-0	A-30

<sup>1</sup> Where other machinery spaces of category (7) are the spaces of low fire risk, i.e. they do not contain machinery operating on fuel oil or having a pressure lubrication systems, "A-0" class divisions are permitted.

<sup>2</sup> Refer to [Footnote 7](#) to Table 2.3.3-1.

Notes : 1. [Refer to Note 1](#) to Table 2.3.3-1.

2. [Refer to Note 4](#) to Table 2.2.1.3-1.

(7) other machinery spaces:

machinery spaces excluding those specified in (6) and spaces accommodating electrical equipment (automatic telephone stations, spaces for air conditioning ducts);

spaces separated from engine room where urea or sodium hydroxide solution tanks for selective catalytic reduction (SCR) systems, exhaust gas recirculation (EGR) systems or exhaust gas cleaning systems (EGCS) are installed.

(8) cargo spaces:

all spaces used for carriage of cargoes (including cargo tanks for oily products) as well as trunkways and hatchways to such spaces;

(9) service spaces (greater fire risk):

galleys and pantries containing appliances for hot food preparation, saunas, paint lockers and storerooms with an area of 4 m<sup>2</sup> and over, spaces for storage of flammable liquids, workshops and similar spaces, which are not part of machinery spaces; refrigerated provision storerooms insulated with combustible materials;

waste stowage spaces and garbage chutes connected thereto;

(10) open decks:

open deck spaces and enclosed promenades having no fire risk. This means that their furnishings shall be restricted to deck furniture. In addition, such spaces shall be naturally ventilated by permanent openings:

air spaces (spaces outside superstructures and deckhouses);

(11) ro-ro cargo spaces and motor vehicles spaces as defined in [1.5.4.3](#) and [1.5.4.4](#).

**2.3.4** Linings, ceilings, draught stops and their associated grounds shall be made of non-combustible materials:

in accommodation and service spaces, and in control stations, if protection method IC is used;

in corridors and stairway enclosures serving accommodation and service spaces, and control stations, if protection methods IIC and IIIC are used.

**2.3.5** Within accommodation spaces, bulkheads not required to be "A" or "B" class divisions shall be:

.1 at least "C" class division in method IC fire protection;

.2 not subject to any restrictions, except in cases where "C" class bulkheads are required in accordance with [Table 2.3.3-1](#) in method IIC fire protection;

.3 not subject to any restrictions except that in no case shall the area of any accommodation space or spaces bounded by "A" or "B" class divisions exceed 50 m<sup>2</sup> (except in cases where "C" class bulkheads are required in accordance with [Table 2.3.3-1](#)), in method IIIC fire protection.

Consideration may be given by the Register to increasing this area for public spaces.

If the method IC of protection has been used while ship construction, application of combustible materials may be allowed for doors separating cabins from internal sanitary spaces such as showers.

**2.3.6** The doors installed in the bulkheads bounding machinery spaces of category A shall be self-closing and adequately gastight. "A" class doors approved without the sill being part of the frame shall be installed such that the gap under the door does not exceed 12 mm, and a non-combustible sill shall be installed under the door such that floor coverings do not extend beneath the closed door. "B" class doors approved without the sill being part of the frame shall be installed such that the gap under the door does not exceed 25 mm.

**2.3.7** The doors required to be self-closing shall not be equipped with locking devices. However, locking devices may be used equipped with remotely controlled release mechanisms.

**2.3.8** In the corridor bulkheads ventilation openings may be permitted in and under the doors of cabins and public spaces. Ventilation openings are also permitted in "B" class doors leading to sanitary rooms, studies, pantries, lockers and storerooms. Except for the permitted below, openings shall be provided in the lower portion of such doors only. If such ventilation opening is located in or under the door, the total net area of such opening shall not exceed  $0,05 \text{ m}^2$ . Alternatively, balancing duct made of non-combustible material and located below sanitary room is allowed to be arranged between the cabin and the corridor if an area of its cross section does not exceed  $0,05 \text{ m}^2$ . Ventilation openings except the ones located under the door shall be fitted with grills made of non-combustible material.

**2.3.9** All bulkheads required to be "B" class divisions within accommodation spaces, shall extend from deck to deck and to the hull shell or other boundaries. However, if the continuous "B" class ceilings or linings are fitted on both sides of the bulkhead the bulkhead may terminate at the continuous ceiling or lining.

**2.3.10** For the purpose of application of the requirements of [2.1.1.7](#), [2.1.1.8](#) and [2.1.1.10](#) it is necessary to follow [Fig. 2.3.10](#) and Tables [2.3.10-1](#) and [2.3.10-2](#). [Table 2.3.10-1](#) is used for the method IC, [Table 2.3.10-2](#) is used for the methods IIC and IIIC.

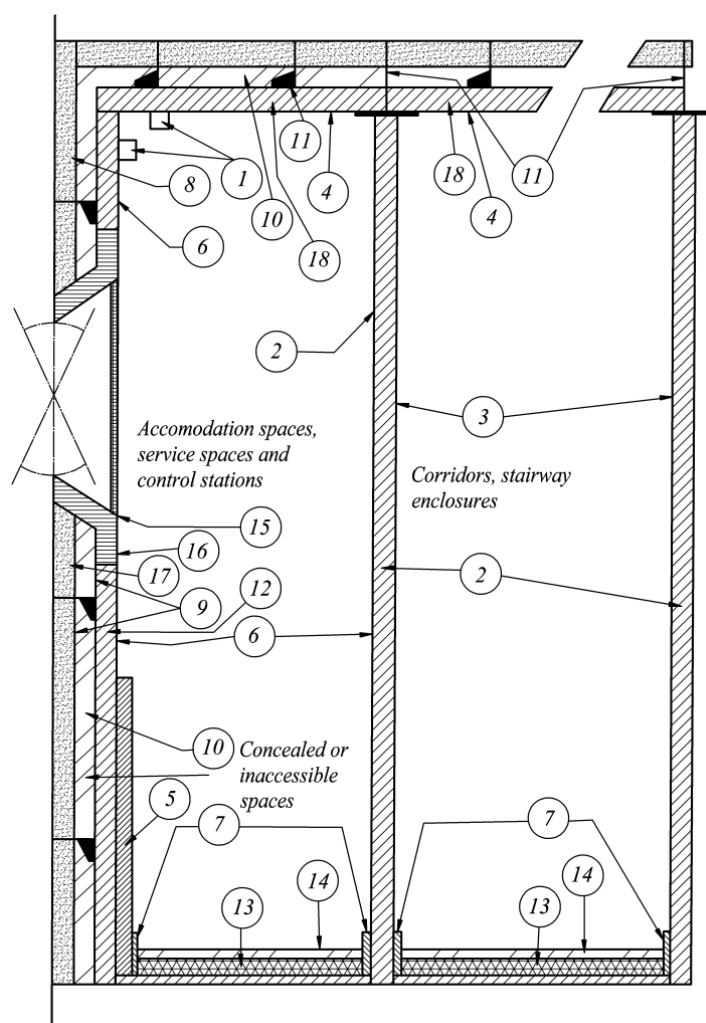


Fig. 2.3.10  
Structural members

Table 2.3.10-1

Method IC

Nos.	Requirements for materials. Structural member	Non-combustibility (refer to <a href="#">2.3.4</a> )	Non-combustibility (refer to <a href="#">2.1.1.5</a> )	Low flame-spread (refer to <a href="#">2.1.1.8.2</a> )	Total volume of combustible materials (refer to <a href="#">2.1.1.10.1</a> )	Calorific value (refer to <a href="#">2.1.1.10</a> )	Smoke and toxic vapors generation (refer to <a href="#">2.1.1.6</a> and <a href="#">2.1.1.7</a> )	Hardened combustibility (refer to <a href="#">2.1.1.6</a> )
1	Moldings				×			
2	Panels	×						
3	Painted surfaces, linings, textiles, films			×	×	×	× <sup>1</sup>	
4	Painted surfaces, linings, textiles, films			×	×	×	× <sup>1</sup>	
5	Decorations				×		×	
6	Painted surfaces, linings, textiles, films				×	×	× <sup>1</sup>	
7	Plinth				×			
8	Insulation		× <sup>2</sup>					
9	Surfaces and paints in concealed and inaccessible places			×				
10	Draught prevention seals	×						
11	Furring	×		×				
12	Linings	×						
13	Primary deck covering						× <sup>4</sup>	×
14	Floor covering			× <sup>3</sup>			×	

Nos.	Requirements for materials. Structural member	Non-combustibility (refer to <a href="#">2.3.4</a> )	Non-combustibility (refer to <a href="#">2.1.1.5</a> )	Low flame-spread (refer to <a href="#">2.1.1.8.2</a> )	Total volume of combustible materials (refer to <a href="#">2.1.1.10.1</a> )	Calorific value (refer to <a href="#">2.1.1.10</a> )	Smoke and toxic vapors generation (refer to <a href="#">2.1.1.6</a> and <a href="#">2.1.1.7</a> )	Hardened combustibility (refer to <a href="#">2.1.1.6</a> )
15	Scuttle frame	x						
16	Scuttle frame surface			x	x	x	x	
17	Scuttle frame surface in concealed and inaccessible places			x				
18	Ceiling panel	x						

<sup>1</sup> Applied to paints, varnishes and other coatings.  
<sup>2</sup> Vapour barriers used for coating of the cooling systems piping (refer to [2.1.1.5](#)) may be combustible, provided they are low -flame spread.  
<sup>3</sup> In corridors and stair ways enclosures only.  
<sup>4</sup> Only in accommodation and service spaces and control stations.



Table 2.3.10-2

Methods IIC and IIIC

Nos.	Requirements for materials. Structural member	Non-combustibility (refer to <a href="#">2.3.4</a> )	Non-combustibility (refer to <a href="#">2.1.1.5</a> )	Low flame-spread (refer to <a href="#">2.1.1.8.2</a> )	Total volume of combustible materials (refer to <a href="#">2.1.1.10.1</a> )	Calorific value (refer to <a href="#">2.1.1.10</a> )	Smoke and toxic vapors generation (refer to <a href="#">2.1.1.6</a> and <a href="#">2.1.1.7</a> )	Hardened combustibility (refer to <a href="#">2.1.1.6</a> )
1	Moldings				×3			
2	Panels	×1						
3	Painted surfaces, linings, textiles, films			×	×	×	×4	
4	Painted surfaces, linings, textiles, films			×	×2	×3	×4	
5	Decorations				×2		×	
6	Painted surfaces, linings, textiles, films				×2	×3	×4	
7	Plinth				×2			
8	Insulation		×5					
9	Surfaces and paints in concealed and inaccessible places			×				
10	Draught prevention seals	×1						
11	Furring	×1		×				
12	Linings	×1						
13	Primary deck covering						×7	×
14	Floor covering			×6			×	
15	Scuttle frame	×1						
16	Scuttle frame surface			×2	×2	×3	×	

Nos.	Requirements for materials. Structural member	Non-combustibility (refer to <a href="#">2.3.4</a> )	Non-combustibility (refer to <a href="#">2.1.1.5</a> )	Low flame-spread (refer to <a href="#">2.1.1.8.2</a> )	Total volume of combustible materials (refer to <a href="#">2.1.1.10.1</a> )	Calorific value (refer to <a href="#">2.1.1.10</a> )	Smoke and toxic vapors generation (refer to <a href="#">2.1.1.6</a> and <a href="#">2.1.1.7</a> )	Hardened combustibility (refer to <a href="#">2.1.1.6</a> )
17	Scuttle frame surface in concealed and inaccessible places			×				
18	Ceiling panel	× <sup>1</sup>						

<sup>1</sup> Only in corridors and stairw ays enclosures servicing accommodation and service spaces and control stations.  
<sup>2</sup> Applied to such accommodation and service spaces, w hich are bounded by non-combustible bulkheads, ceilings and linings.  
<sup>3</sup> When combustible materials are fitted on non-combustible bulkheads, ceilings and linings in accommodation and service spaces.  
<sup>4</sup> Applied to paints, varnishes and other coatings.  
<sup>5</sup> Vapour barriers used for coating of the cooling systems piping (refer to [2.1.1.5](#)) may be combustible, provided they are low -flame spread.  
<sup>6</sup> In corridors and stairw ays enclosures only.  
<sup>7</sup> Only in accommodation and service spaces and control stations.

## 2.4 OIL TANKERS

**2.4.1** The requirements of this Chapter are additional to those set out in [2.1](#) and [2.3](#) (except for [2.3.3](#)) when only method IC fire protection is adopted and apply to oil tankers and combination carriers of 500 gross tonnage and upwards.

**2.4.2** The minimum fire integrity of bulkheads and decks separating adjacent spaces shall be as prescribed in Tables [2.4.2-1](#) and [2.4.2-2](#) with regard to the following.

For determining the appropriate fire integrity standards to be applied to divisions between adjacent spaces, the spaces are classified according to their fire risk as follows:

(1) control stations: spaces accommodating emergency sources of electrical power and lighting; wheelhouse and navigation room; spaces accommodating ship radio equipment; fire stations; main machinery control room if it is located outside machinery space; spaces accommodating centralized fire alarm system;

(2) corridors and lobbies;

(3) accommodation spaces as defined in [1.5.2](#), except corridors;

(4) stairways:

interior stairways, lifts, totally enclosed emergency escape trunks and escalators (other than those wholly contained within the machinery spaces) and enclosures thereto.

A stairway which is enclosed only at one level shall be regarded as part of the space from which it is separated by a fire door;

(5) service spaces (low risk):

storerooms having areas less than 4 m<sup>2</sup> and not having provisions for the storage of flammable liquids, drying rooms, laundries and refrigerated provision storerooms insulated with non-combustible materials; spaces accommodating electrical distribution boards having an area of less than 4 m<sup>2</sup>;

(6) machinery spaces of category A:

spaces as defined in 1.2, Part VII "Machinery Installations";

incinerator and combined incinerator/ waste stowage spaces, and the flue uptakes from such spaces ([refer to 2.1.5.9](#));

(7) other machinery spaces:

machinery spaces excluding spaces referred to in (6) and spaces accommodating electrical equipment (automatic telephone stations, spaces for air conditioning ducts);

spaces separated from engine room where urea or sodium hydroxide solution tanks for selective catalytic reduction (SCR) systems, exhaust gas recirculation (EGR) systems or exhaust gas cleaning systems (EGCS) are installed;

(8) cargo pump rooms as defined in [1.5.7.1](#);

(9) service spaces (greater fire risk): galleys and pantries containing appliances for hot food preparation, saunas, paint lockers and storerooms with an area of 4 m<sup>2</sup> and over, spaces for storage of flammable liquids, workshops and similar spaces, which are not part of machinery spaces; refrigerated provision storerooms insulated with combustible materials; waste stowage spaces and garbage chutes connected thereto;

(10) open decks:

open deck spaces and enclosed promenades having no fire risk. This means that their furnishings shall be restricted to deck furniture. In addition, such spaces shall be naturally ventilated by permanent openings.

air spaces (spaces outside superstructures and deckhouses).

Table 2.4.2-1

**Fire integrity of bulkheads separating adjacent spaces**

Spaces		(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
Control stations	(1)	A-0 <sup>1</sup>	A-0	A-60	A-0	A-15	A-60	A-15	A-60	A-60	*
Corridors and lobbies	(2)		C	B-0	A-0 B-0 <sup>2</sup>	B-0	A-60	A-0	A-60	A-0	*
Accommodation spaces	(3)			C	A-0 B-0 <sup>2</sup>	B-0	A-60	A-0	A-60	A-0	*
Stairways and lifts	(4)				A-0 B-0 <sup>2</sup>	A-0 B-0 <sup>2</sup>	A-60	A-0	A-60	A-0	*
Service spaces (low risk)	(5)					C	A-60	A-0	A-60	A-0	*
Machinery spaces of category A	(6)						*	A-0	A-0 <sup>3</sup>	A-60	*
Other machinery spaces	(7)							A-0 <sup>4</sup>	A-0	A-0	*
Cargo pump rooms	(8)								*	A-60	*
Service spaces (high risk)	(9)									A-0 <sup>4</sup>	*
Open decks	(10)										—

<sup>1</sup> Bulkheads separating the wheelhouse, chartroom and radio room from each other may be "B-0" class.

<sup>2</sup> For clarification as to which applies, refer to [2.1.4.3](#) and [2.3.5.1](#).

<sup>3</sup> Bulkheads and decks between cargo pump-rooms and machinery spaces of category A may be penetrated by cargo pump shaft glands and similar gland penetrations, provided that gastight seals with efficient lubrication or other means of ensuring the permanence of the gas seal are fitted in way of the bulkheads or deck.

<sup>4</sup> Where spaces are used for the same purpose, divisions between them need not be fitted.

**Notes :** 1. Where an asterisk appears in the tables the division shall be of steel or other equivalent material but is not required to be of "A" class. However, if in the deck except for the decks in a space of category (10), there are penetrations for electric cables, piping and ventilation ducts, such penetrations shall be flame and smoke tight. Divisions between control stations (emergency generators) and open decks may have air intake openings without closing appliances, except cases when fixed gas fire-fighting system is installed.

2. [Refer to Note 4](#) to Table 2.2.1.3-1.

Table 2.4.2-2

**Fire integrity of decks separating adjacent spaces**

Spaces below		Spaces above									
		(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
Control stations	(1)	A-0	A-0	A-0	A-0	A-0	A-60	A-0	—	A-0	*
Corridors and lobbies	(2)	A-0	*	*	A-0	*	A-60	A-0	—	A-0	*
Accommodation spaces	(3)	A-60	A-0	*	A-0	*	A-60	A-0	—	A-0	*
Stairways and lifts	(4)	A-0	A-0	A-0	*	A-0	A-60	A-0	—	A-0	*
Service spaces (low risk)	(5)	A-15	A-0	A-0	A-0	*	A-60	A-0	—	A-0	*
Machinery spaces of category A	(6)	A-60	A-60	A-60	A-60	A-60	*	A-60 <sup>1</sup>	A-0	A-60	*
Other machinery spaces	(7)	A-15	A-0	A-0	A-0	A-0	A-0	*	A-0	A-0	*
Cargo pump rooms	(8)	—	—	—	—	—	A-0 <sup>2</sup>	A-0	*	—	*
Service spaces (high risk)	(9)	A-60	A-0	A-0	A-0	A-0	A-60	A-0	—	A-0 <sup>3</sup>	*
Open decks	(10)	*	*	*	*	*	*	*	*	*	*

<sup>1</sup> Where other machinery spaces of category (7) are the spaces of low fire risk, i.e. they do not contain machinery operating on fuel oil or having a pressure lubrication systems, "A-0" class divisions are permitted.

<sup>2</sup> [Refer to Footnote 3](#) to Table 2.4.2-1.

<sup>3</sup> [Refer to Footnote 4](#) to Table 2.4.2-1.

Notes : 1. [Refer to Note 1](#) to Table 2.4.2-1.

2. [Refer to Note 4](#) to Table 2.2.1.3-1.

**2.4.3** Exterior boundaries of superstructures and deckhouses enclosing accommodation and including any overhanging decks which support such accommodation, shall be constructed of steel and be "A-60" class for the whole of the portions which face the cargo area and on the outward sides for a distance of 3 m from the end boundary facing the cargo area.

The distance of 3 m shall be measured horizontally and parallel to the centreline of the ship from the boundary facing the cargo area at the each deck level. The insulation above shall be provided up to the underside of navigation bridge deck.

Lower part of the navigation bridge facing the cargo area shall be "A-60" class.

**2.4.4** Arrangement of openings shall meet the requirements of [2.4.4.1 – 2.4.4.3](#).

**2.4.4.1** Except as permitted in [2.4.4.2](#), access doors, air inlets and openings to accommodation spaces, service spaces, control stations and machinery spaces shall not face the cargo area. They shall be located on the transverse bulkhead not facing the cargo area or on the outboard side of the superstructure or deckhouse at the distance of at least 4 % of the ship length but not less than 3 m from the end of the superstructure or deckhouse facing the cargo area. However, this distance need not exceed 5 m.

Access to forecastle spaces containing sources of ignition may be permitted through doors facing cargo area provided the doors are located outside hazardous areas (refer to 19.2, Part XI "Electrical Equipment").

**2.4.4.2** The Register may permit access doors in superstructures or deckhouses on transverse bulkheads facing the cargo area or on side bulkheads within 5 m limits specified in [2.4.4.1](#), to cargo control rooms and to such service spaces used as provision rooms, storerooms and lockers, provided they do not give access directly or indirectly to any other space containing or providing for accommodation, control stations or service spaces such as galleys, pantries or workshops or similar spaces containing sources of vapour ignition. Boundaries of such a space shall be of "A-60" class except for the boundary facing the cargo area. Bolted plates for the removal of machinery may be fitted within the limits specified in [2.4.4.1](#). Wheelhouse doors and windows may be located within the limits specified in [2.4.4.1](#) so long as they are designed to ensure that the wheelhouse can be made rapidly and efficiently gastight and vaportight.

**2.4.4.3** The Register may permit access to a deck foam system room where foam tanks and control station are located within the distances specified in [2.4.4.1](#) provided the requirements of [2.4.4.2](#) are fulfilled and the door is located flush with a bulkhead.

**2.4.5** Windows and side scuttles facing the cargo area and located on the sides of superstructures and deckhouses within the limits specified in [2.4.4.1](#) shall be of the fixed (non-opening) type. Such windows and side scuttles, except wheelhouse window, shall be of "A-60" class.

Except that "A-0" class standard is acceptable for windows and side scuttles outside the limit specified in [2.4.4.1](#).

**2.4.6** The Register may permit a navigation position to be fitted above the cargo area where this is for navigation purposes only, and it shall be separated from the cargo tank deck by means of an open space with a height of at least 2 m. The fire protection of such a navigation position shall be as required for control stations in [2.4.2](#) and other provisions, as applicable, of this Part.

**2.4.7** Machinery spaces shall be positioned aft of cargo tanks and slop tanks; they shall also be situated aft of pump rooms and cofferdams, but not necessarily aft of the fuel oil tanks. Any machinery space shall be isolated from cargo tanks and slop tanks by cofferdams, pump rooms, fuel oil tanks, or ballast tanks.

Pump rooms containing pumps and their accessories for ballasting those spaces situated adjacent to cargo tanks and slop tanks, and pumps for fuel oil transfer may be used for isolation of machinery spaces from cargo tanks and slop tanks provided that such pump rooms have the same safety standard as that required for cargo pump rooms. The lower portion of the

pump room bulkhead may be recessed into machinery spaces of category A to accommodate pumps. The deck head of the recess may be not more than one third of the moulded depth above the keel. In ships of not more than 25 000 t deadweight, for reasons of access and satisfactory piping arrangements and on agreement with the Register, the deck head of the recess may be at a level of up to one half of the moulded depth above the keel.

A cargo tank or a slop tank adjoining machinery spaces by a corner shall be isolated therefrom by a corner cofferdam.

The design and dimensions of cofferdams shall comply with the requirements of 2.7.5.2, Part II "Hull".

Corner cofferdams inaccessible for inspection shall be fitted with suitable media.

No cargoes or wastes shall be stowed in cofferdams.

Void space or ballast water tank protecting fuel oil tank as shown in [Fig. 2.4.7](#), need not be considered as a cargo area even though they have a cruciform contact with the cargo oil tank or slop tank. The void space protecting fuel oil tank is not considered as a cofferdam required above. Void spaces may be located as shown in [Fig. 2.4.7](#) even though they have a cruciform contact with the slop tank.

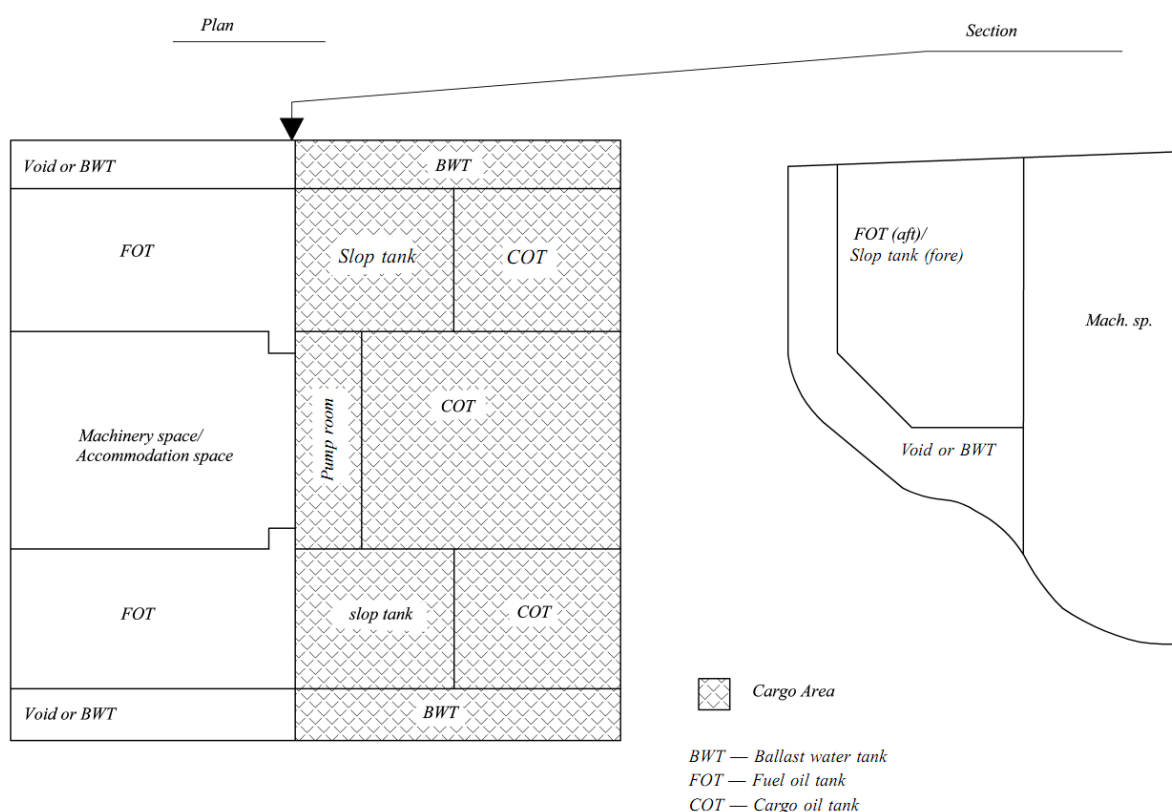


Fig. 2.4.7

#### 2.4.8 Pump rooms shall be closed in by gastight bulkheads.

Permanent approved gastight lighting enclosures may be installed in bulkheads and decks separating pump rooms from other spaces. These enclosures are intended for lighting of pump rooms provided that they are sufficiently durable and that fire integrity and gas-tightness of the bulkhead or deck is preserved.

**2.4.9** Control stations, cargo control stations, accommodation and service spaces (except for isolated cargo handling gear lockers) shall be positioned aft of all cargo tanks, slop tanks and spaces isolating cargo or slop tanks from machinery spaces, but not necessarily aft

of the fuel oil tanks and ballast tanks, and shall be arranged in such a way that a single failure to a deck or bulkhead shall not permit the entry of gas or fumes from the cargo tanks into any of the above spaces. The recess provided in accordance with [2.4.7](#) may be disregarded when determining the location of the said spaces.

Enclosed smoking rooms shall be provided within the accommodation area. These spaces shall be formed by "B-15" class divisions, and facings shall be made of materials having low flame spread characteristics.

**2.4.10** Where deemed necessary and on agreement with the Register, control stations, cargo control rooms, accommodation and service spaces may be positioned forward of the cargo tanks, slop tanks and spaces which isolate cargo tanks and slop tanks from machinery spaces but not necessarily forward of fuel oil tanks or ballast tanks. Machinery spaces other than category A may be permitted forward of the cargo tanks and slop tanks provided they are isolated from the cargo tanks and slop tanks by cofferdams, pump rooms, fuel oil tanks or ballast tanks.

All of the above-mentioned spaces shall be subject to an equivalent standard of safety and appropriate availability of fire extinguishing appliances. Control stations, cargo control rooms, accommodation and service spaces shall be arranged in such a way that a single failure of a deck or a bulkhead shall not permit the entry of gas or fumes from the cargo tanks into such spaces. In addition, where deemed necessary for the safety of navigation of the ship, machinery spaces containing internal combustion engines not being main propulsion machinery having output greater than 375 kW may be located forward of the cargo area.

Paint lockers, regardless of their use shall not be positioned above the tanks and spaces as determined in [2.4.9](#).

**2.4.11** No access holes to fuel oil tanks located in the double bottom below cargo tanks are permitted in cargo tanks and in the machinery space.

**2.4.12** Means shall be provided to keep deck spills away from the accommodation and service spaces. This may be accomplished by provision of a permanent continuous coaming of a height at least 300 mm from side to side. Similar measures and arrangements shall be provided for stern loading.

**2.4.13** Manholes, openings for cleaning cargo tanks and other openings shall not be arranged in completely enclosed or in semi-enclosed spaces.

**2.4.14** The following requirements shall be also met in combination carriers:

**.1** the slop tanks shall be surrounded by cofferdams, except where the boundaries of the slop tanks are the hull, main cargo deck, cargo pump room bulkhead or fuel oil bunker tank. These cofferdams shall not be open to a double bottom, pipe tunnel, pump room or other enclosed space, as well as they shall not be used for carriage of cargo or ballast and they need not be connected with cargo or ballast systems.

Means shall be provided for filling the cofferdams with water and draining them.

Where the boundary of the slop tank is the cargo pump room bulkhead, the pump room shall not be open to the double bottom, pipe tunnel or other enclosed space. However, openings provided with gastight bolted covers may be permitted;

**.2** hatches and tank cleaning openings to slop tanks shall be only permitted on the open deck; they shall be fitted with closing arrangements, except where they consist of bolted plates with bolts at watertight spacing. Closing arrangements shall be fitted with securing devices controlled by responsible person out of ship officers;

**.3** arrangement of openings for cargo handling operations in decks and bulkheads separating the spaces for the carriage of oil and oil products from the spaces not intended or fitted for their carriage is permitted only provided equivalent tightness for oil products and their vapours is ensured;

**.4** detailed instructions shall be exhibited on board, covering safety measures to be taken during loading or unloading of the ship and when dry cargoes are carried with oil product residues in the slop tanks.



**2.4.15** Where the electrochemical protection is fitted on the ship it shall comply with the following requirements:

**.1** where the electrochemical protection of structures or their elements is fitted, anodes can be made of zinc, magnesium or aluminium alloys;

**.2** impressed current systems are not permitted in oil cargo tanks. Magnesium or magnesium alloy anodes are not permitted in cargo tanks and tanks adjacent to cargo tanks;

**.3** aluminium alloy anodes are only permitted in cargo tanks and tanks adjacent to cargo tanks of ships carrying oil products in locations where the potential energy does not exceed 275 J. The height of the anode shall be measured from the bottom of the tank to the centre of the anode, and its weight shall be taken as the weight of the anode as fitted, including the fitting devices and inserts.

However, where aluminium alloy anodes are located on horizontal surfaces such as bulkhead girders and stringers not less than 1 m wide and fitted with an upstanding flange or face flat projecting not less than 75 mm above the horizontal surface, the height of the anode may be measured from the surface.

Aluminium alloy anodes shall not be located under tank hatches or openings (in order to avoid any metal parts falling on the fitted anodes), unless protected by adjacent structure;

**.4** the anodes shall have steel covers and these shall be sufficiently rigid to avoid resonance in the anode support and be designed so that they retain the anode even when it is wasted. Anodes shall be fitted with delimiters from sides and bottom made of the material which does not spark while contact with the anode. The steel inserts shall be attached to the structure by means of a continuous weld of adequate section, the weld elements shall be free of stress concentrations. Alternatively they may be attached to separate supports by bolting, provided a minimum of two bolts with locknuts are used.

However, other mechanical means of clamping approved by the Register may be accepted.

The supports at each end of an anode shall not be attached to separate items which are likely to move independently.

**2.4.16** The fenders shall be made of or securely faced with non-sparking materials, and shall not be bolted to the shell plating.

## **2.5 FISHING VESSELS**

**2.5.1** The requirements of this Chapter are additional to those set out in [2.1](#) and apply to fishing vessels of 500 gross tonnage and upwards and/or 45 m and more in length, the definition of which is given in 1.2.1, Part I "Classification" of the Rules for the Classification and Construction of Small Sea Fishing Vessels.

**2.5.2** In way of accommodation and service spaces and control stations one of three methods of protection shall be adopted in compliance with [2.3.2](#).

**2.5.3** The minimum fire integrity of the bulkheads and decks separating adjacent spaces shall be as prescribed in Tables [2.5.3-1](#) and [2.5.3-2](#).

For determining the appropriate fire integrity standards to be applied to divisions between adjacent spaces, the spaces are classified according to their fire risk as follows:

(1) control stations: spaces accommodating emergency sources of electrical power and lighting; wheelhouse and navigation room; spaces accommodating ship radio equipment; fire stations; main machinery control room if it is located outside machinery space; spaces accommodating centralized fire alarm system;

(2) corridors and lobbies;

(3) accommodation spaces in accordance with [1.5.2](#), except corridors;

(4) stairways:

interior stairways, lifts, totally enclosed emergency escape trunks and escalators (other than those wholly contained within the machinery spaces) and enclosures.

A stairway which is enclosed only at one level shall be regarded as part of the space from which it is not separated by a fire door;

(5) service spaces (low risk):

storerooms not having provisions for the storage of flammable liquids and having areas less than 4 m<sup>2</sup>;

drying rooms and laundries;

refrigerated provision storerooms insulated with non-combustible materials;

spaces accommodating electrical distribution boards having an area of less than 4 m<sup>2</sup>;

(6) machinery spaces of category A:

spaces as defined in 1.2, Part VII "Machinery Installations";

incinerator rooms and combined incinerator/waste stowage spaces and the flue uptakes from such spaces ([refer to 2.1.5.9](#));

(7) other machinery spaces:

machinery spaces excluding those specified in (6);

spaces for fish meal plants;

spaces accommodating electrical equipment (automatic telephone stations, spaces for air conditioning ducts);

spaces separated from engine room where urea or sodium hydroxide solution tanks for selective catalytic reduction (SCR) systems, exhaust gas recirculation (EGR) systems or exhaust gas cleaning systems (EGCS) are installed;

(8) cargo spaces:

all spaces used for carriage of cargoes (including bulk cargo tanks) as well as trunkways and hatchways to such spaces;

(9) service spaces (greater fire risk):

galleys and pantries containing appliances for hot food preparation, saunas;

storerooms with an area of 4 m<sup>2</sup> and over;

paint lockers and lamp lockers; spaces for storage of flammable liquids;

workshops and similar spaces, which are not part of machinery spaces;

waste stowage spaces and garbage chutes connected thereto;

Table 2.5.3-1

**Fire integrity of bulkheads separating adjacent spaces**

Spaces	Categories of spaces	Categories of spaces									
		(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
Control stations	(1)	A-0 <sup>1</sup>	A-0	A-60	A-0	A-15	A-60	A-15	A-60	A-60	*
Corridors and lobbies	(2)		C	B-0	B-0 A-0 <sup>2</sup>	B-0	A-60	A-0	A-0	A-0	*
Accommodation spaces	(3)			C <sup>3, 4</sup>	B-0 A-0 <sup>2</sup>	B-0	A-60	A-0	A-0	A-0	*
Stairways	(4)				B-0 A-0 <sup>2</sup>	B-0 A-0 <sup>2</sup>	A-60	A-0	A-0	A-0	*
Service spaces (low risk)	(5)					C	A-60	A-0	A-0	A-0	*
Machinery spaces of category A	(6)						*	A-0	A-0 <sup>5</sup>	A-60	*
Other machinery spaces	(7)							A-0 <sup>6</sup>	A-0	A-0	*
Cargo spaces	(8)								*	A-0	*
Service spaces (high risk)	(9)									A-0 <sup>6</sup>	*
Open decks	(10)										—

<sup>1</sup> Bulkheads separating the wheelhouse, chartroom and radio room from each other may be of "B-0" class.

<sup>2</sup> For clarification as to which applies, [refer to 2.1.4.3](#).

<sup>3</sup> Doors separating cabins from individual sanitary accommodation may be constructed of combustible materials in method IC fire protection. No special requirements are imposed upon bulkheads in methods IIC and IIIC.

<sup>4</sup> In case of method IIIC bulkheads of "B-0" class shall be provided between spaces or groups of spaces of 50 m<sup>2</sup> and over in area.

<sup>5</sup> "A-0" class may be used if no dangerous goods are intended to be carried. For cargo spaces intended for carriage of dangerous goods [refer to 7.2.12](#).

<sup>6</sup> Where spaces are used for the same purpose, divisions between them need not be fitted.

**Notes :** 1. Where an asterisk appears in the tables, the division shall be of steel or equivalent but is not required to be of "A" class. However, if in the deck except for the decks in a space of category (10), there are penetrations for electric cables, piping and ventilation ducts, such penetrations shall be flame and smoke tight. Divisions between control stations (emergency generators) and open decks may have air intake openings without closing appliances, except cases when fixed gas fire-fighting system is installed.

2. [Refer to Note 4 to Table 2.2.1.3-1](#).

Table 2.5.3-2

**Fire integrity of decks separating adjacent spaces in ships**

Spaces below	Categories of spaces	Spaces above									
		Categories of spaces									
		(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
Control stations	(1)	A-0	A-0	A-0	A-0	A-0	A-60	A-0	A-0	A-0	*
Corridors and lobbies	(2)	A-0	*	*	A-0	*	A-60	A-0	A-0	A-0	*
Accommodation spaces	(3)	A-60	A-0	*	A-0	*	A-60	A-0	A-0	A-0	*
Stairways	(4)	A-0	A-0	A-0	*	A-0	A-60	A-0	A-0	A-0	*
Service spaces (low risk)	(5)	A-15	A-0	A-0	A-0	*	A-60	A-0	A-0	A-0	*
Machinery spaces of category A	(6)	A-60	A-60	A-60	A-60	A-60	*	A-60 <sup>1</sup>	A-30	A-60	*
Other machinery spaces	(7)	A-15	A-0	A-0	A-0	A-0	A-0	*	A-0	A-0	*
Cargo spaces	(8)	A-60	A-0	A-0	A-0	A-0	A-0	A-0	*	A-0	*
Service spaces (high risk)	(9)	A-60	A-0	A-0	A-0	A-0	A-60	A-0	A-0	A-0 <sup>2</sup>	*
Open decks	(10)	*	*	*	*	*	*	*	*	*	—

<sup>1</sup> Where other machinery spaces of category (7) are the spaces of low fire risk, i.e. they do not contain machinery operating on fuel oil or having a pressure lubrication systems, "A-0" class divisions are permitted.

<sup>2</sup> [Refer to Footnote 6](#) to Table 2.5.3-1.

Notes : 1. [Refer to Note 1](#) to Table 2.5.3-1.

2. [Refer to Note 4](#) to Table 2.2.1.3-1.

(10) open decks:

open deck spaces and enclosed rest areas having no fire risk (this means that their furnishings shall be restricted to deck furniture; in addition, such spaces shall be naturally ventilated by permanent openings:

raw fish-filleting areas, fish washing rooms and similar spaces with no fire risk;

air spaces (spaces outside superstructures and deckhouses).

**2.5.4** Linings, ceilings, draught stops and their associated grounds shall be made of non-combustible materials:

in accommodation and service spaces, and in control stations, if protection method IC is used;

in corridors and stairway enclosures serving accommodation and service spaces, and control stations, if protection methods IIC and IIIC are used.

**2.5.5** Provisions of [2.3.5](#) shall apply to bulkheads within accommodation and service spaces not required to be "A" or "B" class divisions.

Within accommodation spaces, bulkheads required to be "B" class divisions shall extend from deck to deck and to the shell or other boundaries. However, if the continuous "B" class ceilings or linings are fitted on both sides of the bulkhead, the bulkhead may terminate at the continuous ceiling or lining.

**2.5.6** Provisions of [2.3.5.3](#), [2.3.6](#), [2.3.7](#) and [2.3.8](#) shall apply to fire doors.

**2.5.7** For the purpose of application of the requirements given in [2.1.1.7](#), [2.1.1.8](#) and [2.1.1.10](#) it is necessary to use [Fig. 2.3.10](#) and Tables [2.3.10-1](#) and [2.3.10-2](#). [Table 2.3.10-1](#) shall apply in method IC fire protection, [Table 2.3.10-2](#) shall apply in method IIC and IIIC fire protection.

**2.5.8** As a lining material for specially equipped fish-processing shops (for raw fish filleting and washing, refrigerating, canning shops) moisture-resistant plywood with low flame spread characteristics may be used as specified in the FTP Code. For plastic laminated moisture resistant plywood, both composing materials (plywood and laminate) shall have low flame-spread characteristics.

Air spaces enclosed behind ceilings, panellings, or linings shall be divided by close fitting draught stops spaced not more than 14 m apart. In the vertical direction, such air spaces shall be closed at each deck.

Insulating materials of refrigerant piping penetrating spaces of specially equipped fish-processing shops (shops for raw fish filleting and washing, refrigerating, canning shops) shall meet the requirements of 8.2.3, Part XII "Refrigerating Plants".

## **2.6 FISHING VESSELS OF LESS THAN 500 GROSS TONNAGE**

**2.6.1** Unless otherwise stated, the requirements of this Chapter are additional to those set out in [2.1](#) and apply to fishing vessels of less than 500 gross tonnage and 24 m in length and over but less than 45 m, the definition of which is given in 1.2.1, Part I "Classification" of the Rules for the Classification and Construction of Small Sea Fishing Vessels.

**2.6.2** In way of accommodation and service spaces and control stations method IC fire protection shall be adopted in compliance with [2.3.2](#).

**2.6.3** The minimum fire integrity of the bulkheads and decks separating adjacent spaces shall be as prescribed in Tables [2.6.3-1](#) and [2.6.3-2](#).

For determining the appropriate fire integrity standards to be applied to divisions between adjacent spaces, the spaces are classified according to their fire risk according to [2.5.3](#).

**2.6.4** In accommodation and service spaces, in control stations as well as in corridors and stairway enclosures serving accommodation and service spaces and control stations, linings, ceilings, draught stops and their associated grounds shall be made of non-combustible materials.

**2.6.5** Within accommodation spaces, bulkheads required to be "B" class divisions shall extend from deck to deck and to the shell or other boundaries. However, if the continuous "B" class ceilings or linings are fitted on both sides of the bulkhead, the bulkhead may terminate at the continuous ceiling or lining.

Within accommodation spaces, bulkheads not required to be "A" or "B" class divisions, shall be at least "C" class division.

Application of combustible materials may be allowed for doors separating cabins from internal sanitary spaces.

**2.6.6** In accommodation spaces, service spaces and control stations where stairways penetrate more than a single deck, shall be surrounded by "B-0" class divisions with self-closing doors at all levels. Stairways, which penetrate only a single deck, shall be protected at least at one level by at least "B-0" class divisions and self-closing doors. Lift trunks shall be constructed of steel or equivalent material and shall be so fitted as to prevent the passage of smoke and flame from one 'tween-deck space to another and shall be provided with means of closing so as to permit the control of draught and smoke.

**2.6.7** Air spaces enclosed behind ceilings, panellings, or linings shall be divided by close fitting draught stops spaced not more than 7 m apart. In the vertical direction, such air spaces, including those behind linings of stairways, trunks, etc., shall be closed at each deck.

**2.6.8** Provisions of [2.3.6](#), [2.3.7](#) and [2.3.8](#) shall apply to fire doors.

**2.6.9** For the purpose of application of the requirements given in [2.1.1.7](#), [2.1.1.8](#) and [2.1.1.10](#) it is necessary to use [Fig. 2.3.10](#) and [Table 2.3.10-1](#).

**2.6.10** As a lining material for specially equipped fish-processing shops (for raw fish filleting and washing, refrigerating, canning shops) moisture-resistant plywood with low flame spread characteristics may be used as specified in the FTP Code. For plastic laminated moisture resistant plywood, both composing materials (plywood and laminate) shall have low flame-spread characteristics.

Air spaces enclosed behind ceilings, panellings, or linings shall be divided by close fitting draught stops in accordance with [2.6.7](#).

Insulating materials of refrigerant piping penetrating spaces of specially equipped fish-processing shops (for raw fish filleting and washing, refrigerating, canning shops) shall comply with the requirements of 8.2.3, Part XII "Refrigerating Plants".

Table 2.6.3-1

**Fire integrity of bulkheads separating adjacent spaces**

Spaces	Categories of spaces	Categories of spaces									
		(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
Control stations	(1)	A-0 <sup>1</sup>	A-0	A-60	A-0	A-15	A-60	A-15	A-60	A-60	*
Corridors and lobbies	(2)		C	B-0	B-0	B-0	A-60	A-0	A-0	A-0 <sup>2</sup> B-15	*
Accommodation spaces	(3)			C <sup>3</sup>	B-0	B-0	A-60	A-0	A-0	A-0 <sup>2</sup> B-15	*
Stairways	(4)				B-0	B-0	A-60	A-0	A-0	A-0 <sup>2</sup> B-15	*
Service spaces (low risk)	(5)					C	A-60	A-0	A-0	A-0 <sup>2</sup> B-15	*
Machinery spaces of category A	(6)						*	A-0	A-0 <sup>4</sup>	A-60	*
Other machinery spaces	(7)							A-0 <sup>5</sup>	A-0	A-0	*
Cargo spaces	(8)								*	A-0	*
Service spaces (high risk)	(9)									A-0 <sup>2,5</sup> B-15 <sup>5</sup>	*
Open decks	(10)										—

<sup>1</sup> Bulkheads separating the wheelhouse, chartroom and radio room from each other may be of "B-0" class.

<sup>2</sup> Bulkheads separating galley from spaces of categories (2)–(5) and (9), shall be of "A-0" class. Bulkheads separating storerooms for flammable materials and substances from spaces of categories (2), (4), (5) and (9), shall be of "A-0" class (storerooms shall not be adjacent to accommodation spaces).

<sup>3</sup> Doors separating cabins from individual sanitary accommodation may be constructed of combustible materials.

<sup>4</sup> "A-0" class may be used if no dangerous goods, for example, fish meal, are intended to be carried. For cargo spaces intended for carriage of dangerous goods, refer to 7.2.12.

<sup>5</sup> Where spaces are used for the same purpose, divisions between them need not be fitted.

**Notes :** 1. When an asterisk appears in the tables, the division shall be of steel or equivalent material, but is not required to be of "A" class. However, if in the deck except for the decks in a space of category (10), there are penetrations for electric cables, piping and ventilation ducts, such penetrations shall be flame and smoke tight. Divisions between control stations (emergency generators) and open decks may have air intake openings without closing appliances, except cases when fixed gas fire-fighting system is installed.

2. Refer to Note 4 to Table 2.2.1.3-1.

Table 2.6.3-2

**Fire integrity of decks separating adjacent spaces**

Spaces below	Categories of spaces	Spaces above									
		Categories of spaces									
		(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
Control stations	(1)	A-0	A-0	A-0	A-0	A-0	A-60	A-0	A-0	A-0	*
Corridors and lobbies	(2)	A-0	*	*	A-0	*	A-60	A-0	A-0	A-0	*
Accommodation spaces	(3)	A-60	A-0	*	A-0	*	A-60	A-0	A-0	A-0	*
Stairways	(4)	A-0	A-0	A-0	*	A-0	A-60	A-0	A-0	A-0	*
Service spaces (low risk)	(5)	A-15	A-0	A-0	A-0	*	A-60	A-0	A-0	A-0	*
Machinery spaces of category A	(6)	A-60	A-60	A-60	A-60	A-60	*	A-60 <sup>1</sup>	A-30	A-60	*
Other machinery spaces	(7)	A-15	A-0	A-0	A-0	A-0	A-0	*	A-0	A-0	*
Cargo spaces	(8)	A-60	A-0	A-0	A-0	A-0	A-0	A-0	*	A-0	*
Service spaces (high risk)	(9)	A-60	A-0	A-0	A-0	A-0	A-60	A-0	A-0	A-0 <sup>2</sup>	*
Open decks	(10)	*	*	*	*	*	*	*	*	*	—

1 Where other machinery spaces of category (7) are the spaces of low fire risk, i.e. they do not contain machinery operating on fuel oil or having a pressure lubrication systems, "A-0" class divisions are permitted.

2 [Refer to Footnote 5](#) to Table 2.6.3-1.

Notes : 1. [Refer to Note 1](#) to Table 2.6.3-1.

2. [Refer to Note 4](#) to Table 2.2.1.3-1.



### **3 FIRE-FIGHTING EQUIPMENT AND SYSTEMS**

#### **3.1 GENERAL**

##### **3.1.1 General.**

**3.1.1.1** The requirements of this Section are applicable to all fire-fighting equipment and systems fitted in sea-going ships for the purpose of fire protection of the ship concerned.

Where provision is made in a ship for extra fire extinguishing systems in addition to those prescribed by this Section, such systems shall also comply with the requirements set out below, to an extent approved by the Register.

During design and manufacture of fire extinguishing systems, the requirements of the FSS Code and Sections 1 to 5, Part VIII "Systems and Piping" of these Rules shall be complied with.

**3.1.1.2** Fire-fighting equipment and systems shall be so constructed that they will be efficient and readily available for operation under all service conditions (refer to 2.3.1, Part VII "Machinery Installations").

**3.1.1.3** Containers and pressure vessels used in fire extinguishing systems shall meet the requirements set forth in 6.4, Part X "Boilers, Heat Exchangers and Pressure Vessels".

**3.1.1.4** The use of a fire extinguishing medium which either by itself or under expected conditions of use gives off toxic gases in such quantities as to endanger the persons shall not be permitted. It is prohibited to install in ships new fire extinguishing plants utilizing halon 1211, halon 1301 и halon 2402, as well as perfluorocarbons.

##### **3.1.2 Fire extinguishing systems.**

**3.1.2.1** In addition to the water fire main system and in accordance with the purpose for which they are intended, all ship's spaces shall be protected by one of the fixed fire extinguishing systems according to [Table 3.1.2.1](#), unless expressly provided otherwise.

The Register may consider the use of other equivalent systems, ensuring equivalent protection.

For machinery spaces of category A and pump rooms specified in [1.5.7.1](#), equivalent fire extinguishing systems complying with the requirements of [3.9](#) may be used instead of pressure water-spraying systems and carbon dioxide smothering systems.

For protection of spaces specified in [1.5.4.3](#), [1.5.4.4](#) and [1.5.9](#), the Register may permit the use of fixed fire extinguishing system other than prescribed by [Table 3.1.2.1](#), if the full-scale test in conditions simulating spilled petroleum burning in the said space will prove that alternative system is not less effective in fire fighting.

**3.1.2.2** Calculation of the necessary quantity of the fire-extinguishing medium shall be made for each protected space. The maximum calculation values shall be taken for the quantity of stored fire extinguishing medium.

Fire extinguishing system shall be fitted with valves normally closed for transfer of fire extinguishing medium to the appropriate space.

Where two or more adjacent spaces presenting different degrees of fire risk are not separated by gastight or watertight bulkheads or decks, or where fuel oil can flow from one space into another and the possibility of such flowing is not eliminated structurally, the choice of fire extinguishing medium and, consequently, of a fire extinguishing system shall be made to comply with the requirements for the fire protection of the space which affords the greatest fire risk, and the calculation of the necessary quantity of fire extinguishing medium and the rate of application shall be made on the basis of the total area or volume, respectively, of all spaces thus communicating.

When calculating the necessary quantity of the fire extinguishing medium and its application rate for fixed gas fire extinguishing systems, the adjacent spaces with independent ventilation systems not separated by at least "A-0" class divisions shall be considered as the same space.

Table 3.1.2.1

Nos.	Description of spaces	Fixed fire extinguishing systems							
		Sprinkler	Pressure water spraying	Water screen	Drenching	Foam fire extinguishing	Carbon dioxide smothering	Dry powder	Aerosol
1	Control stations listed in <a href="#">1.5.1.1</a> , <a href="#">1.5.1.5</a>	+ <sup>1</sup>			+ <sup>22</sup>				
2	Control stations listed in <a href="#">1.5.1.2</a> <sup>2</sup>		+			+	+		+
3	Accommodation spaces listed in <a href="#">1.5.2.1</a> and <a href="#">1.5.2.2</a>	+ <sup>1</sup>							
4	Service spaces listed in <a href="#">1.5.3.1</a> , <a href="#">1.5.3.2.3</a> <sup>22</sup> and <a href="#">1.5.3.2.4</a>	+ <sup>1</sup>			+ <sup>22</sup>				
5	Storerooms listed in <a href="#">1.5.3.2.1</a>				+				
6	Storerooms listed in <a href="#">1.5.3.2.2</a> <sup>3</sup>	+ <sup>1</sup>	+		+ <sup>22</sup>	+ <sup>4</sup>	+	+	+ <sup>5</sup>
7	Cargo spaces listed in <a href="#">1.5.4.3</a> , <a href="#">1.5.4.4</a>		+	+ <sup>6</sup>		+ <sup>7</sup>	+ <sup>8</sup>		
8	Tanks for petroleum products, <a href="#">refer to 1.5.4.1</a>					+			
9	Cargo spaces, <a href="#">refer to 1.5.4.2</a> <sup>9,10</sup>		+ <sup>11,12</sup>			+ <sup>4</sup>	+ <sup>13</sup>		
10	Machinery spaces of category A <sup>2,14</sup> , hangers and spaces where refueling and hanger facilities are located; spaces containing equipment for the fuel preparation specified in 9.7.2.5 of Part XVII "Distinguishing Marks and Descriptive Notations in the Class Notation Specifying Structural and Operational Particulars of Ships"; BWMR containing ozone-based BWMS <sup>23</sup>		+			+ <sup>7</sup>	+		+
11	Silencers of internal combustion engines <sup>15</sup> , regenerators of gas turbine installation <sup>16</sup> and exhaust ducts from galley ranges <sup>17</sup> , exhaust gas boilers						+		
12	Unattended machinery spaces containing propulsion electric motors, steam engines or steam turbines having power output not less than 375 kW		+ <sup>18</sup>			+ <sup>7</sup>	+		+
13	Pump rooms listed in <a href="#">1.5.7.1</a>		+			+ <sup>7</sup>	+ <sup>19</sup>		+ <sup>5</sup>
14	Working spaces listed in <a href="#">1.5.8.1</a>		+			+ <sup>7</sup>	+		+
15	Fire zones of category A machinery spaces		+ <sup>20</sup>						
16	Special category spaces listed in <a href="#">1.5.9</a>		+						

17	The deck of gas carriers in the cargo area, including any parts of the exposed liquid cargo or vapour piping, any liquid or gaseous product loading and unloading lines on the deck and in the bow and stern cargo handling areas, as applicable, and the exposed gas process units							+	
18	Rooms for separators, etc. and other spaces specified in 4.2.7, Part VII "Machinery Installations"		+			+ <sup>7</sup>	+		+
19	Scavenge spaces of the crosshead type internal combustion engines (refer to 2.2.4, Part IX "Machinery")						+		
20	Area of forward and aft loading/unloading arrangements in oil tankers, helidecks					+			
21	Chain stoppers and cargo hose connections on oil tankers accommodated to mooring at point berths carried out to sea and fitted up with a forward cargo gear		+						
22	Corridors and stairways	+ <sup>21</sup>							

<sup>1</sup> Automatic sprinkler system shall be installed:

In passenger ships carrying more than 36 passengers in control stations, accommodation and service spaces including corridors and stairways. Alternatively, control stations, where water may damage essential equipment may be fitted with an approved fixed fire extinguishing system of another type ([refer to 3.3.1.1](#)). The system may not be fitted in spaces of minor or no fire risk as void spaces, public toilets, carbon dioxide cylinder rooms and similar spaces;

in passenger ships carrying not more than 36 passengers (where fixed smoke detection alarm system is fitted only in corridors, stairways and escape routes within accommodation spaces) in accommodation and service spaces and if the Register deems it necessary, in control stations ([refer to 1.5.1.2](#)), except in spaces of minor or no fire risk as void spaces, sanitary rooms, etc.;

in cargo ships where method ILC is adopted in accommodation spaces, galleys and other service spaces, except spaces of minor or no fire risk as void spaces, sanitary rooms, etc; incinerator and combined incinerator/waste storage spaces, and the flue uptakes from such spaces ([refer to 2.1.5.9](#)).

<sup>2</sup> Where the capacity of emergency diesel-generator is lower than 375 kW, the control station space may be protected by portable fire extinguishers according to [Table 5.1.2](#).

<sup>3</sup> Paint lockers and storerooms for flammable liquids, liquefied and compressed gases need not be fitted with a fixed fire extinguishing system, if the area of each storage space is not more than 4 m<sup>2</sup> ([refer to 3.1.3.3](#)). Spaces for storage of cargo specimen located in the tanker cargo area may not be fitted with fire extinguishing system.

<sup>4</sup> A system using medium expansion foam shall be used.

<sup>5</sup> Explosion-proof aerosol generators shall be installed.

<sup>6</sup> Water screens are used in addition to the systems specified in cols [4](#), [7](#) and [10](#) in cases indicated in [2.2.1.2](#).

- <sup>7</sup> A system using high expansion foam shall be used. The selected foam concentrate shall be suitable, depending on the protected ship's space, for extinguishing of fuel oil, aviation fuel, flammable liquids, combustible materials and carried cargoes applied on the ship.
- <sup>8</sup> A carbon dioxide smothering system may be installed only in the cargo spaces, which may be closed tightly from a location outside the said spaces. Refer also to [3.1.2.13](#).
- <sup>9</sup> A foam fire extinguishing system shall not be used for the protection of cargo spaces of container ships.
- <sup>10</sup> On agreement with the Register spaces for general cargoes except dangerous goods may not be fitted with fixed fire extinguishing systems in the following cases:  
in passenger ships engaged in short voyages;  
in passenger ships of less than 1000 gross tonnage, provided the ship is fitted with portable fire-fighting equipment for cargo spaces, as well as with steel hatch covers and effective closing appliances of all ventilating and other openings leading to cargo spaces;  
in cargo ships of less than 2000 gross tonnage constructed or intended only for the carriage of ore, coal, grain, green timber, non-combustible cargoes and cargoes of minor fire risk (refer to Table 1 of IMO circular MSC.1/Circ.1395/Rev.4), provided the ship is fitted with steel hatch covers and effective closing appliances of all ventilating and other openings leading to cargo spaces;  
in cargo spaces are carried only such cargoes, for which fixed gas fire extinguishing system is not efficient (refer to Table 2 of IMO circular MSC.1/Circ.1395/Rev.4), provided the requirement of [7.2.5.2](#) is fulfilled.
- <sup>11</sup> In fish meal cargo spaces the rate of water discharge shall be 1,5 l/min per 1 m<sup>2</sup>; in combined cargo spaces for fish meal and intended also for carriage and storage of packages the rate of water discharge shall be 5 l/min per 1 m<sup>2</sup>.
- <sup>12</sup> Spaces for the carriage of Class 1 dangerous goods, except 1.4S, in addition to the smothering system shall be protected according to [7.2.5.3](#).
- <sup>13</sup> A carbon dioxide smothering system or any equivalent fire extinguishing system may not be installed in fishing vessels for protection of the refrigerated cargo holds provided they are not cargo spaces of high fire risk and/or not intended for storage and carriage of packages.
- <sup>14</sup> Where an auxiliary oil-fired boiler or boilers as well as incinerators operating on fuel oil situated inside the machinery space is (are) not isolated from the rest of the space by gastight enclosure bulkheads and platforms, the machinery space shall be fitted with one of the above fire extinguishing systems, this system being capable of protecting the entire space, even where this machinery space does not contain any other oil-fired equipment or machinery, besides the above boilers.
- <sup>15</sup> The silencers of medium- and high-speed engines need not to be fitted with the fixed fire extinguishing system, when there are spark arresters in the exhausts. This requirement does not apply to fishing vessels of less than 500 gross tonnage.
- <sup>16</sup> Installation of one of the above systems is compulsory in all oil tankers and oil recovery tankers, supply vessels, ships adapted for the carriage of explosive and fire hazardous cargoes and on ships servicing and towing the above-mentioned ships.
- <sup>17</sup> In passenger ships carrying not more than 36 passengers and in cargo ships is required when ducts pass through some spaces located in way of accommodation spaces.
- <sup>18</sup> Pressure water-spraying system may be used only for spaces where steam turbines or steam engines are of enclosed type.
- <sup>19</sup> A warning notice shall be provided at the carbon dioxide smothering system controls stating that because of ignition hazard caused by electrostatic discharges the system shall be used only for fire extinguishing but not for inerting purposes.
- <sup>20</sup> [Refer to 3.12.](#)
- <sup>21</sup> The sprinkler system is compulsory only on passenger ships carrying more than 36 passengers.
- <sup>22</sup> Only on ships fitted with fixed diving system to protect compression chamber control and support station, diving operation control station and pressure vessels, including cylinders with gases (O<sub>2</sub>, N<sub>2</sub>, He) or breathing gas mixtures (O<sub>2</sub>/He, O<sub>2</sub>/He/N<sub>2</sub>, N<sub>2</sub>/O<sub>2</sub>) located in separate storerooms.
- <sup>23</sup> Refer to [2.1.5.10.8](#).

**3.1.2.3** Where a fixed gas fire extinguishing system is used, the openings through which air may penetrate to or gas may escape from a protected space shall be capable of being closed from outside the protected space. Watertight and gastight doors in the bulkhead separating adjacent machinery spaces may be considered as closures of openings in such bulkhead only where they are of a self-closing type or operated remotely and the fire extinction stations, from which the extinguishing medium may be discharged, are provided with the signalling of the fully closed doors. In the absence of such signalling, the calculation of the required amount and the rate of discharge of extinguishing medium shall be based on the requirement of providing for the total volume (area) of the adjacent spaces.

**3.1.2.4** In multi-deck ships, one 'tween deck is considered as separated from another 'tween deck or hold by a gastight deck, provided the cargo hatchways, other hatchways and openings in this deck are closed with watertight or gastight steel hatch closures and covers, while watertight stops are fitted where the deck is pierced in way of the framing. In the absence of such closures and stops, the spaces shall be considered as communicating, and the extinguishing medium calculation shall be made on the basis of the total volume of the spaces.

**3.1.2.5** Where a space protected by means of carbon dioxide smothering system and aerosol fire extinguishing system contains air reservoirs the required quantity of extinguishing medium shall be calculated on the basis of the designed volume of the protected space plus the excess of the free volume of the compressed air. If arrangements are made for discharging the compressed air outside the protected space, by means of relief valves and fuses provided on the air reservoirs then an increase of the quantity of carbon dioxide in the carbon dioxide smothering systems need not be provided and the volume of the air in the air receivers in the aerosol fire extinguishing systems while assessment of the quantity of the aerosol generating compound may be not considered ([refer to 3.11.1.3](#)).

**3.1.2.6** In order to prevent excessive pressure in spaces protected by fire smothering systems, due to discharge of extinguishing medium, such spaces shall be fitted with breather valves, where necessary, or other available means (e.g. air pipes or ventilation ducts) shall be used.

**3.1.2.7** Spaces for fuel oil units ([refer to item 18](#) of Table 3.1.2.1) enclosed inside engine rooms may have either an independent fire extinguishing system or they may be protected by the fire extinguishing system of the engine room.

**3.1.2.8** Whatever a fixed fire extinguishing system is specified in [Table 3.1.2.1](#) for boiler spaces of oil tankers in which crude oil or clops are used for boilers, provision shall be made for 135 l capacity foam extinguisher in compliance with [5.1.10](#) or an equivalent foam unit equipped with fixed foam generators capable of delivering foam to the boiler fronts and to trap under burners, valves and connections. This fire unit shall be remotely operated from outside the boiler room.

In boiler rooms with domestic boilers of less than 175 kW and in case of boilers protected by fixed local application fire extinguishing systems, the fire extinguisher or unit is not required.

**3.1.2.9** The systems shall be so arranged as to provide the delivery of extinguishing medium to the entire space protected, including the enclosed portions thereof (e.g. control stations, workshops, etc. in machinery spaces).

**3.1.2.10** The use of steam may be permitted by the Register depending on the particular case as an addition to the required fire extinguishing medium; the boiler or boilers available for supplying steam shall have an evaporation of at least 1,0 kg of steam per hour for each 0,75 m<sup>3</sup> of the gross volume of the largest space so protected.

**3.1.2.11** Where gas, which is a gaseous product of oil fuel combustion, is used as a fire extinguishing medium, the systems using it for protection of machinery and cargo spaces shall comply with the FSS Code.

**3.1.2.12** Liquid cargoes with the flash point above 60 °C other than oil products or liquid cargoes liable to the requirements of the IBC Code are treated as those with low fire risk and requiring no fixed foam fire extinguishing system.

**3.1.2.13** For protection of cargo spaces fitted with partially weathertight hatchway covers on board container ships (refer to IMO circular MSC/Circ.1087), the requirements of [Section 2](#) of the above circular shall serve as a guide when calculating the amount of carbon dioxide in the carbon dioxide fire extinguishing systems. If the clear gaps between hatchway covers exceed 50 mm, fixed pressure water-spraying system shall be fitted in the cargo spaces.

**3.1.2.14** Deep-fat cooking equipment, installed in enclosed spaces or on open decks, shall be fitted with an automatic or manual fire extinguishing system tested according to the international standard ISO 15371 "Fire Extinguishing Systems for Protection of Galley Deep-Fat Cooking Equipment". Controls for manual operation of the fire extinguishing system shall be clearly labeled. When actuating this system the following shall be provided:

- .1 automatic shutdown of electrical power supply to the deep-fat cooking equipment;
- .2 the alarms giving warning of actuation of this system in a galley where deep fat cooking equipment is fitted.

Deep-fat cooking equipment shall be equipped with main and auxiliary thermostats with individual failure warning systems.

**3.1.3 Arrangement and equipment of fire extinction stations.**

**3.1.3.1** Mechanical equipment, such as foam mixers, reservoirs, cylinders or vessels containing extinguishing medium or compressed air, inert gas generators, or high expansion foam generators, refrigerating plants, etc., as well as the starting controls of all fire extinguishing systems, except for the water fire main system, shall be arranged as a rule in fire extinction stations outside the protected spaces ([refer also to 3.1.3.5](#)). Spaces for storage of fire extinguishing medium located below deck or having no access from the open deck shall be provided with mechanical ventilation system in compliance with 12.9.1, Part VIII "Systems and Piping".

The storage rooms for fixed gas fire extinguishing systems of fire extinction stations shall be used for no other purpose.

Pumps, other than those servicing the fire main, required for the water supply to fire extinguishing systems, their sources of power and controls shall be fitted outside the space or spaces protected by such systems and shall be so arranged as to prevent failure of any system in case of fire in the space or spaces protected.

**3.1.3.2** Fire extinction stations shall comply with the following requirements:

- .1 any entrance to the fire extinction stations shall be, as a rule, from the open deck and shall be independent of the protected space. If the station is located below deck, it shall be located no more than one deck below the open deck and shall be directly accessible by a stairway or ladder from the open deck.

The means of controlling the fixed fire extinguishing system shall be readily accessible and shall be grouped in as few locations as possible at positions not likely to be cut off by a fire in the protected space;

- .2 stations shall not be arranged forward of the collision bulkhead;
- .3 bulkheads and decks (including doors and other means of closing any opening therein), which form the boundaries between them and adjacent enclosed spaces shall be gastight. Such storage rooms for fire extinguishing medium shall be considered as fire control stations when applying fire integrity tables;
- .4 the spaces housing stations shall be protected by heat insulation and shall be fitted with heating, if it is essential for normal operation of the station that positive temperature is maintained therein. The temperature in the spaces housing carbon dioxide extinction stations shall not exceed 45 °C;
- .5 air temperature in the station shall be controlled by means of thermometer so fitted therein that its readings are visible both from inside the station and, through a scuttle, from outside the station; in case of remote control of temperature limit the scuttle need not be required;



**.6** fire extinction stations for cargo spaces shall be provided with telephone or other means of communication with the central control station and with the machinery space, if operation of the fire extinction station is dependent on the equipment located in the machinery space;

**.7** entrance doors shall be opened outwards and kept permanently locked and one set of keys for the locks shall be kept in a closed case with a glazed door located near the lock;

**.8** all valves and other arrangements of the station shall be provided with nameplates identifying them with the spaces whose protection is controlled by the individual valves or arrangements. In addition, a schematic plan of the fire extinguishing system showing the starting controls and the spaces protected, as well as brief instructions for starting and operating the system shall be displayed in a conspicuous position within the station.

**3.1.3.3** For lockers of a deck area of less than 4 m<sup>2</sup>, containing combustible materials and substances ([refer to 1.5.3.2.2](#)) which do not give access to accommodation spaces carbon dioxide portable fire extinguisher providing a minimum volume of free gas to 40 % of the gross space volume, may be accepted in lieu of fixed fire extinguishing systems. The inlet port shall be arranged in a locker bulkhead to allow discharge of extinguishing medium without entry into the protected space. This portable fire extinguisher shall be stowed adjacent to the port. Alternatively, a port or hose connection may be provided to facilitate the use of fire main water.

**3.1.3.4** In passenger ships controls for any required fire extinguishing system for machinery spaces and the controls specified in [2.1.4.1](#), [2.1.4.2.3](#), as well as in 12.2.11 and 13.1.3, Part VIII "Systems and Piping" shall be located together or shall be grouped in as few places as possible. A safe access to these places from the open deck shall be provided.

**3.1.3.5** In equivalent fixed gas fire extinguishing systems with modular configuration, the fire extinguishing gas cylinders may be located in the protected space in at least six separate locations and subject to the requirements of para 5 of Annex to IMO circular MSC.1/Circ.1267. The arrangement of fire extinguishing gas cylinders, the electrical circuits and piping essential for the release of any system shall be such that in the event of a single failure to one of the release lines (including bottle valve) through mechanical damage, fire or explosion in a protected space, other system equipment shall provide the delivery and distribution of five sixth of the fire extinguishing gas adequate to the minimum fire extinguishing concentration.

For systems that need less than six cylinders (using the smallest bottles available), the total amount of extinguishing gas on the bottles shall be such that in the event of a single failure to one of the release lines (including bottle valve), five sixth of the fire extinguishing gas can still be discharged. This may be achieved by for instance using more extinguishing gas than required so that if one bottle is not discharging due to a single fault, the remaining bottles shall discharge the minimum five sixth of the required amount of gas. This can be achieved with minimum two bottles.

However, no-observed-adverse-effect level (NOAEL is the highest gas concentration where the adverse effect to the health is not observed) calculated at the highest expected engine room temperature shall not be exceeded when discharging the total amount of extinguishing gas simultaneously.

Systems that cannot comply with the above, for instance systems using only one bottle located inside the protected space, cannot be accepted. Such systems shall be designed with the bottle(s) located outside the protected space, in a dedicated room in compliance with [3.1.3.2](#).

**3.1.3.6** Fire extinguishing medium protecting the cargo holds may be stored in a room located forward the cargo holds, but aft of the collision bulkhead, provided that both the local manual release mechanism and remote control(s) for the release of the media are fitted, and the latter is of robust construction or so protected as to remain operable in case of fire in the protected spaces. The remote controls shall be placed in the accommodation area in order to facilitate their ready accessibility by the crew. The capability to release different quantities of fire extinguishing medium into different cargo holds so protected shall be included in the remote release arrangement.

### **3.1.4 Pipes and fittings.**

#### **3.1.4.1** Pipes shall be so laid as to comply with the following requirements:

**.1** the necessary pipes for conveying fire extinguishing medium into the protected spaces shall be provided with control valves so marked as to indicate clearly the spaces to which the pipes are led. Suitable provisions shall be made to prevent inadvertent release of the medium into the space.

This requirement does not apply to the foam extinguishing systems intended to deliver foam from outside the cargo tanks by means of monitors and portable air-foam nozzles or foam generators producing average expansion foam;

**.2** where a cargo space fitted with a gas fire extinguishing system is used as a passenger space, the gas connection shall be blanked during such use;

**.3** laying the pipes of fire extinguishing systems through spaces containing fuel oil and lubricating oil shall not be permitted.

Pipes of fire extinguishing systems, shall not be laid through refrigerated spaces;

**.4** gas fire extinguishing systems may pass through accommodation spaces, provided they have sufficient wall thickness, and their gas tightness after installation on board a ship is tested by test pressure of not less than 5 N/mm<sup>2</sup>. Besides, pipelines running through the accommodation spaces shall be connected by welding only and shall not have condensate drainage openings or other openings within such spaces;

**.5** all fire extinguishing systems shall be so designed as to permit periodical checks in operation.

Systems fitted with pipes and nozzles for supply of fire extinguishing medium shall have arrangements for checking them in operation using compressed air.

A non-return shut-off valve shall be fitted on the pipeline supplying compressed air to the manifold of the fire smothering station;

**.6** gaskets and flexible joints used in fire extinguishing systems shall be made of non-combustible materials resistant to the effect of the extinguishing medium, and marine environment;

**.7** in piping sections where valve arrangements introduce sections of closed piping, such sections shall be fitted with a pressure relief valve and the outlet of the valve shall be led to open deck.

#### **3.1.4.2** Pipes shall be made of steel.

Copper, copper-and-nickel or bimetallic pipes (one of the layers being steel or copper) may be used as equivalent to steel pipes.

Carbon steel pipes shall have anti-corrosive coating both inside and outside.

The fittings of fire extinguishing systems, including sprinklers and sprayers, shall be made of materials resistant to the fire extinguishing medium and to marine environment. Nozzles of fixed pressure water-spraying and equivalent water-based fire extinguishing systems (fixed water-mist fire extinguishing systems) for machinery spaces and cargo pump rooms shall be of an approved type and shall be tested in compliance with the requirements of IMO circular MSC/Circ.1165, as amended by IMO circular MSC.1/Circ.1269.

### **3.1.5 Starting of systems.**

**3.1.5.1** A system shall be put into operation without any supplementary change-over at the station and shall operate quickly and efficiently under all service conditions, including those when the temperature is below zero and during a fire.

The means of control of any fixed gas fire extinguishing system shall be readily accessible, simple to operate and shall be grouped together in as few locations as possible at positions not likely to be cut off by a fire in a protected space.

At each location there shall be clear instructions relating to the operation of the system having regard to the safety of personnel.



**3.1.5.2** The possibility of spontaneous starting of a fire extinguishing system shall be excluded under any service conditions, including the effect of such factors as pitching and rolling, shaking and vibration.

**3.1.5.3** Starting controls shall be so arranged, and if necessary so protected, that a free access to them is provided and their mechanical damage is precluded.

**3.1.5.4** Arrangements shall be provided for the attachment of seals to the starting controls of the system.

**3.1.5.5** Irrespective of remote control provision the system shall be capable of being manually started directly at the fire extinction station, and the pump — at the place of its location.

**3.1.5.6** Remote control system (by air, nitrogen, carbon dioxide, etc.) shall be provided with two cylinders, gas quantity in each of them being sufficient for a single start.

**3.1.5.7** Where provision is made for mechanical devices in the remote starting system, their valves shall be controlled with the help of hand wheel or levers to be positively connected to the valve stems or spindles.

**3.1.5.8** Automatic discharge of fire extinguishing medium is not permitted except for cases stipulated by [3.3](#), [3.6.3](#) and [3.11.2.5](#).

### 3.2 WATER FIRE MAIN SYSTEM

#### 3.2.1 Number and capacity of fire pumps.

**3.2.1.1** In ships provision shall be made for pumps, fire mains, hydrants and hoses complying as applicable with the requirements of this Chapter.

The number of fixed independently driven fire pumps and the minimum pressure at all hydrants at water delivery through any adjacent hydrants by two pumps simultaneously of the quantity of water specified in [3.2.5.1](#) shall be not less than those specified in [Table 3.2.1.1](#), the length of hoses complying with the requirements of [5.1.4](#), and the nozzle outlet diameters complying with [5.1.5](#).

Pontoons for technological and dry cargo transportation services (refer to definitions in 1.1.1, Part I "Classification") having no machinery spaces may not be fitted with a water fire main system.

Table 3.2.1.1

Gross tonnage	Passenger ships		Other ships	
	Number of pumps	Minimum pressure at hydrants, in MPa	Number of pumps	Minimum pressure at hydrants, in MPa
Under 500	2	0,30	1	0,20
500 to 1000	2	0,30	2	0,25
1000 to 4000	2	0,30	2	0,25
4000 to 6000	3	0,40	2	0,25
6000 and upwards	3	0,40	2	0,27

Notes : 1. The number of pumps indicated above does not include the emergency fire pump, if fitted.  
2. The maximum pressure at any hydrant shall not exceed pressure, at which the effective control of a fire hose can be demonstrated.

For ships of restricted areas of navigation, which are not engaged in international voyages (except for passenger ships) and have a gross tonnage under 2000, the requirement of [Table 3.2.1.1](#) concerning the number of pumps may be waived subject to a special agreement with the Register.

On floating cranes with a gross tonnage under 2000, one fire pump may be installed.

The pressure developed by the fire pumps shall be sufficient to ensure the operation of other fire extinguishing systems using water (e.g., for pressure water spraying, froth extinguishing, etc.) and supplied from the same fire pumps.

**3.2.1.2** In passenger ships of 1000 gross tonnage and upwards, the of sea connections, fire pumps and their sources of power shall be so arranged that, in the event of a fire in any one compartment, all the fire pumps will not be put out of action. Passenger ships of less than 1000 gross tonnage and cargo ships of 2000 gross tonnage and upwards shall be provided with an emergency fire pump of a capacity not less than 25 m<sup>3</sup>/h and cargo ships of less than 2000 gross tonnage shall be provided with an emergency fire pump of a capacity not less than 15 m<sup>3</sup>/h independently driven, if a fire in any one compartment could put all the pumps or their sources of power out of action. Source of power and sea connection shall be located outside the space where the main fire pumps or their sources of power are located (refer also to [3.2.4.2](#) and [3.2.5.7](#)).

**3.2.1.3** Emergency fire pump, if fitted, shall meet the requirements of [3.2.4](#).

**3.2.1.4** In addition to the provisions of [3.2.1.2](#) in passenger ships of less than 1000 gross tonnage and in cargo ships the emergency fire pump shall be also fitted in the following cases:

.1 the two main fire pumps, their sea connections and sources of power are located within compartments separated at least by "A-0" class divisions, so that a fire in any one compartment will not put both fire pumps out of action;

**.2** one main fire pumps is located in a compartment having more than one bulkhead or deck adjacent to the compartment containing the other main fire pump.

**3.2.1.5** The total capacity of fixed fire pumps, except for an emergency pump, if any, with the pressure at any hydrant not less than that specified in [Table 3.2.1.1](#), shall ensure discharge of water for fire fighting in a quantity, in m<sup>3</sup>/h, not less than

$$Q = km^2 \quad (3.2.1.5)$$

where  $m = 1,68 \sqrt{L(B + D)} + 25$ ;

L = length of the ship (refer to 1.1.3, Part II "Hull"), in m, excluding the length of the spoil hopper, if no tanks and other storages for combustible materials are installed therein, in hopper dredgers and hopper barges;

B = moulded breadth, in m;

D = depth to the bulkhead deck amidships, in m;

k = coefficient equal to:

0,016 for passenger ships having subdivision index R equal to, or more than 0,5;

0,012 for passenger ships having subdivision index R less than 0,5;

0,008 for all other ships;

R = subdivision index determined in accordance with 2.3, Part V "Subdivision".

In all cases for passenger ships and cargo ships of more than 500 gross tonnage the required fire pumps shall provide the following water supply for fire-fighting purposes at the pressure specified in [Table 3.2.1.1](#):

**.1** in passenger ships — not less than two thirds of the quantity sucked from the holds by bilge pumps;

**.2** in cargo ships — not less than four thirds of the quantity sucked from the holds of the same size passenger ship by each independent bilge pump according to the requirements of 7.1, Part VIII "Systems and Piping".

**3.2.1.6** For catamarans and similar ships, the total capacity of fire pumps shall be determined as twice the capacity value for one hull.

**3.2.1.7** In all ships other than passenger ships the total capacity of fire pumps need not exceed 180 m<sup>3</sup>/h, unless a larger capacity is required in order to ensure the simultaneous operation of other systems using water.

**3.2.1.8** The capacity, pressure head and number of fire pumps for floating docks shall be chosen in accordance with the quantity of water required by the largest cargo ship which the dock can carry, for the operation of the water fire main system.

On non-self-contained floating docks receiving water for the water fire main system from the shore the emergency fire pump need not be installed.

**3.2.1.9** Each fixed fire pump except of emergency shall be capable of supplying at least two jets of water required by [3.2.6.2](#).

**3.2.1.10** The capacity of each fixed pump, other than an emergency pump, shall not be less than 80 % of the total required capacity divided by the required number of fire pumps, but in any case not less than 25 m<sup>3</sup>/h.

If the number of fire pumps exceeds the required number, the feed of the additional pumps shall be at least 25 m<sup>3</sup>/h and it shall be sufficient to support at least two nozzles in accordance with [3.2.6.2](#).

**3.2.1.11** If other fire extinguishing systems using water supplied by fixed fire pumps are provided in ships, the capacity of these pumps shall be sufficient for the operation of the water fire main system having the capacity not less than 50 % determined by [Formula \(3.2.1.5\)](#) and for parallel operation of one of the other systems requiring the largest quantity of water. In the case concerned the quantity of water for the water fire main system shall be sufficient for delivering at least two jets of water through the largest nozzles used in the ships, but more than six jets and more than 90 m<sup>3</sup>/h for cargo ships are not required. Possible increase

of water discharge through each hydrant due to the pressure rise in the pipes required for the operation of the other fire extinguishing systems shall be taken into consideration.

The quantity of water for fire extinguishing systems, other than for the water fire main system, shall be determined in accordance with the requirements in [3.3.2.2](#), [3.4.2](#), [3.5.2](#) (within one main vertical zone), [3.6.5](#) and [3.7](#).

### **3.2.2 Location of fire pumps.**

**3.2.2.1** Location of fire pumps on cargo and passenger ships shall comply with the requirements of [3.2.1.2](#) and [3.2.1.4](#) that determine necessity of installation of an emergency fire pump depending on location of fire pumps as well as requirements of [3.2.3.6](#) and [3.2.3.7](#).

**3.2.2.2** In catamarans and similar ships, for which not less than two pumps are required in compliance with [Table 3.2.1.1](#), it is recommended that one pump be fitted in each hull.

In this case, water supply by each pump to the water fire main of any hull of the ship shall be ensured.

### **3.2.3 Basic requirements for fire pumps.**

**3.2.3.1** In all self-propelled ships, fixed fire pumps shall have an independent power source.

In cargo ships between 500 and 1000 gross tonnage, one of the pumps shall have an independent drive.

In passenger ships of less than 150 gross tonnage with the main propulsion machinery of power output less than 220 kW, the pumps driven by the main engine may be used provided that the propulsion unit (engine-shaft-propeller) is so designed as to permit of fire pump operation when the ship is not under way.

**3.2.3.2** Fixed fire pumps including an emergency pump may be used for other shipboard services, if the ship is provided with at least two independently driven pumps, one of which is at all times kept readily available for its direct purpose.

Where in conformity with [Table 3.2.1.1](#) only one fire pump is fitted, it may be used for other purposes requiring short-time consumption of water (flushing out of decks, hawse pipes etc.).

A fire pump may be used for emergency drainage of machinery spaces.

**3.2.3.3** In cargo ships where other pumps, such as general service, bilge, ballast, and etc., are fitted in a machinery space, provision shall be made to ensure that at least one of these pumps, having the capacity and pressure required by [3.2.1.11](#) and [Table 3.2.1.1](#), is capable to supply water to the fire main. However, if the ship is equipped with the required number of fire pumps of necessary capacity and pressure, then it is sufficient to have a connection of the general service pump with water fire main system. Such pumps shall meet the requirements of [3.2.3.2](#) and [3.2.3.4](#).

**3.2.3.4** Pumps and piping intended for fire-fighting purposes shall not be used for the pumping of oil and other flammable liquids, nor as ballast pumps for tanks used for alternate carriage of fuel oil and water ballast.

**3.2.3.5** Fire pumps shall be fitted with a pressure gauge on the discharge side.

Pumps capable of developing in the fire main hydrants and hoses a pressure exceeding the permissible value shall be provided with relief valves set to operate at a pressure not more than 10 % in excess of the fire main working pressure, and having the pipes to discharge water into the suction main. Location and adjustment of these valves shall prevent excessive pressure in any part of the fire main.

**3.2.3.6** Fixed fire pumps and their sea valves shall be located below the light-draught waterline of the ship. Where the pumps are located above the lowest possible waterline, efficient arrangements shall be made for self-priming.

A fixed emergency pump shall be installed in compliance with [3.2.4](#).

Fire pumps installed outside machinery spaces of category A shall have an independent sea valve in each compartment in which they are located.

In the case of ice class ships, at least one of the pumps shall be connected with the heated ice box (refer to 4.3.1.2, Part VIII "Systems and Piping").

**3.2.3.7** All pumps, including the emergency pump, shall be placed in spaces with positive temperature.

**3.2.3.8** In passenger ships of 1000 gross tonnage and upwards and in all passenger ships with periodically unattended machinery spaces containing fire pumps, the water fire main system shall constantly be under pressure providing immediate the supply of at least one effective water jet from any of fire hydrants and automatic start of one of the required fire pumps at a drop of pressure.

In passenger ships of less than 1000 gross tonnage, the water fire main system shall enable the automatic and remote start-up of at least one fire pump from the navigation bridge. If the pump starts automatically or if the bottom valve cannot be opened from location where the pump is remotely started, the bottom valve shall always be kept open.

**3.2.3.9** In cargo ships with a periodically unattended machinery space containing fire pumps or when only one person is required on watch provision shall be made for remote starting of one of the main fire pumps from the navigation bridge and from fire station if available and for immediate water supply in the fire main without additional opening of the valves in the pump room. At the location of such arrangement a water pressure indicator shall be installed.

Where water fire main system is under pressure as required in [3.2.3.8](#), remote starting need not be provided.

In ships of less than 1600 gross tonnage, fulfilment of this requirement may not be provided, if starting arrangement of the fire pump in machinery space is easily accessible.

**3.2.4 Fixed emergency fire pump.**

**3.2.4.1** The emergency pump shall be driven by a diesel engine or an electric motor supplied with power from the emergency source of power.

**3.2.4.2** The pump, its sources of power and sea connections shall be so located as not to be put out of action in the event of a fire within the spaces where the main fire pumps are located.

The emergency fire pump, its seawater inlet, and suction and delivery pipes and isolating valves shall be located outside the machinery space. If this arrangement cannot be made, the sea chest may be fitted in the machinery space if the sea inlet valve is remotely controlled from a position in the same compartment as the emergency fire pump and the suction pipe is as short as practicable. Short lengths of suction or discharge piping may penetrate the machinery space or compartments where main fire pumps are installed, provided they are enclosed in a substantial steel casing or are insulated to "A-60" class standards in accordance with IMO circular MSC.1/Circ.1456. The pipes shall have substantial wall thickness, but in no case less than 11 mm, and shall be welded except for the flanged connection to the sea inlet valve.

Location of the pump and its drive shall allow free access to them for maintenance and repair.

**3.2.4.3** Where the pump is located above the lowest possible waterline, efficient arrangements shall be made for self-priming.

Under all conditions of heel, trim, pitch and roll, likely to be encountered in the ship service, the total suction head and the net positive suction head shall provide the fulfilment of the requirement of [3.2.4.6](#).

The design conditions for fulfilment of these requirements are defined in IMO circular MSC.1/Circ.1388.

**3.2.4.4** The space containing the emergency fire pump shall not be contiguous to the boundaries of machinery spaces of category A or those spaces containing main fire pumps. Where this is not practicable, the common bulkhead between the two spaces shall comply with the requirements of [Table 2.3.3-1](#) for control stations.

When a single access to the emergency fire pump room is through another space adjoining a machinery space of category A or the spaces containing the main fire pumps, "A-60" class boundary is required between that other space and the machinery space of category A or the spaces containing the main fire pumps.

No direct access shall be permitted between the machinery space and the space containing the emergency fire pump and its source of power. When this is impracticable, an arrangement may be accepted where the access is by means of an air-lock where the door to the machinery space shall be made to "A-60" class and the second door shall be made at least of steel, each of the doors being self-closing and gastight, or through a watertight door capable of being operated from a space remote from the machinery space and the space containing the emergency fire pump and unlikely to be cut off in the event of fire in those spaces. In such cases a second means of access to the space containing the emergency fire pump and its source of power shall be provided.

No hold-back hooks are permitted for the above doors.

**3.2.4.5** Any diesel driven source of power supplying the emergency fire pump shall be easily started manually in cold condition at a temperature up to 0 °C. If this source of power is installed in unheated space, it shall be fitted with electrical means of cooling water or lubricating oil heating, which ensure its quick start. If manual start of this source of power is practically impossible, then on agreement with the Register starting arrangements or other compressed air, hydraulically or electrically driven starting mechanisms shall be used. These mechanisms shall be such as to provide starting of the source of power at least six times during half an hour and, at least twice during the first 10 min.

Service fuel tank for the pump drive shall contain fuel sufficient to ensure the pump operation at full load for not less than three hours. Besides, outside the machinery space of category A fuel stores shall be available sufficient to ensure the pump operation at full load for additional 15 h.

**3.2.4.6** The emergency fire pump capacity shall be not less than 40 % of the total required capacity of fire pumps determined according to [3.2.1.5](#), considering [3.2.1.2](#) and [3.2.1.7](#).

**3.2.4.7** The emergency fire pump capacity shall comply with [3.2.4.6](#).

Where a fixed pressure water-spraying system installed for the protection of the machinery space in accordance with [3.4](#) is supplied by the emergency fire pump, then the emergency fire pump capacity shall be adequate to supply the system at the required pressure plus two jets of water.

The capacity of the two jets shall be calculated for the largest nozzles used in the ship at not less than 25 m<sup>3</sup>/h. When determining the largest nozzles, the nozzles in the space where the main fire pumps are located may not be considered. The capacity of the fire pump with the nozzle diameter of 16 mm shall be 16 m<sup>3</sup>/h, the capacity of the pump with the nozzle diameter of 19 mm – 23,5 m<sup>3</sup>/h, accordingly, the pressure at hydrants being 0,27 MPa.

**3.2.4.8** Where the sea inlet valve is in the machinery space, measures shall be taken so that the valve can be opened in the event of fire.

### **3.2.5 Piping.**

**3.2.5.1** The diameters of the fire main and water service pipes shall be sufficient for the effective distribution of the maximum required discharge from two fire pumps operating simultaneously. In cargo ships the diameter need only be sufficient for the discharge of 140 m<sup>3</sup>/h.

In ships of 500 gross tonnage and upwards and floating cranes ([refer to 3.2.5.6](#)) the pipes of the fire main shall be rated at a working pressure of at least 1 MPa.



**3.2.5.2** To prevent freezing, the pipelines of the water fire main system extended to open decks or non-heated spaces shall be provided with shut-off fittings mounted in heated spaces, and with water drainage arrangements.

**3.2.5.3** Each fire pump shall be fitted with shut-off valves on the suction and discharge pipes.

The use of slide valves on the suction pipe is permitted.

In ships of 500 gross tonnage and upwards the valves on the discharge side of the pumps shall be of a non-return shut-off type.

**3.2.5.4** In oil tankers, the fire main shall comply with the following supplementary requirements:

**.1** in the fire main at the poop front in a protected position as specified in IMO circular MSC.1/Circ.1456 and in easily accessible places on the cargo oil tank deck, the isolation valves shall be fitted at intervals of not more than 40 m. Each of such valves shall be provided with an information plate to indicate that the valve shall be kept permanently open under normal service conditions;

**.2** before each isolation valve on the fire main there shall be fitted twin fire hydrants so located that they are equally spaced, over the length of the ship and the fulfilment of the requirements of [3.2.6.2](#) is ensured;

**.3** before the cut-off valve fitted in the poop there shall be a branch pipe on either side, led out from the fire main to the forward part of the poop deck; the diameter of each branch pipe shall be sufficient for supplying water through two fire hoses connected to two hydrants fitted at the end of each branch. Where fire pumps are fitted forward of the cargo tanks, two more similar pipes branching from the fire main of the same diameter as above shall be provided on the after part of the forecastle deck, an isolation valve being fitted on the fire main within the erection, after the branches.

**3.2.5.5** In catamarans and similar ships, each hull shall be provided with a water fire main system including water hydrants, hoses and nozzles.

**3.2.5.6** In all ships of 500 gross tonnage and upwards, and in floating cranes facilities shall be available on the open deck enabling an international shore connection to be used on either side of the ship ([refer to 5.1.18](#)).

**3.2.5.7** Isolating valve to separate the piping within the machinery space of category A containing the fire pump (or pumps) from the main outside it shall be fitted in piping in easily accessible position (outside the machinery space).

The fire main shall be so arranged that when the isolating valves are shut all the hydrants on the ship, except those fitted in the piping separated from water supply, can be supplied with water by another fire pump located outside the machinery space.

**3.2.5.8** On fishing vessels of 24 m in length and over, the fire mains shall have no connections other than those required for fire fighting, except for the purpose of washing the deck and anchor chains and operation of bilge ejectors, subject to the efficiency of the water fire main system being maintained.

### **3.2.6 Fire hydrants.**

**3.2.6.1** Each fire hydrant shall have a shut-off valve and a standard quick-acting coupling. Hydrants fitted on open decks shall also have quick-acting plugs, or equivalent device.

**3.2.6.2** The number and location of fire hydrants shall ensure at least the delivery of two water jets from different hydrants, one of the jets being delivered through a hose of standard length as stipulated under [5.1.4.1](#), to any area of the ship which is generally accessible to passengers and crew during the voyage and to any part of any cargo space that is empty, ro-ro cargo space and for special-category spaces — to any part of the space through standard length hoses. Besides, such hydrants shall be located near entrance to the protected spaces.

In passenger ships, the number and location of fire hydrants in the accommodation, service and machinery spaces shall be such that the above-mentioned requirement is met when all watertight doors and all doors in bulkheads of main vertical zones are closed.

On open decks for containers, two jets of water shall be delivered onto each accessible vertical side of the container by standard length hoses.

**3.2.6.3** It is not recommended that fire hydrants are located closer than 20 m from each other in the internal spaces and more than 30 m on open decks.

**3.2.6.4** Fire hydrants shall not be placed at the ends of dead-end corridors, in special electrical spaces or closed or rarely attended spaces.

**3.2.6.5** In ships, carrying deck cargoes fire hydrants shall be located to ensure easy access, while the pipes shall be located to avoid being damaged by cargo.

**3.2.6.6** In machinery space of category A at least two hydrants shall be provided.

**3.2.6.7** In all ships there shall be fitted a fire hydrant located in the forward part of the propeller shaft tunnels.

**3.2.6.8** All fire hydrants shall be painted red.

**3.2.6.9** In passenger ships two fire hydrants shall be provided in the shaft tunnel, being one of the means of escape, in the proximity to the machinery space of category A.

Where some other space is used as a means of escape, two fire hydrants shall be provided therein at the entrance to the machinery space of category A. Provision of [3.2.6.7](#) need not be met in this case.

**3.2.6.10** In spaces housing refrigerating machinery and spaces containing the process equipment working under pressure of Group II refrigerants, fire hydrants shall be provided in compliance with 3.1.5 and 3.5.2, Part XII "Refrigerating Plants".



### **3.3 SPRINKLER SYSTEM**

#### **3.3.1 General.**

**3.3.1.1** Automatic sprinkler systems shall be a wet pipe type, as specified by IMO circular MSC/Circ.1165. Upon agreement with the Register for small exposed sections, as well as at control stations, where water may cause damage to essential equipment, may be fitted with a dry pipe system or a pre-action system as permitted by IMO circular MSC/Circ.1165.

**3.3.1.2** A sprinkler system shall be automatically set in operation at temperatures in the protected space rising to the values indicated in [3.3.4.2](#).

**3.3.1.3** The automatic sprinkler system shall be kept charged at the necessary pressure and shall have provision for a continuous supply of water as required in the present Chapter.

**3.3.1.4** The air cylinder, compressor, pump and the pipes of the sprinkler system, except for the piping connecting the sprinkler system to the water fire main system, shall be independent of all other systems.

**3.3.1.5** A sprinkler pump and a pressure tank shall be arranged outside the protected space, at an adequate distance from the machinery spaces of category A. A gauge indicating the pressure in the system shall be provided at each section stop valve and at a central control station.

**3.3.1.6** Means shall be provided for testing the automatic operation of the sprinkler pump on reduction of pressure in the system.

**3.3.1.7** When sprinkler systems equivalent to the systems specified in this Chapter are used, they shall be approved by the Register according to the Guidelines adopted by IMO resolution A.800(19) considering amendments introduced by IMO resolutions MSC.265(84)/Corr.1 and MSC.284(86). When approving such systems special consideration shall be given to the fulfillment of the requirements of [3.3.1.1 — 3.3.1.6](#), [3.3.2](#), [3.3.3.1](#), [3.3.3.2](#), [3.3.4.2](#), [3.3.5](#) and [3.3.6](#).

#### **3.3.2 Sprinkler pumps.**

**3.3.2.1** An independent power pump shall be provided solely for the purpose of continuing automatically the discharge of water from the sprinklers. The pump shall be brought into action automatically by the pressure drop in the system before the standing fresh water charge in the pressure tank is completely exhausted.

**3.3.2.2** The pump and piping system shall be capable of maintaining the necessary pressure at the level of the highest sprinkler to ensure a continuous flow rate of water sufficient for the simultaneous coverage of the minimum floor area of 280 m<sup>2</sup> at the application rate specified in [3.3.4.1](#).

For application to a ship with a total protected area of less than 280 m<sup>2</sup>, the Register may specify the appropriate area for sizing of pumps and supply components.

**3.3.2.3** The pump shall be fitted on the delivery side with a test valve with a short open-ended discharge pipe. The effective area through the valve and pipe shall be adequate to permit the release of the required pump output while maintaining the pressure in the system specified in [3.3.3.2](#).

**3.3.2.4** The sea inlet to the pump shall wherever possible be in the space containing the pump and shall be so arranged that when the ship is afloat it will not be necessary to shut off the supply of sea water to the pump for any purpose other than the inspection or repair of the pump.

**3.3.2.5** Provision shall be made for connection of the main supply piping with the ship's fire main. A lockable non-return shut-off valve shall be fitted at the connection concerned.

**3.3.2.6** There shall be not less than two sources of power for the pumps. Where the sources of power are electrical, the pump shall be supplied according to 4.3.1.5, 19.1.1.1, 19.1.1.2 and 19.1.2.1.7, Part XI "Electrical Equipment".

One of the sources of power for the pump may be an internal combustion engine which shall be so situated (besides compliance with the instructions of [3.3.1.5](#)) that a fire in any protected space will not affect the air supply to the machinery.

**3.3.3 Pressure tank.**

**3.3.3.1** The pressure tank shall be fitted with:

- .1 an automatic pressure maintaining device;
- .2 glass gauge;
- .3 a relief valve;
- .4 a pressure gauge.

**3.3.3.2** The pressure tank shall contain a standing charge of fresh water equivalent to the volume of water which would be discharged in one minute by the sprinkler pump.

The volume of the pressure tank shall be equal to at least twice that of the charge of water specified above.

Arrangements shall be made for maintaining such air pressure in the tank as to ensure that where the perennial supply of fresh water in the tank has been used the pressure in that tank is not less than a working pressure at the sprinkler plus a hydrostatic pressure from the tank bottom to the highest sprinkler.

Suitable means of replenishing the air under pressure and of replenishing the fresh water charge in the tank shall be provided. Means shall be also provided to prevent the passage of sea water into the tank.

**3.3.3.3** Pneumatic pressure tanks shall comply with the requirements for pressure vessels set out in Part X "Boilers, Heat Exchangers and Pressure Vessels".

**3.3.4 Sprinklers.**

**3.3.4.1** Sprinklers shall be placed in an overhead position and spaced in a suitable pattern to maintain an average application rate of not less than 5 l/min per 1 m<sup>2</sup> over the horizontal area of the protected space.

The Register may permit the use of other application rate depending on structural features of the protected space.

While protecting windows by sprinklers, the requirements of [2.2.4.4](#) shall be met.

**3.3.4.2** The sprinklers shall be resistant to corrosion by marine atmosphere. In accommodation and service spaces the sprinklers shall come into operation within the temperature range from 68 to 79 °C, except that in locations such as drying rooms where high ambient temperatures might be expected, the operation temperature may be increased by not more than 30 °C above the maximum deckhead temperature. In saunas, provision shall be made for empty sprinkler systems with the upper operating limit of 140 °C. Refrigerated chambers may be fitted with dry pipe sprinkler systems.

**3.3.5 Control valves.**

**3.3.5.1** Each section of sprinklers shall include means for giving a visual and audible alarm signal automatically at one or more indicating units whenever any sprinkler comes into operation. Such alarm systems shall be such as to indicate if any fault occurs in the system. Such units shall indicate in which section served by the system a fire has occurred and shall be centralised on the navigation bridge or in the continuously manned control station and, in addition, visible and audible alarms from the unit shall also be placed in a position other than on the aforementioned spaces to ensure that the indication of fire is immediately received by the crew.

**3.3.5.2** Switches shall be provided at one of the indicating positions referred to in [3.3.5.1](#) which will enable the alarm and the indicators for each section of sprinklers to be tested. A list or plan shall be displayed at each indicating unit showing the spaces covered and the

location of the zone in respect of each section. Suitable instructions for testing and maintenance shall be available.

**3.3.5.3** A test valve shall be provided for testing the automatic alarm for each section of sprinklers by a discharge of water equivalent to the operation of one sprinkler. The test valve for each section shall be situated near the stop valve for that section.

**3.3.6 Pipes.**

**3.3.6.1** Sprinklers shall be grouped into separate sections, each of them shall contain not more than 200 sprinklers. In passenger ships, any section of sprinklers shall not serve more than two decks and shall not be situated in more than one main vertical zone. However, the Register may permit such section of sprinklers to serve more than two deck or be situated in more than one main vertical zone, provided it shall not reduce, on the Register opinion, the fire protection of the ship.

**3.3.6.2** Provision shall be made in each section for purging the pipes with compressed air and flushing them with fresh water.

**3.3.6.3** Each section of sprinklers shall be capable of being isolated by one stop valve only after which a gauge shall be provided.

The stop valve in each section shall be readily accessible in a location outside of the associated section or in cabinets within stairway enclosures. The valve's location shall be clearly and permanently indicated.

Measures shall be taken to preclude unauthorized persons from operating the shut-off valves.

**3.3.6.4** The suction pipes of the pumps feeding a sprinkler system shall be fitted with filters.

**3.3.6.5** The diameters of the pipes of a sprinkler system shall be such as to ensure the operation of sprinklers at the water pressure and the rate of discharge specified in [3.3.2.2](#) and [3.3.4.1](#).

**3.3.6.6** The pipelines of the sprinkler system shall be fitted with non-return shut-off valves preventing sea water from penetrating into the pressure tank and the leakage of water from the tanks and the system.

### 3.4 PRESSURE WATER-SPRAYING SYSTEM

**3.4.1** In machinery spaces of category A as well as in cargo pump rooms specified in [1.5.7.1](#) pressure water-spraying system shall be supplied from an independent pump, which shall be automatically put into action by a pressure drop in the system and from the fire main. A non-return shut-off valve shall be fitted on the connection line with the fire main.

Where automatic release of system sections is provided, their manual release shall be provided as well.

The pressure water-spraying system for ro-ro cargo spaces, vehicle spaces (refer to [1.5.4.3](#) and [1.5.4.4](#)) and special category spaces ([refer to 1.5.9](#)) shall comply with the provisions of IMO circular MSC.1/Circ.1430/Rev.2 "Revised Guidelines for the Design and Approval of Fixed Water-Based Fire-Fighting Systems for Ro-Ro Spaces and Special Category Spaces". Such system shall protect all portions of any deck and sites for vehicles in the specified spaces, shall have manual control and pressure gauge at every distribution box with clear marking indicating protected spaces, as well as suitable maintenance and service instructions located at the valves section. Considering a substantial loss of stability, which may occur due to large concentration of water on decks of specified spaces during system operation, measures shall be provided as stipulated in 7.6.12, Part VIII "Systems and Piping".

Where high-pressure water-spraying system is used, the necessity for the reserve supply for such system shall be determined in each case on agreement with the Register, the rate of water supply shall be provided not less than specified in [3.4.2.1](#).

**3.4.2** The number and arrangement of the nozzles shall be such as to ensure an effective average distribution of water in the spaces to be protected of not less than:

**.1** 5 l/min per 1 m<sup>2</sup> of the horizontal area over which fuel oil is likely to spread or cargo space area;

**.2** 1,5 l/min per 1 m<sup>2</sup> of the largest horizontal cross-sectional area of the fish meal hold.

In cargo, working and special spaces, where the system may be divided into sections, the pump shall be capable of supplying two sections of the total length of at least 40 m.

**3.4.3** In machinery spaces of category A of ships specified and in cargo pump rooms in [1.5.7.1](#) the pressure water-spraying system shall be kept charged under the required pressure up to the valves on the distribution pipes. The pump supplying the water for the system shall be put automatically into action by a pressure drop in the system.

**3.4.4** Filters preventing the system and spray nozzles from becoming clogged shall be fitted on the suction pipe of the pump supplying the system and on the connection pipe with the fire main.

**3.4.5** Distribution valves shall be placed in easily accessible positions outside the protected spaces so as not to be readily cut off by a fire in the protected space.

Provision shall be made in the protected spaces, where people are permanently present, for remote control of distribution valves from these spaces.

**3.4.6** Spray nozzles shall be placed in the protected spaces as follows:

**.1** underneath the ceiling of the space;

**.2** above equipment and machinery using fuel oil or other flammable liquids and other fire hazardous objects;

**.3** above bilges, double bottom floor coverings and other surfaces over which fuel oil or flammable liquids are likely to spread;

**.4** above stacks of fish meal bags.

The spray nozzles shall be so disposed in the protected space that the area covered by one nozzle will overlap that covered by adjacent nozzles.

**3.4.7** Pump of the system providing protection of category A machinery spaces and cargo pump rooms shall ensure a supply of water at the required pressure to all sections of the system in any compartment to be protected. The pump and its controls shall be installed outside the spaces to be protected.

The pump may be driven by independent internal combustion machinery which shall be so situated that a fire in the protected space will not affect the air supply to the machinery. If the pump is electrically driven from the emergency generator, the generator shall comply with the requirements of Section 9, Part XI "Electrical Equipment".

**3.4.8** Average rate of water supply specified in [3.4.2](#), shall be increased for the following spaces:

**.1** 20 l/min per 1 m<sup>2</sup> for boilers frontal parts and surfaces, fuel oil units, centrifugal separator (other than bilge water separators), and fuel filters;

**.2** 10 l/min per 1 m<sup>2</sup> for pipelines of heated fuel located near the exhaust pipes or similar heated surfaces of main and auxiliary diesel engines;

**.3** in accordance with Tables 4-1, 4-2 and 4-3 of IMO circular MSC.1/Circ.1430/Rev.2 for ro-ro and special category spaces.

**3.4.9** Fixed pressure water-spraying system of an approved type complying with the provisions of IMO circular MSC.1/Circ.1268 "Guidelines for the Approval of Fixed Pressure Water-Spraying and Water-Based Fire-Extinguishing Systems for Cabin Balconies" shall be installed to protect cabin balconies of passenger ships where furniture and furnishings on such balconies are not as defined in [2.1.1.9](#).

### **3.5 WATER-SCREEN SYSTEM**

**3.5.1** These Rules provide for the use of the water-screen system in the following cases:

- .1** in special purpose ships where, subject to special agreement with the Register, water screens are permitted in lieu of "A" class divisions, in accordance with [2.2.1.2](#);
- .2** for protection of vertical surfaces of ships' hull in compliance with [6.6.6](#).

**3.5.2** The design capacity of the pumps supplying the water-screen system shall be sufficient to provide at least 70 l/min per linear meter of the screen length.

### **3.6 DRENCHING SYSTEM**

**3.6.1** These Rules provide for the use of water drenching system for drenching the racks of magazines (refer to [6.2.2.18](#) and [Table 3.1.2.1](#)), as well as for protection of pressure vessels on ships fitted with fixed diving system (refer to 3.2.2, Part V "Fire Protection" of the Rules for the Classification and Construction of Manned Submersibles and Ship's Diving Systems).

**3.6.2** The drenching system shall be fed from the fire main. The pumps and associated sources of power shall be placed outside the space protected.

**3.6.3** The system shall be started from outside the space.

It is recommended that the system shall be put into action at a temperature rise in the space above admissible.

**3.6.4** The drenching system of magazines and the pressure water-spraying system of the cargo spaces fitted for the carriage of explosives may be used for their flooding in emergency only together with the water fire main system fitted for this purpose.

**3.6.5** The capacity of the pumps supplying the system shall be sufficient to ensure the following rates of water discharge for drenching magazine racks, 36 l/min per 1 m<sup>2</sup> of the total magazine floor area.

### **3.7 FOAM FIRE EXTINGUISHING SYSTEM**

#### **3.7.1 General.**

**3.7.1.1** The foam fire extinguishing systems shall be capable to produce air mechanical foam for the use as an extinguishing medium suitable for extinguishing an oil fire depending on the foam expansion ratio:

of low expansion ratio (about 10:1 but not more than 12:1);

of medium expansion ratio (between 21:1 and 200:1);

of high expansion ratio (not more than 1000:1).

Foam fire extinguishing systems may include units separately producing, but simultaneously supplying low expansion ratio foam and medium expansion ratio foam (combination foam).

**3.7.1.2** Use shall be made of foam concentrates of types approved by the Register (refer to 1.3.3.1).

A foam concentrate for generating low expansion foam shall be approved in accordance with the provisions of IMO circular MSC.1/Circ.1312, considering the amendments introduced by MSC.1/Circ.1312/Corr.1.

A foam concentrate for generating medium expansion foam shall be approved in accordance with the provisions of IMO circular MSC/Circ.798.

A foam concentrate for generating high expansion foam shall be approved in accordance with the provisions of IMO circular MSC/Circ.670.

A foam concentrate for generating low expansion and medium expansion foam shall be capable of being used both with fresh water and sea water.

**3.7.1.3** The capacity of foam fire extinguishing systems and the quantity of a foam concentrate shall be calculated depending on the foam expansion ratio, foam solution supply rate and operation time of the system given in [Table 3.7.1.3](#) and in [3.7.2.1](#).

Operation of a deck foam system at its required output shall permit the simultaneous use of the minimum required number of jets of water at the required pressure from the fire main, in compliance with the requirements for water fire main system, which shall be possible on deck over the full length of the ship, in the accommodation, service spaces, control stations and machinery spaces.

**3.7.1.4** Tanks for the storage of foam concentrate shall be fitted with arrangements for filling and draining, a device for watching the level of the liquid and a manhole for cleaning and inspecting. The tanks shall be of sufficient capacity to contain the full required amount of foam concentrate.

If no excessive pressure is required to be created in tanks during the system operation, non-return valves shall be fitted between such tanks and the fire main.

Where a foam concentrate using fresh water is utilized in the high expansion foam system, at fire extinction station there shall be the reserve of water sufficient for at least single foam fill up of the protected space of the largest volume. The remainder of the water may be supplied from ship's storage tanks. Equipment (pumps, fittings, etc.) necessary for supplying fresh water to the tank shall be arranged outside the protected space, be fed from the emergency diesel-generator and have a capacity sufficient to ensure continuous operation of the system as required in [Table 3.7.1.3](#).

**3.7.1.5** The mixers for making aqueous solution of a foam concentrate of the required concentration shall be of an approved type. The mixers shall ensure operation of simultaneously used foam nozzles and/or foam generators.



Table 3.7.1.3

Spaces	Foam solution supply rate, in l/min per 1 m <sup>2</sup> , with the foam expansion ratio			Rated time of continuous operation, in min
	low expansion	medium expansion <sup>1)</sup>	high expansion	
Cargo oil tanks and cargo tank deck	6 <sup>2)</sup>			
	0,6	6 <sup>3)</sup>	—	20 <sup>4)</sup> /30
	3			
Tanks for oil products with a flash point 60°C and above (fuel oil tanks)	6 <sup>3)</sup>	4,5 <sup>3)</sup>	—	20
Dry cargo holds	—	4 <sup>3)</sup>	—	45
Machinery spaces and other spaces whose equipment is oil-fired	—	—	1 <sup>3)</sup>	— <sup>5)</sup>
Paint lockers, storerooms for flammable liquids, flammable liquefied and compressed gases	—	4,5 <sup>3)</sup>	—	20
Hangars for helicopters, enclosed garages, as well as spaces listed in 1.5.4.3 and 1.5.8.1	—	—	— <sup>6)</sup>	45
Helidecks <sup>7)</sup>	— <sup>7)</sup>	— <sup>7)</sup>	— <sup>7)</sup>	— <sup>7)</sup>

<sup>1)</sup> The solution supply rates apply to combination-foam production as well.

<sup>2)</sup> The rate of solution supply shall not be less than the greatest of the following:

.1 6 l/min per square metre of the horizontal sectional area of the single tank having the largest such area;

.2 0,6 l/min per square metre of cargo tanks deck area, where cargo tanks deck area means the maximum breadth of the ship multiplied by the total longitudinal extent of the cargo tank spaces;

.3 3 l/min per square metre of the area protected by the largest monitor, such area being entirely forward of the monitor but not less than 1250 l/min.

<sup>3)</sup> For the area of the largest horizontal section of the largest protected space.

<sup>4)</sup> Sufficient foam concentrate shall be supplied to ensure at least 20 min of foam generation in oil tankers fitted with an inert gas system and 30 min in oil tankers not fitted with an inert gas system using largest rate of solution supply stipulated in Footnote 1.

<sup>5)</sup> Sufficient foam concentrate shall be supplied to ensure foam generation in the volume equal to 5-fold volume of the largest protected space. Foam expansion ratios shall not exceed 1000:1.

<sup>6)</sup> The rate of solution supply shall be sufficient for filling of the protected space volume during 15 min.

<sup>7)</sup> For foam solution supply rate refer to 6.4.1.2, Part XVII "Distinguishing Marks and Descriptive Notations in the Class Notation Specifying Structural and Operational Particulars of Ships".

**3.7.1.6** The main control station of the fixed deck system shall be located in the fire extinction station outside the cargo spaces in the vicinity of accommodation spaces and be easily accessible and ensure control of the system in the event of fire in protected areas. Sampling device for measurement of the percentage of foam concentrate in a solution shall be fitted at the fire extinction station on the fire main at a maximum distance from mixers, the pressure gauge shall be fitted on the pipe supplying water to the system.

The main equipment of the deck system (tanks with a foam concentrate, pumps, mixers, etc.) may be located in the engine room.

**3.7.1.7** Deck foam systems applied by a common line from the fire main may be used onboard provided that the foam applicators can be effectively operated by one person when fire extinguishing medium is supplied at a pressure required for monitors. Additional foam concentrate shall be provided for 2 nozzles operation during the period of time according to [Table 3.7.1.3](#).

**3.7.1.8** Fire safety of the enclosed pipe trunk situated within the cargo tanks deck area shall comply with the requirements of IMO circular MSC.1/Circ.1276.

### **3.7.2 Fixed deck systems.**

**3.7.2.1** The expansion ratio of the foam generated by the system shall not generally be greater than 12:1. If the system generates actually low expansion foam with expansion ratio slightly in excess of 12:1, the quantity of the foam concentrate shall be calculated as for the system with foam expansion ratio 12:1. Where the system generates the foam with expansion ratio somewhat below 12:1, the quantity of the foam concentrate shall be proportionally increased.

The system shall be capable of discharging through fixed discharge outlets in no more than 5 min, a quantity of foam sufficient to produce an effective foam blanket over the largest single area over which fuel oil is liable to spread.

Where medium expansion ratio foam is used in oil tankers, the amount of the foam concentrate shall be not less than the rated quantity and sufficient for the operation of the rated number of the foam generators and one monitor during 10 min.

**3.7.2.2** On oil tankers foam shall be supplied by means of monitors and portable foam generators or air-foam nozzles (refer to [5.1.6](#) and [5.1.19](#)) to the entire cargo deck area and to any cargo tank whose deck was ruptured. The number and location of the foam main hydrants shall be such as to ensure foam supply to any part of the cargo tanks deck from at least two portable foam generators or air-foam nozzles.

The number of air-foam nozzles shall be sufficient to provide maneuverability during fire fighting and protect areas screened from the monitors.

**3.7.2.3** At least 50 % of the foam solution supply rate required in [.1](#) and [.2](#) of Footnote 2 to Table 3.7.1.3 shall be delivered from each monitor.

In ships of less than 4000 t deadweight only portable foam generators or air-foam nozzles may be employed. However, in such a case the capacity of each generator according to [5.1.19](#) or nozzle according to [5.1.6.1](#) shall be at least 25 % of the foam solution supply rate required in [.1](#) and [.2](#) of Footnote 2 to Table 3.7.1.3.

**3.7.2.4** The number and position of monitors shall be such as to comply with [3.7.2.2](#), [3.7.2.6](#) and [3.7.2.8](#). The solution-delivering capacity of any monitor shall not be less than indicated in [.3](#) of Footnote 2 to Table 3.7.1.3.

**3.7.2.5** It is recommended that a monitor shall be provided with a changing-over device for alternate supply of water and foam. Pipes branching from the fire main and foam solution supply piping shall be connected to the changing-over device.

In lieu of the changing-over device suitably inter-locked shut-off valves may be fitted.

**3.7.2.6** The distance from the monitor to the farthest extremity of the protected area forward of that monitor shall be not more than 75 % of the monitor throw in still air conditions.

**3.7.2.7** The foam fire main as well as water fire main if it is an integral part of the deck fire extinguishing system in easily accessible places of the cargo deck shall be fitted with isolation sluice or disc valves spaced not more than 40 m apart forward of each monitor to isolate damaged sections of these fire mains. Next to each of such valves there shall be provided an information plate to indicate that the valve shall be kept permanently open under normal service conditions.

Before each isolation valve fitted on the foam piping there shall be twin fire hydrants for coupling thereto fire hoses with air-foam nozzles located at such distance that the requirements of [3.2.6.2](#) are met.

Branches from the fire main and foam piping to the monitors shall also be fitted before the isolation valves.

Where medium expansion foam is used, twin fire hydrants shall be substituted by valve chests with a number of fire hydrants equal to 50 % of the required number of foam generators.

**3.7.2.8** In oil tankers, each foam fire extinction station shall be provided with a shut-off device located on the foam fire main before it extends beyond the boundaries of the station.

Before the shut-off device there shall be a branch led out to the monitors situated both port and starboard at the front of the poop or accommodation spaces facing the cargo tanks deck and to twin fire hydrant for coupling thereto fire hoses with air-foam nozzles. The monitors may be located in the cargo area above the fuel oil tanks (oil bunker tanks) adjacent to cargo tanks if capable of protecting the deck below and aft of each other.

For oil tankers of less than 4000 t deadweight, it is sufficient to provide only branch pipes to the said fire hydrants.

Where medium expansion foam is used, twin fire hydrants shall be substituted by valve chests with a number of fire hydrants equal to 50 % of the required number of foam generators.

**3.7.2.9** Foam fire extinguishing system for dry cargo spaces shall meet the following requirements:

- .1** a shut-off valve shall be fitted where the foam fire main is led out to the open deck;
- .2** provision shall be made for valve chests with fire hydrants to be fitted on the foam fire main on both sides. The distance between the valve chests of either side shall not exceed 40 m. The number of fire hydrants in each valve chest shall be equal to 50 % of the required number of foam generators.

**3.7.2.10** If a ship is provided with a fixed low and/or medium expansion foam system, there shall be provided branches from solution pipe line to entrances from the upper deck to machinery spaces as also to the fuel oil filling positions. Each branch shall be fitted with two hydrants for coupling thereto fire hoses with air-foam nozzles or foam generators.

**3.7.2.11** In ships where medium expansion mechanical foam is used, solution piping shall be connected to fire main to provide for the possibility of application of such foam for extinction of fires in accommodation and service spaces through the fire main. For this purpose provision shall be made for an appropriate number of portable foam generators at hydrants in accommodation and service spaces.

**3.7.2.12** Helideck or helicopter landing area fixed foam fire extinguishing system on ships and FOP shall meet the requirements of 6.4.1, Part XVII "Distinguishing Marks and Descriptive Notations in the Class Notation Specifying Structural and Operational Particulars of Ships".

### **3.7.3 Fixed high expansion foam fire extinguishing system.**

#### **3.7.3.1 General.**

**3.7.3.1.1** The system shall be of approved type and capable of fire extinction and tested based on the procedure in Appendix 1 of IMO circular MSC.1/Circ.1384.

**3.7.3.1.2** The system shall be capable of manual release. It shall be designed to produce foam at the required application rate within 1 min of release. Automatic release of the system shall not be permitted unless appropriate operational measures or interlocks are provided to prevent any local application systems or other systems from interfering with the effectiveness of the system.

**3.7.3.1.3** The system and its components shall be suitably designed to withstand ambient temperature changes, vibration, humidity, shock, clogging and corrosion normally encountered on ships, which shall be approved based on test results in compliance with the requirements of Appendix 2 to IMO circular MSC.1/Circ.1384. Piping, fittings and related components inside the protected spaces (except gaskets) shall be designed to withstand 925 °C.

**3.7.3.1.4** System piping, foam concentrate storage tanks, other system components, pipe fittings and valves in contact with the foam concentrate shall be compatible with the foam concentrate and be constructed of corrosion resistant materials such as stainless steel, or equivalent. Other system piping and foam generators shall be full galvanized steel or equivalent.

**3.7.3.1.5** Means shall be provided for the crew to safely check the quantity of foam concentrate and take periodic control samples for foam quality. Means for testing the operation of the system and assuring the required pressure and flow shall be provided by pressure gauges at both inlets (water and foam concentrate supply) and at the outlet of the foam proportioner. A test valve shall be installed on the distribution piping downstream of the foam proportioner, along with orifices which reflect the calculated pressure drop of the system. Distribution pipework shall have self-draining capability and all sections of piping shall be provided with connections for flushing, draining and purging with air. All nozzles shall be able to be removed for inspection in order to prove clear of debris.

**3.7.3.1.6** Operating instructions for the system shall be displayed at each operating position. Besides, installation, operation and maintenance instructions/plans for the system shall be supplied to the ship and be readily available on board. The above instructions shall be in English and the working language of the crew.

**3.7.3.1.7** If an internal combustion engine is used as a prime mover for the sea water pump for the system, the fuel oil tank to the prime mover shall contain sufficient fuel to enable the pump to run on full load for at least 3 h. Sufficient reserves of fuel shall be available outside the machinery space of category A to enable the pump to be run on full load for an additional 15 h. If the fuel tank serves other internal combustion engines simultaneously, the total fuel tank capacity shall be adequate for all connected engines.

**3.7.3.1.8** The arrangement of foam generators and piping in the protected space shall not interfere with access to the installed machinery for routine maintenance activities.

**3.7.3.1.9** The system source of power supply, foam concentrate supply and means of controlling the system shall be readily accessible and simple to operate, and shall be arranged at positions outside the protected space not likely to be cut off by a fire in the protected space. All electrical components directly connected to the foam generators shall have at least an IP 54 rating.

**3.7.3.1.10** The foam generator room shall be ventilated to protect against overpressure, and shall be heated to avoid the possibility of freezing. The foam generators of the outside air foam system shall be located where an adequate amount of fresh air supply can be arranged in compliance with its specification.

**3.7.3.1.11** The quantity of foam concentrate available shall be sufficient to produce a volume of foam equal to at least five times the volume of the largest protected space enclosed by steel bulkheads, at the nominal expansion ratio, or enough for 30 min of full operation for the largest protected space, whichever is greater.

**3.7.3.1.12** Machinery spaces, cargo pump-rooms, vehicle spaces, ro-ro spaces and special category spaces shall be provided with audible and visual alarms within the protected space warning of the release of the system. The alarms shall operate for the length of time needed to evacuate the space, but in no case less than 20 s.

**3.7.3.2** Systems for the protection of machinery spaces and cargo pump-rooms.

**3.7.3.2.1** The system shall be supplied by both main and emergency sources of power in compliance with 4.3.1, 9.3 and 19.1.2 of Part XI "Electrical equipment". The emergency power supply shall be provided from outside the protected space.

**3.7.3.2.2** Sufficient foam-generating capacity shall be provided to ensure the minimum design filling rate for the system is met and in addition shall be adequate to completely fill the largest protected space within 10 min. Where such a machinery space includes a casing (e.g. a machinery space of category A containing internal combustion machinery, and/or a boiler, with an engine casing), the volume of such casing, above the level up to which foam shall be filled to protect the highest positioned fire risk objects within the machinery space, need not be included in the volume of the protected space. The level up to which foam shall be filled to protect the highest positioned fire risk objects within the machinery space shall not be less than:

1 m above the highest point of any such object; or  
the lowest part of the casing, whichever is higher.

Fire risk objects include, but may not be limited to, those listed in the definitions of "Machinery spaces of category A" and "Fuel oil unit" in 1.2 Part VII "Machinery Installations". Although not referred to in those definitions, they may also include items having a similar fire risk such as exhaust gas boilers or oil fuel tanks.

**3.7.3.2.3** The arrangement of delivery ducts of the outside air foam system/foam generators of the inside air foam system shall in general be designed based on the approval test results in compliance with [3.7.3.1.1](#). A minimum of two generators/ducts shall be installed in every space containing combustion engines, boilers, purifiers, and similar equipment. Small workshops (working spaces) and similar spaces listed in [1.5.3.2.2](#) and [1.5.8.1](#), may be covered with only one foam generator/foam delivery duct.

**3.7.3.2.4** Foam delivery ducts of the outside air foam system/foam generators of the inside air foam system shall be uniformly distributed under the uppermost ceiling in the protected spaces including the engine casing. The number and location of foam generators shall be adequate to ensure all high fire risk areas are protected in all parts and at all levels of the spaces. Extra foam delivery ducts/foam generators may be required in obstructed locations. The foam delivery ducts/foam generators shall be arranged with at least 1 m free space in front of the foam outlets, unless tested with less clearance. The foam delivery ducts/foam generators shall be located behind main structures, and above and away from engines and boilers in positions where damage from an explosion is unlikely.

**3.7.3.2.5** The arrangement of the foam delivery ducts of the outside air foam system shall be such that a fire in the protected space will not affect the foam-generating equipment. If the foam generators are located adjacent to the protected space, foam delivery ducts shall be installed to allow at least 450 mm of separation between the generators and the protected space, and the separating divisions shall be class "A-60" rated.

**3.7.3.2.6** Foam delivery ducts shall be constructed of steel having a thickness of not less than 5 mm. In addition, stainless steel dampers (single or multi-bladed) with a thickness of not less than 3 mm shall be installed at the openings in the boundary bulkheads or decks between the foam generators and the protected space. The dampers shall be automatically operated (electrically, pneumatically or hydraulically) by means of remote control of the foam generator related to them. The dampers shall be arranged to remain closed until the foam generators begin operating.

**3.7.3.3** Systems for the protection of vehicle, ro-ro, special category and cargo spaces.

**3.7.3.3.1** The system shall be supplied by the ship's main power source.

**3.7.3.3.2** Sufficient foam-generating capacity shall be provided to ensure the minimum design filling rate for the system, determined during approval testing in accordance with [3.7.3.1.1](#), is met and in addition shall be adequate to completely fill the largest protected space within 10 min. However, for systems protecting vehicle and ro-ro spaces and special category spaces, with decks that are reasonably gas-tight and that have a deck height of 3 m

or less, the filling rate shall be not less than two thirds of the design filling rate determined during approval testing in accordance with [3.7.3.1.1](#) and in addition sufficient to fill the largest protected space within 10 min.

**3.7.3.3.3** The system may be divided into sections. However, the capacity and design of the system shall be based on the protected space demanding the greatest volume of foam. Adjacent protected spaces need not be served simultaneously if the boundaries between the spaces are "A" class divisions.

**3.7.3.3.4** A minimum of two foam delivery ducts of the outside air foam system/foam generators of the inside air foam system shall be installed in every space. The arrangement of foam delivery ducts/foam generators shall in general be designed based on the approval test results and be arranged to uniformly distribute foam in the protected spaces, and the layout shall take into consideration obstructions that can be expected when cargo is loaded on board. As a minimum, ducts/generators shall be led to/located on every second deck, including movable decks. The horizontal spacing of the ducts/generators shall ensure rapid supply of foam to all parts of the protected space. This shall be established on the basis of full scale tests.

**3.7.3.3.5** The foam delivery ducts/foam generators shall be arranged with at least 1 m free space in front of the foam outlets, unless tested with less clearance.

**3.7.3.3.6** The design and arrangement of outside air foam fire extinguishing systems shall be in compliance with [3.7.3.2.5](#) and [3.7.3.2.6](#).

**3.7.3.4** Systems using outside air with generators installed inside the protected space.

**3.7.3.4.1** To protect spaces specified in [3.7.3.2](#) and [3.7.3.3](#), the fixed high expansion foam fire extinguishing systems with foam generators using outside air but with generators located inside the protected space and supplied by fresh air ducts may be applied. Such systems shall be equivalent to the outside air foam systems.

**3.7.3.4.2** For acceptance, the following minimum design features shall be considered:

- .1 lower and upper acceptable air pressure and flow rate in supply ducts;
- .2 function and reliability of damper arrangements;
- .3 arrangements and distribution of air delivery ducts including foam outlets; and
- .4 separation of air delivery ducts from the protected space.



### 3.8 CARBON DIOXIDE SMOTHERING SYSTEM

#### 3.8.1 General.

**3.8.1.1** The amount of carbon dioxide, in kg, shall be determined by the formula

$$G = 1,79V\varphi \quad (3.8.1.1)$$

where  $V$  = rated volume of the protected space (refer to [3.1.2.2](#), [3.1.2.5](#)), in m<sup>3</sup>;  
 $\varphi$  = factor equal to:  
 0,3 for dry cargo holds and other spaces, except those indicated below;  
 0,35 for machinery spaces, the rated volume of which is determined with regard to the full volume of casings;  
 0,4 for machinery spaces, the rated volume of which is determined without any regard to the volume of casings from the level at which the horizontal area of the casings is equal to, or less than, 40 % of the horizontal cross sectional area of the space itself measured in the middle between the floor covering of the inner bottom and the trunk bottom and storerooms specified in [1.5.3.2.2](#) (refer also to [Footnote 3](#) to Table 3.1.2.1);  
 0,45 for vehicles spaces and ro-ro spaces which are not special category spaces and are capable of being sealed, and for which at least two thirds of the gas required for the relevant space shall be introduced within 10 min.

For machinery spaces such value of the factor  $\varphi$  shall be taken which results in a greater value  $G$ . In ships of less than 2000 gross tonnage, except for passenger ships, factors 0,35 and 0,4 may be reduced to 0,3 and 0,35, respectively, if two or more machinery spaces, which are not fully separated from each other, are considered as forming one space.

**3.8.1.2** Where a carbon dioxide smothering piping is used as a smoke detection one, the carbon dioxide distributing manifold may be placed together with the CO<sub>2</sub> release controls for each space protected by the smoke detection system near its detecting units. However, it is recommended that the provision of such manifold shall not preclude the possibility of discharging CO<sub>2</sub> into any of the protected spaces directly from the fire extinction station, if two or more machinery spaces, which are not fully separated from each other, are considered as forming one space.

**3.8.1.3** The total cross-sectional area of manifolds and the cross-section of the distributing manifold shall be not more than the sum of the cross-sections of the cylinder valves simultaneously opening for the largest by volume protected space (for high-pressure systems) and not more than the cross-section of the tank discharge valve (for low-pressure systems).

**3.8.1.4** The cross-sections of distributing pipes for individual protected spaces shall be not more than the sum of the cross-sections of cylinder discharge valves simultaneously opening for the space concerned (for high-pressure system) or not more than the cross-section of the tank discharge valve (for low-pressure systems). The sum of the cross-sections of the discharge pipes shall not exceed the cross-section of the supply pipe except where the calculated pressure drop in any pipe cross section is not less than 1 MPa.

**3.8.1.5** The supply of 85 % of the rated amount of carbon dioxide within not more than 2 min shall be ensured for machinery spaces.

For container and general cargo spaces (primarily intended to carry a variety of cargoes separately secured or packed) as well as for spaces specified in [1.5.4.3.1](#) and [1.5.4.4.1](#), at least two thirds of the gas shall be discharged into the space within 10 min. For solid bulk cargo spaces, at least two thirds of the gas shall be discharged into the space within 20 min. The system controls shall be arranged to allow one third, two thirds or the entire quantity of gas to be discharged based on the loading condition of the hold.

**3.8.1.6** The thickness of pipe walls shall be calculated in accordance with 2.3, Part VIII "Systems and Piping"; in this case, the design pressure  $p$  is assumed as equal to the design pressure of cylinders and tankers according to [3.8.2.1](#) and [3.8.3.1](#) and shall be not less than the values specified in Table 2.3.8 of the above Part.

**3.8.1.7** Carbon dioxide shall be supplied to the protected spaces through nozzles arranged in the upper part of these spaces. The piping for the distribution of fire extinguishing medium shall be arranged and discharge nozzles so positioned that a uniform distribution of carbon dioxide is obtained which shall be confirmed by a hydraulic calculation. Where the floor plates of the machinery spaces of category A are placed higher than one meter above the tank top, a number of nozzles (about 15 % of the total number) shall be fitted in the upper portion of the space below the plates.

**3.8.1.8** The total sectional area of the outlets of the nozzles of the space concerned shall not exceed 85 % of the total cross-section of the distributing piping.

**3.8.1.9** Perforated pipes may be used instead of nozzles in silencers, exhaust-gas boilers and smoke stacks. The total area of pipe perforations shall be by 10 % less than the pipe cross-section.

**3.8.1.10** In addition to the alarms required by [4.3.4](#), signal whistles operated by the released carbon dioxide pressure shall be fitted on pipes laid in the spaces listed in [4.3.1](#).

**3.8.1.11** The sealing materials for the valves and flexible hoses shall be usable at low temperatures down to – 60 °C.

**3.8.1.12** In piping sections where valve arrangements introduce sections of closed piping, such sections shall be fitted with a pressure relief valve and the outlet of the valve shall be led to open deck.

**3.8.1.13** All discharge piping, pipe fittings and nozzles in the protected spaces shall be constructed of materials having a melting temperature which exceeds 925 °C. The piping and associated equipment shall be adequately supported.

**3.8.1.14** A fitting shall be installed in the discharge piping to permit the air testing.

### **3.8.2 High-pressure system.**

**3.8.2.1** The number of cylinders for storing liquid carbon dioxide shall be provided depending on the filling ratio (amount of carbon dioxide per 1 litre of cylinder capacity) which is not to be more than 0,675 kg/l at the design cylinder pressure 12,5 MPa and over and not more than 0,75 kg/l at the cylinder design pressure 15 MPa and over.

When filling cylinders, deviation of not more than by  $\pm 0,5$  kg from the rated amount per cylinder is permitted.

In cases specified in [3.1.3.3](#) and [3.8.5](#) the filling ratio shall be reduced by 0,075 kg/l against the above values.

**3.8.2.2** The cylinders shall be placed vertically in rows on the pads, which may be made of wood and shall be accessible for inspection and checking of the amount of carbon dioxide contained therein. Each cylinder shall be marked with its ordinal number. Pilot cylinders shall be fitted in the fire extinction station. Pilot cylinders (carbon dioxide of no more than 7 kg, compressed air or nitrogen) used for remote release may be placed at the fire stations or in the enclosures of the ship's internal spaces.

**3.8.2.3** A pipe connecting a cylinder with a manifold shall be as a rule seamless and made of red copper. But use of special flexible hoses made of approved materials is permitted.

A non-return valve shall be fitted on the pipe connecting the cylinder and the manifold.

Arrangement of the manifolds shall provide their complete draining.

**3.8.2.4** A manifold of the carbon dioxide extinction station shall be fitted with a pressure gauge graduated to a value at least 1 MPa in excess of the hydraulic test pressure of the carbon dioxide cylinders. The value of the pressure gauge scale division shall not exceed 0,5 MPa.

**3.8.2.5** A carbon dioxide extinction station shall have arrangements for weighing the cylinders or measuring the level of liquid therein.



### **3.8.2.6 Valves of cylinders.**

**3.8.2.6.1** The valve shall have protective devices complying with the following requirements:

protective diaphragms shall break at a pressure rise in the cylinders up to  $(1,3 \pm 0,1)p$ , in MPa (where  $p$  is design pressure of the cylinder). For valves with slotted diaphragms which are additionally fitted with protective diaphragms the breaking pressure of slotted diaphragms shall be at least 1 MPa more than the highest value of the protective diaphragm breaking pressure;

there shall be provided a checking device to indicate that the protective device has operated.

**3.8.2.6.2** Where the lever type device is used to open the valve this device shall ensure the full opening of the valve by turning the lever to an angle not more than  $90^\circ$  and shall permit the valves to be opened individually or by groups.

**3.8.2.6.3** The cylinder valves shall be fitted with scarfed pipes cut short at 5 to 15 mm from the cylinder bottom; the inside diameter of the said valve pipes and of the pipes connecting the cylinder valves with a manifold shall be not less than 10 mm.

**3.8.2.6.4** If the design of the hand-operated (manual mechanical or manual pneumatic) valves installed on carbon dioxide cylinders of local fire extinction systems (refer to [3.8.5](#)) and providing simultaneous discharge of carbon dioxide, differs from that of the valves of all other cylinders where they are fitted, they shall have the inscription "primary".

**3.8.2.7** The gas from the protective devices of cylinders shall be discharged:

**.1** to the atmosphere beyond the boundaries of the station through a separate pipe provided with an audible alarm at the outlet;

**.2** to the distribution manifold where provision shall be made for:

two pipes, one of which is open-ended and fitted with a shut-off valve, and the other is provided with a protective diaphragm;

a signalling device to indicate the presence of pressure in the manifold whose readings shall be transmitted to the space where watch keepers are present all the time.

In this case, a checking device to indicate that the protective device has operated is not required for the valves.

### **3.8.3 Low pressure system.**

**3.8.3.1** The rated amount of liquid carbon dioxide shall be stored in tank (tanks) at the working pressure of about 1,8 — 2,2 MPa which is ensured by maintaining a temperature of about  $-18^\circ\text{C}$ .

The normal liquid charge in the container shall be limited to provide sufficient vapour space to allow for expansion of the liquid under the maximum storage temperatures than can be obtained corresponding to the setting of the pressure relief valves but shall not exceed 95 % of the volumetric capacity of the container.

**3.8.3.2** A tank shall be served by two self-contained refrigerating plants, each consisting of one compressor, a condenser and a cooling battery.

The refrigerating capacity and the automatic control of each unit shall be so as to maintain the required temperature under conditions of continuous operation during 24 h at sea temperatures up to  $32^\circ\text{C}$  and ambient air temperatures up to  $45^\circ\text{C}$ .

When one of the plants is rendered inoperative, the other shall be automatically brought into operation. Cooling batteries shall be separate for each plant or common, but they shall consist of not less than two isolated sections, each having a surface designed for full output.

In other respects, a refrigerating plant shall meet the requirements of Part XII "Refrigerating Plants" for unclassified plants (except for 3.3, 3.4, 3.5 and 6.2.6), as well as those of 2.1.1, 2.3.11, 2.3.12 and 7.2.2 for classed plants.

The system control devices and the refrigerating plants shall be located within the same room where the pressure vessels are stored.

**3.8.3.3** A tank shall be fitted with:

- branches with shut-off valves for filling the tank;
- a discharge pipe;
- a device for direct monitoring of liquid carbon dioxide level, mounted on the tank;
- two relief valves with discharge pipes laid to the open air and arranged so as to provide disconnection of any of them with the remaining one connected with the container;
- a pressure gauge;
- high (not more than setting of the relief valve) and low (not less than 1,8 MPa) pressure;
- lowest acceptable level alarm device.

Relief valves shall be adjusted at the pressure not less than  $1,1p$  (where  $p$  is working pressure in the tank, in MPa), and throughput of each valve shall be such that pressure in the tank with the valve fully open does not exceed the standby pressure by more than 20 %.

The value of the design pressure of the tank shall be assumed equal to the greatest lifting pressure of a relief valve.

**3.8.3.4** If fitted outside the tank, the level gauge pipe of the device for remote monitoring of the level of liquid shall be shut off with two valves (open throughout the period of operation) and provided with one control hydrant only, nominally filled (100 %). The pipe and the control hydrant shall be thermally insulated.

**3.8.3.5** The tank and pipes led therefrom and permanently filled with carbon dioxide shall be provided with heat insulation preventing operation of the relief valve within 24 h after the installation is de-energized, at the ambient temperature of 45 °C and initial pressure equal to the starting pressure of the refrigerating plant.

**3.8.3.6** Material for a tank shall meet the requirements of 3.3, Part XIII "Materials". Welds shall be radiographed as required for class II in Table 3.3.2-2, Part XIV "Welding".

**3.8.3.7** Safety relief devices shall be provided in each section of pipe that may be isolated by block valves and in which there could be a build-up of pressure in excess of the design pressure of any of the components.

The system shall be designed in such a way that the carbon dioxide pressure at the nozzles installed in the protected spaces shall not be less than 1 MPa.

**3.8.3.8** The alarm system shall give visual and audible alarm signals:

- when the maximum (not higher than the setting of the relief valve) and minimum (not less than 1,8 MPa) pressure is reached in the tank;
- when the level of liquid carbon dioxide in the tank is reduced to the minimum acceptable level;
- in case of refrigerating plant failure;
- when the discharge of carbon dioxide begins.

The alarm signals shall be given at the central control station and in engineers' cabins.

**3.8.4 Release control.**

**3.8.4.1** Controls of systems protecting those spaces, which are normally manned ([refer to 4.3.1](#)), shall comply with the requirements of [3.8.4.2](#).

**3.8.4.2** Two separate controls shall be provided for releasing carbon dioxide into a protected space and to ensure the activation of the alarm. One control shall be used for opening the valve of the piping which conveys the gas into the protected space and a second control shall be used to discharge the gas from its storage containers. Positive means shall be provided so that they can only be operated in that order. The two controls shall be located inside a release box clearly identified for the particular space. If the box containing the controls is to be locked, a key to the box shall be in a break-glass-type enclosure conspicuously located adjacent to the box.

**3.8.4.3** The pipe supplying gas from pilot cylinder to the pneumatic actuator of main bottles through a time-delay device shall be fitted with by-pass valve located across this time-delay device which can be used in case the device goes defective. The by-pass valve is not required when the time-delay pneumatic device is used, except for the device being an integral part of a pneumo-electric time delay module.

**3.8.4.4** In low pressure systems, release of carbon dioxide shall be manual. Where an automatic control system is provided to supply rated amount of carbon dioxide to protected spaces, manual regulation of gas supply shall also be provided.

Where the system serves more than one spaces, facilities shall be provided to control the amount of released carbon dioxide such as an automatic flowmeter or a precision level indicator located at the control station(s).

**3.8.5 Local carbon dioxide fire extinguishing stations.**

For certain protected spaces placed at galleys and control stations (fire stations), local stations may be permitted where the total mass of carbon dioxide in the cylinders shall not exceed 7 kg.

In a machinery space local stations may be permitted for fire protection of crankcases and silencers of the internal combustion engines, of smoke stacks and other enclosed compartments with the total mass of carbon dioxide in each cylinder not exceeding 16 kg.

The cylinders shall have safety devices preventing the pressure therein to rise above permissible limits. There shall be provided a checking device to indicate that the protective device has operated.

Larger mass of carbon dioxide is permitted, provided the requirements of [3.8.2.4](#) and [3.8.2.7](#) are met.

As a rule, equipment of the local stations shall be mounted outside the protected spaces. The cylinders shall be mounted in such a way that their serviceability is not impaired by the weather, vibration and other external factors and they shall not be placed in accommodation spaces.

The applicable requirements of [3.1.1](#), [3.1.2](#), [3.1.4](#) and [3.1.5](#) in view of the foregoing shall be met.

The requirements of [3.8.1.2 — 3.8.1.4](#), [3.8.1.7](#), [3.8.2.2 — 3.8.2.4](#), [3.8.2.6.2](#), [3.8.2.7](#), [3.8.3](#) and [3.8.4](#) for the above-mentioned systems may be waived, except as specified in this para.

### **3.9 EQUIVALENT FIRE EXTINGUISHING SYSTEMS FOR MACHINERY SPACES AND CARGO PUMP ROOMS MENTIONED IN [1.5.7.1](#)**

**3.9.1** Fixed gas fire extinguishing systems equivalent to carbon dioxide smothering systems shall be of an approved type complying with the provisions of IMO circular MSC/Circ.848 "Revised Guidelines for the Approval of Equivalent Fixed Gas Fire-Extinguishing Systems, as Referred to in SOLAS-74, for Machinery Spaces and Cargo Pump Rooms", considering the amendments introduced by IMO circular MSC.1/Circ.1267.

**3.9.2** Fixed water-mist fire extinguishing systems shall be of an approved type complying with the provisions of IMO circular MSC/Circ.1165 "Revised Guidelines for the Approval of Equivalent Water-Based Fire-Extinguishing Systems for Machinery Spaces and Cargo Pump-Rooms", considering the amendments introduced by IMO circulars MSC.1/Circ.1237, MSC.1/Circ.1269, MSC.1/Circ.1385 and MSC.1/Circ.1386.

### **3.10 DRY POWDER SYSTEM**

#### **3.10.1 General.**

**3.10.1.1** An extinguishing powder approved by the Register for this purpose shall be used in the dry powder system.

**3.10.1.2** Nitrogen or other inert gas approved by the Register for this purpose shall be used as a propellant gas.

**3.10.1.3** The system shall consist of:  
powder installations that contain dry powder containers, propellant gas cylinders and a distribution manifold;  
hose stations;  
pipes and fittings for bringing the system into action and powder supply to the hose stations.

**3.10.1.4** Provision shall be made for a remote release of the system from any hose station.

#### **3.10.2 Quantity of dry powder and propellant gas. Capacity and number of nozzles.**

**3.10.2.1** A rated quantity of dry powder shall be stored in each container of the powder installation to provide a minimum 45 continuous discharge time at rated consumption for all attached monitors and hand hose lines.

**3.10.2.2** Each nozzle shall be capable of discharge at a rate not less than 3,5 kg/s, the powder throw range being not less than 8 m. In determining a maximum distance of coverage of each hand hose line the length of its hose shall be taken into account.

The capacity of each fixed monitor shall be at least 10 kg/s, maximum distance of coverage for monitors having a capacity 10, 25 and 45 kg/s shall be 10, 30 and 40 m, respectively.

**3.10.2.3** The number of hand hose lines and monitors shall provide the delivery of the dry chemical powder to any part of the cargo tank deck and cargo piping from two hand hose lines or a combination monitor/hand hose line.

At least one hand hose line or monitor shall be located aft of the cargo area.

**3.10.2.4** In gas carriers one monitor shall be provided in the cargo area to protect cargo manifold and capable of discharge locally and remotely.

**3.10.2.5** Dry powder fire extinguishing system for the protection of spaces stipulated in [1.5.3.2.2](#), shall ensure the delivery of not less than 0,5 kg powder/m<sup>3</sup> for not more than 10 s.

**3.10.2.6** The quantity of the propellant gas shall provide for a single entire release of the dry powder from the powder container.

#### **3.10.3 Powder fire extinction stations.**

**3.10.3.1** The powder fire extinction stations shall be positioned on the deck in the cargo area.

**3.10.3.2** The dry powder system shall consist of at least two self-contained station and in gas carriers with a cargo capacity of less than 1000 m<sup>3</sup> only one such station may be fitted.

**3.10.3.3** Ships fitted with bow or stern cargo loading and discharge manifold shall be provided with an additional dry powder fire extinction station complete with at least one monitor and one hand hose line.

**3.10.3.4** Where a fire extinction station has two or more hose stations, an independent pipe with release valves shall ensure proper dry powder delivery from the manifold to each station.

The powder fire extinction station shall provide for independent and simultaneous operation of all those stations.

#### **3.10.4 Hose station.**

**3.10.4.1** Each hose station shall consist of remote-release cylinders with a non-kinkable hand hose line not more than 33 m in length or of a monitor.

**3.10.4.2** All hose station equipment, other than a monitor, shall be stored in a watertight box or cabinet.

**3.10.4.3** Each nozzle shall be fitted with an on/off operation and discharge device.

**3.10.4.4** The cross-section of the nozzle shall be equal to that of the fire hose line or less than that by not more than 50 %.

**3.10.4.5** Release cylinders shall be provided with pressure gauges.

**3.10.4.6** Instructions on putting the system into action shall be available at the hose station.

**3.10.5 Dry powder containers, pipes and fittings.**

**3.10.5.1** Provision shall be made in the container for a dry powder discharge pipe cut short at about 100 mm from the bottom.

**3.10.5.2** A device shall be provided in the lower part of the container for gas flow into the container preventing the powder from flowing back into the gas pipe.

**3.10.5.3** The filling ratio of the containers shall be taken equal to not more than 0,95.

**3.10.5.4** Pipes and fittings shall have no contractions and abrupt expansions of cross-section.

**3.10.5.5** The cross-sectional area of the manifold in the powder installation shall be not less than the total area of the pipes connected thereto for simultaneous discharge of dry powder or shall be not more than twice that area.

**3.10.5.6** Provision shall be made on the distribution manifold for an arrangement for purging the pipes after use.

**3.10.5.7** A bending radius of the dry powder pipe shall not be less than 5 pipe nominal diameters.

**3.10.5.8** The dry powder shall be discharged into the spaces indicated in [1.5.3.2.2](#) through nozzles. Their construction, arrangement and number shall provide for uniform spraying of powder in the entire volume of the space. The pressure at the remotest nozzle shall be taken at least equal to a minimum pressure necessary for effective spraying of powder.

**3.11 AEROSOL FIRE EXTINGUISHING SYSTEM<sup>1</sup>****3.11.1 General.**

**3.11.1.1** The fire extinguishing aerosol (which is produced while combustion of solid fuel aerosol generating compounds) generators used in the aerosol fire extinguishing systems shall be of the type approved by the Register.

**3.11.1.2** The aerosol fire extinguishing system shall include:

generators of fire extinguishing aerosol;  
remote control device;  
predischARGE alarms;  
cables.

**3.11.1.3** Design mass of the aerosol generating agent, in kg, shall be calculated for each protected space separately and shall be determined by the formula

$$G = ((V + \sum_{j=1}^n V_{arj} \cdot P_{arj} \cdot P_a^{-1}) \cdot k \cdot q) / f \quad (3.11.1.3)$$

where  $V$  = design (net) volume of the protected space, in m<sup>3</sup>;

$V_{arj}$  = volume of the  $j$ -th air receiver, in m<sup>3</sup> — refer to [3.1.2.5](#);

$n$  = number of air receivers in the protected space;

$j$  = serial number of air receiver;

$P_{arj}$  = working pressure in the  $j$ -th air receiver, in MPa;

$P_a$  = atmospheric pressure, in MPa;

$q$  = normative fire extinguishing concentration of aerosol, in kg/m<sup>3</sup>;

$k$  = factor of safety equal to 1,3;

$f$  = efficiency coefficient, in %, is the percentage of fire extinguishing aerosol actually discharged from a specific aerosol generator (the coefficient is determined by comparing the mass loss of a generator after discharge to its beginning mass).

**3.11.1.4** Normative fire extinguishing concentration of aerosol depends on the type of generator and usually does not exceed 0,2 kg/m<sup>3</sup>.

**3.11.1.5** At system actuation within the protected space, the following measures shall be taken:

automatic activation of the fire warning system in compliance with the requirements of 4.3;  
automatic shutdown of ventilation;  
automatic closing of ventilation fire dampers;  
automatic shutdown of the electric drives of oil burner units of boilers and incinerators and other equipment capable to reduce the concentration of fire extinguishing aerosol.

**3.11.1.6** The system discharge time shall not exceed 2 min.

**3.11.1.7** Arrangement of generators in the protected space shall ensure equal distribution of fire extinguishing aerosol. If there are shadow zones formed by equipment and boundaries fire extinguishing aerosol shall be fed directly to the shadow zones.

**3.11.1.8** Generators shall be installed considering the distance to the thermal zone boundaries ([refer to 3.11.2.2](#)) so that the minimum safe distance away from the generators along the aerosol jet to escape routes and other areas where personnel may be present is not less than the distance to the thermal zone boundary with a temperature of 75 °C, and to combustible materials – not less than the distance to the thermal zone boundary with a temperature of 200 °C.

**3.11.1.9** Aerosols shall have non-ozone depleting characteristics.

<sup>1</sup> Refer also to IMO circular MSC.1/Circ.1270 "Revised Guidelines for the Approval of Fixed Aerosol Fire-Extinguishing Systems Equivalent to Fixed Gas Fire-Extinguishing Systems, as Referred to in SOLAS 74, for Machinery Spaces" as amended by IMO circular MSC.1/Circ.1270/Corr.1.



**3.11.2 Fire extinguishing aerosol generators.**

**3.11.2.1** Fire extinguishing aerosol generator consists of a casing, which contains an aerosol generating agent, ignitor, electrical connection, devices for mounting to the ship structures. Casing of the generator shall be fitted with the arrangement (nozzle) for the release of an aerosol.

**3.11.2.2** Each type of generator shall have information about the distance (along the aerosol jet) from its exit out of the generator to the end of the thermal zone with the temperature 75 °C and 200 °C.

**3.11.2.3** The number of fire extinguishing aerosol generators shall be calculated for each protected space separately.

Design number of generators, in pieces, shall be determined by the formula

$$N = G/m \quad (3.11.2.3)$$

where  $G$  = design mass of aerosol generating agent, in kg, in accordance with [3.11.1.3](#);  
 $m$  = mass of a charge in one generator, in kg.

The number of generators in the protected space shall be such that in the event of damage to any one power release line or generator, the aerosol concentration shall be not less than normative fire extinguishing concentration of aerosol  $q$  ([refer to 3.11.1.4](#)) provided for the selected type of generator having regard to [3.11.1.7](#).

**3.11.2.4** Casing of generator, its foundation and details fastening it to the foundation shall be made of non-combustible materials.

**3.11.2.5** The generators shall be designed to prevent self-activation at a temperature below 250 °C.

**3.11.3 The fire extinguishing remote control device.**

**3.11.3.1** The remote control device shall comply with Section 2, Part XI "Electrical Equipment".

**3.11.3.2** The remote control device shall enable distant starting of all generators protecting the space. The start-up of generators by groups is permitted proceeding from their number and provided the requirement of [3.11.1.6](#) is met.

**3.11.3.3** If several spaces are protected by the remote control device, it shall enable divided start-up of generators in each space.

**3.11.3.4** There shall be two sources of electrical power — main and emergency — for the remote control device.

**3.11.3.5** The remote control device shall enable automatic monitoring of electric circuits essential for the release of the system with indication of a faulty circuit and also generation of a signal for checking the operability of devices announcing about starting, as well as the signal for checking the possibility of shutdown of ventilation and other devices specified in [3.11.1.5](#).

**3.11.3.6** In case the fire extinguishing remote control device is to be locked, a key to the locker shall be in a break-glass-type case conspicuously located adjacent to the locker.

**3.11.4 Local stations of the aerosol fire extinguishing.**

In justified cases, to protect separate spaces other than machinery spaces of category A and containing no essential equipment, the local stations of the aerosol fire extinguishing may be equipped with at least two generators and the starting controls located outside the protected space and near the entrance to that space (without remote control device).

Starting controls shall meet the requirements of Section 2, Part XI "Electrical Equipment" and ensure:

ready starting of generators at all times;

verification of the integrity of electric circuits essential for starting the generator;

periodical checks of the aerosol fire extinguishing system operability by means of starting with the use of simulators;

short-circuit protection in each electric circuit essential for starting the generators.

In this case, the actuation of equipment listed in [3.11.1.5](#) is provided by the ship means.

**3.11.5 Cabling.**

**3.11.5.1** Cabling shall comply with the requirements of Section 16, Part XI "Electrical Equipment".

**3.11.5.2** Electric circuits connecting generators shall be duplicated and widely separated. Within the protected space, electric circuits essential for the release of the system shall be fire resistant according to IMO circular MSC.1/Circ.1270, as amended by IMO circular MSC.1/Circ.1270/Corr.1.

### **3.12 FIXED LOCAL APPLICATION FIRE EXTINGUISHING SYSTEMS FOR USE IN MACHINERY SPACES**

**3.12.1** Fixed local application fire extinguishing systems shall be fitted on passenger ships of 500 gross tonnage and above and on cargo ships of 2000 gross tonnage and above. The provisions of this Chapter do not apply to fishing vessels.

**3.12.2** Machinery spaces of category A above 500 m<sup>3</sup> in volume shall, in addition to the fixed fire extinguishing system required in [Table 3.1.2.1](#), be protected by an approved type of fixed water-based or equivalent local application fire extinguishing system complying with the requirements of IMO Revised Guidelines (refer to IMO circular MSC.1/Circ.1387, as amended by IMO circular MSC.1/Circ.1387/Corr.1 and IACS UI SC217 (Corr.2 Aug 2022)). In the case of periodically unattended machinery spaces the fire extinguishing system shall have both automatic and manual release capabilities. In the case of continuously manned machinery spaces the fire extinguishing system is only required to have a manual release capability.

Where automatic release is provided the availability of manual release is obligatory.

The manual release shall be located at easily accessible position inside and outside the protected space. The manual release inside the protected space shall not be liable to be cut off by a fire in the protected areas.

The automatic release shall be activated by fire detection system, indicating fire risk areas. Besides it shall be so designed as to prevent accidental release of the local application fire extinguishing system.

**3.12.3** Fixed local application fire extinguishing systems are to protect fire risk areas of the following machinery and equipment (without the necessity of engine shutdown, personnel evacuation, or sealing of the spaces):

- .1 internal combustion engines;
- .2 incinerators;
- .3 purifiers for heated fuel oil;
- .4 boiler fronts (where nozzles are fitted);
- .5 inert gas generators;
- .6 fuel heaters.

In multi-engine installations, at least two sections shall be arranged.

**3.12.4** The activation of any local application fire extinguishing system shall give a visual and a distinct audible alarm in the protected space in the main machinery control room and in the wheelhouse. The alarm, which may be monotone, shall indicate the specific system activated. The system alarm requirements, described within this paragraph are in addition to, and not in lieu of, the fire detection and fire alarm systems required elsewhere in this Part.

**3.12.5** Electrical equipment of the system and its release alarm shall comply with the requirements of 7.13, Part XI "Electrical Equipment".

**3.12.6** Nozzles onboard shall be located in the same positions as during their testing carried out according to the IMO Revised Guidelines (refer to IMO circular MSC.1/Circ.1387, as amended by IMO circular MSC.1/Circ.1387/Corr.1 and IACS UI SC217 (Corr.2 Aug 2022)).

### **3.13 TESTING OF FIRE EXTINGUISHING SYSTEMS**

**3.13.1** Fire extinguishing systems shall be tested in compliance with [Table 3.13.1](#).

**3.13.2** The operational testing of the systems shall be conducted in conformity with Register – approved programs to verify their serviceability, operation of starting controls, and where prototype ships are concerned, to confirm the stipulated time for the fire extinguishing medium discharge into the protected space.

On prototype ships, a test discharge of the rated amount of carbon dioxide into one of the protected spaces is required for high-pressure carbon dioxide systems.

The test discharge may be omitted if reasonable substantiations are submitted to the Register.

Table 3.13.1

Nos.	Systems and assemblies to be tested	Hydraulic test pressure	
		in shop	on board ship
<b>1</b>	Foam and water fire extinguishing systems (refer also to Section 21, Part VIII "Systems and Piping"):		
	.1 pipes;	—	in action
	.2 pipes of sprinkler system	—	1p
<b>2</b>	Pipes of dry powder system	1,5p	1p (by air)
<b>3</b>	Carbon dioxide systems		
<b>3.1</b>	High-pressure systems:		
	.1 pipes from cylinders to release control valves; transit pipe lines passing through spaces (refer to 3.1.4.1.4);	—	1,5p
	.2 pipes from release control valves to nozzles and pipes from safety devices	—	5 MPa
<b>3.2</b>	Low-pressure systems:	—	
	.1 pipes from tank to release control valves;	—	1,5p
	.2 pipes from release control valves to nozzles and pipes from safety devices	—	1p
<b>4</b>	Pneumatic pipes	—	1,5p
<b>5</b>	Cylinders, containers and tanks:		
	.1 operating under pressure, including cylinders without valves;	1,5p	—
	.2 operating without pressure;	By filling up to the top of the air pipe	In assembly with system
	.3 cylinders with screwed-in valves	1p (by air)	—
<b>6</b>	Fittings	1,5p, but not less than 0,2 MPa	

Notes: 1. p is the maximum working pressure in the system, and for carbon dioxide p is a design pressure of a cylinder or a tank, in MPa.

2. Fittings in assembly shall be tested for the tightness of closing by a pressure of at least 1,25p, valves of carbon dioxide cylinders — by the highest breaking pressure of protective diaphragms according to 3.8.2.6.1.

3. The systems shall be tested in assembly on board ship upon completion of all erection work.

4. Pipes specified in 3.1.1 and 3.2.1 of the Table, after being tested by a pressure of 1,5p, may be tested on board by pressure of 1p.

5. Pipes of the water fire main system in ships of 500 gross tonnage and upwards (refer to 3.2.5.1) shall be tested by a pressure of at least 1,0 MPa.

## **4 FIRE DETECTION AND ALARM SYSTEMS**

### **4.1 GENERAL**

**4.1.1** All electrical equipment, devices, alerts and indicators, feeders and wiring of fire detection and alarm systems shall fully comply with the requirements of 7.5 and 7.6, Part XI "Electrical Equipment" of these Rules, the Code on Alerts and Indicators and the FSS Code.

All fire detection and alarm equipment and systems shall be designed to withstand ambient temperature changes, vibration, humidity, shock, impact and corrosion normally encountered in ships.

**4.1.2** The following additional definitions and abbreviations have been adopted in this Part.

Code on Alerts and Indicators, 2009 is the Code on Alerts and Indicators, as adopted by IMO resolution A.1021(26).

Delta-factor is a standardized change of the fire factor value at the early stage of fire development within the specified time period when the fire factor does not reach dangerous values.

Detection circuit is a set of assemblies or components of multi-criteria detector monitoring a fire factor changing during fire.

Fire alarm control and indicating equipment is a technical equipment designed to receive, process and display signals of fire detectors and other interacting devices, to control integrity and functionality of communication lines between the equipment and fire detectors or other devices.

Fire detector is a technical equipment designed to detect a fire factor and/or generate an alarm signal.

Depending on the method of actuation, the fire detectors are divided into automatic fire detectors and manual call points.

Automatic fire detector is a fire detector responding to one or several fire factors.

Depending on the mode of data exchange with the fire alarm control and indicating equipment, the automatic fire detectors are divided into threshold and analogue.

Depending on a type of the monitored fire signature, the automatic fire detectors are divided into:

- heat detectors;
- smoke detectors;
- flame detectors;
- gas detectors;
- combination detectors.

Analogue detector is an automatic fire detector communicating to the fire alarm control and indicating equipment the data on a current value of the monitored fire factor.

Combination fire detector is an automatic fire detector responding to two or more physical fire factors and performing AND logic operations.

Flame detector is an automatic fire detector responding to electromagnetic radiation emitted by flame or smoldering fire.

Depending on electromagnetic spectrum detected by the sensitive element, the flame detectors are divided into:

- ultraviolet (UV) detectors;
- infrared (IR) detectors;
- visible light detectors;
- multiple detectors.

Gas detector is an automatic fire detector sensitive to the changes in the chemical composition of the atmosphere caused by the fire.

Heat detector is an automatic fire detector sensitive to a value of temperature and/or rate of temperature rise.

Depending on response to the monitored fire factor, the threshold heat detectors are divided into:

- maximum detectors;
- differential detectors;
- differential-maximum detectors.

Fixed (maximum) temperature heat detector is an automatic threshold detector initiating an alarm when the ambient air temperature (operation temperature) exceeds the specified threshold value.

Heat differential detector is an automatic threshold detector initiating an alarm when the rate of temperature rise exceeds the specified threshold value.

Differential-maximum heat detector is an automatic threshold detector performing OR logic operations as the maximum temperature and heat differential detectors.

Manual call point is a fire detector designed for manual initiation of an alarm in the fire alarm loop.

Multi-criteria detector is an automatic fire detector containing one or several sensors that respond to the fire-caused physical environmental variables or that uses more than one sensor to detect a separate fire factor based on its different physical properties and that initiates an alarm independently or together with the fire alarm control and indicating equipment upon multi-criteria processing of the monitored data.

Depending on a type of the monitored fire factor, the detection circuits of multi-criteria detectors are divided into:

- heat circuits;
- smoke circuits;
- flame circuits;
- gas circuits.

Multi-criteria fire detection algorithm is a method of processing the signals initiated by one or several fire detectors for reliable identification of fire situation with regard to the several fire factor variables or several physical properties of one factor.

Multi-criteria fire detection and fire alarm system is a complex of automatic multi-criteria fire detectors and fire alarm control and indicating equipment forming onboard integrated system to implement multi-criteria fire detection algorithm.

Section is a group of fire detectors and manually operated call points as reported in the indicating unit(s).

Smoke detector is an automatic fire detector sensitive to particulate solid or liquid products of combustion and/or pyrolysis suspended in the atmosphere.

Depending on the principle of operation, the smoke detectors are divided into ionization and optical.

Ionization smoke detector is an automatic smoke detector sensitive to smoke particles (aerosol) capable of affecting ionization currents.

Optical smoke detector is an automatic smoke detector sensitive to combustion products capable of adsorbing, diffusing or reflecting optical emission of optical signal with the sensible area located in the restricted volume significantly less than the protected space.

Threshold detector is an automatic fire detector initiating an alarm when the monitored fire factor reaches or exceeds the specified threshold value.

**4.1.3** In passenger ships, the control panel shall be located in the onboard safety centre. An indicating unit that is capable of individually identifying each detector that has been activated or manually operated call point shall be located on the navigation bridge.



In cargo ships, the control panel shall be located on the navigation bridge or in the fire control station. In cargo ships, an indicating unit shall be located on the navigation bridge if the control panel is located in the fire control station. A space in which a cargo control console is installed, but does not serve as a dedicated cargo control room (e.g. ship's office, machinery control room), shall be regarded as a cargo control room, and therefore be provided with an additional indicating unit.

Clear information shall be displayed on or adjacent to each indicating unit about the spaces covered and the location of the sections.

In cargo ships and on passenger cabin balconies, indicating units shall, as a minimum, denote the section in which a detector has activated or manually operated call point has operated. In addition, controls for remote closing of the fire doors and shutting down the ventilation fans shall be centralized at the continuously manned central control station. The ventilation fans shall be capable of reactivation by the crew at the continuously manned control station. The control panels in the central control station shall be capable of indicating open or closed position of fire doors, on or off status of the detectors, alarm and fans.

**4.1.4** Fire detection and fire alarm system shall not be used for any other purpose, except for closing fire doors from the switchboard and other similar purposes ([refer to 3.12.2](#)). Where fire doors are at the same time watertight doors (refer to 7.12, Part III "Equipment, Arrangements and Outfit") they shall not be automatically closed upon operation of fire alarms.

Detectors and manual call points shall be connected to dedicated sections of the fire detection and fire alarm system. Other fire safety functions, such as alarm signals from the sprinkler valves, may be permitted in separate sections.

## 4.2 FIRE DETECTION AND FIRE ALARM SYSTEMS

### 4.2.1 Fixed fire detection and fire alarm systems.

**4.2.1.1** The fixed fire detection and fire alarm system shall be installed to protect:

- .1** accommodation and service spaces and control stations ([refer to 4.2.1.2](#));
- .2** Category A machinery spaces periodically unattended and Category A machinery spaces in which installation of automatic and remote control systems and equipment has been approved by the Register instead of continuous manning of the space and the main propulsion plant and associated machinery including main sources of power are provided to a variable degree with automatic or remote control and permanently under supervision of the watchkeeping staff at the control station;
- .3** cargo spaces in which packaged dangerous goods are carried ([refer to 7.2.7](#)) as well as cargo spaces which are inaccessible, on passenger ships, except cases when the ship is engaged in voyages of so short duration, that application of this requirement will be unsuitable;
- .4** spaces for carriage of vehicles, special category spaces and ro-ro spaces ([refer to 4.2.1.3](#)). The fire detection and fire alarm system shall not be installed on weather decks used for the carriage of vehicles with fuel in their tanks;
- .5** cabin balconies of passenger ships, when furniture and furnishings on such balconies are not as defined in [2.1.1.9](#). A fixed fire detection and fire alarm system for cabin balconies shall comply with the requirements of the FSS Code and IMO circular MSC.1/Circ.1242;
- .6** enclosed spaces with incinerators. Spaces having little fire risk, such as void spaces with no storage of combustibles, private bathrooms, public toilets, fire extinguishing medium storage rooms, cleaning gear lockers (in which flammable liquids are not stored), open deck spaces and enclosed promenades having little or no fire risk and that are naturally ventilated by permanent openings, need not be fitted with detectors and manual call points;
- .7** BWMR containing inert gas generators or ozone generators. BWMR containing equipment related to ozone-based BWMS shall be maintained by separate sections of fire detectors that do not cover control stations, service and accommodation spaces.

**4.2.1.2** When protecting accommodation and service spaces and control stations the following shall be provided:

- .1** in passenger ships:
  - smoke detectors shall be installed in all stairways, corridors and escape routes within accommodation spaces as specified in [4.2.1.2.2 — 4.2.1.2.3](#).
  - the entire main vertical zone containing atrium shall be protected over the entire area by the smoke detection system;
  - consideration shall be given to installation of special smoke detectors in ventilation ducts;
  - the fixed fire detection and fire alarm system shall be capable of remotely and individually identifying each detector and manually operated call point;
  - it shall be considered that detectors fitted in cabins, when activated, shall also be capable of emitting, or cause to be emitted, an audible alarm within the space where they are located ([refer to 19.1.1.6.3, Part XI "Electrical Equipment"](#));
- .2** in passenger ships carrying more than 36 passengers the fixed fire detection and fire alarm system shall be so installed and arranged as to detect the presence of smoke in service spaces, control stations and accommodation spaces including corridors, stairways and escape routes within accommodation spaces. Installation of smoke detectors in private bathrooms is not required. Spaces having little fire risk, such as void spaces, public toilets, carbon dioxide extinction station and equivalent spaces need not be protected with fixed fire detection and fire alarm system;

**.3** in passenger ships carrying not more than 36 passengers, there shall be installed throughout each separate vertical or horizontal zone, in all accommodation and service spaces, and where the Register considers it necessary, in control stations, except spaces posing no substantial fire risk such as void spaces, sanitary spaces, etc. either:

**.3.1** a fixed fire detection and fire alarm system so installed and arranged as to detect the presence of fire in such spaces and provide smoke detection in corridors, stairways and escape routes within accommodation spaces; or

**.3.2** an automatic sprinkler system and a fixed fire detection and fire alarm system so installed and arranged as to protect such spaces and, in addition, the fixed fire detection and fire alarm system so installed and arranged as to detect the presence of smoke in corridors, stairways and escape routes within the accommodation spaces;

**.4** detectors may be operated by heat, smoke or other products of combustion, flame or any combination of these factors. Detectors operated by other factors may be considered by the Register, provided that they are no less sensitive than the above detectors.

**.5** in cargo ships accommodation and service spaces and control stations depending on a protection method shall be protected by a fixed fire detection and fire alarm system and/or by an automatic sprinkler system and fire alarm and detection system as follows:

**.5.1** when method IC is used: a fixed fire detection and fire alarm system shall be so installed and arranged as to provide smoke detection in all corridors, stairways and escape routes within accommodation spaces;

**.5.2** when method IIC is used: a fixed fire detection and fire alarm system shall be so installed and arranged as to provide smoke detection in all corridors, stairways and escape routes within accommodation spaces. In addition, an automatic sprinkler system shall be so installed and arranged as to protect accommodation spaces, galleys and other service spaces except spaces posing no substantial fire risk such as void spaces, sanitary spaces, etc.;

**.5.3** when method IIIC is used: a fixed fire detection and fire alarm system shall be so installed and arranged as to detect the presence of fire in all accommodation and service spaces, providing smoke detection in corridors, stairways and escape routes within accommodation spaces, except spaces posing no substantial fire risk such as void spaces, sanitary spaces, etc. In addition, a fixed fire detection and fire alarm system shall be so installed and arranged as to provide smoke detection in all corridors, stairways and escape routes within accommodation spaces. However, there is no need to provide fixed fire detection and fire alarm system in service spaces built away from the accommodation block;

**.6** if the fixed fire detection and fire alarm system is required for protection of spaces other than spaces specified in [4.2.1.2.1](#), at least one detector complying with the requirements of the FSS Code shall be installed in each such space;

**.7** a galley of fishing vessels shall be protected by a fixed fire detection and fire alarm system.

**4.2.1.3** The fire detection and fire alarm system installed in spaces intended for the carriage of vehicles, special category spaces and in ro-ro spaces shall provide early detection of fire. The type of automatic detectors and arrangement thereof shall be determined with consideration of effect of ventilation and other appropriate factors. After installation, the system shall be tested under normal ventilation conditions to determine the average time of its responding. The fire detection and fire alarm system may not be fitted in special category spaces if an effective watching in the form of continuous fire watch is maintained in the spaces throughout the voyage.

**4.2.1.4 Installation requirements.**

**4.2.1.4.1** Detectors and manually operated call points shall be grouped into sections.

**4.2.1.4.2** A section of fire detectors which covers a control station, a service space or an accommodation space shall not include a machinery space of category A and a ro-ro space. A section of fire detectors which covers a ro-ro space shall not include a machinery space of category A. For fixed fire detection and fire alarm systems with remotely and individually identifiable fire detectors, a section covering fire detectors in accommodation, service spaces and control station shall not include fire detectors in machinery spaces of category A or ro-ro spaces.

**4.2.1.4.3** Where the fixed fire detection and fire alarm system does not include means of remotely identifying each detector individually, no section covering more than one deck within accommodation spaces, service spaces and control stations shall normally be permitted except a section which covers an enclosed stairway. In order to avoid delay in identifying the source of fire, the number of enclosed spaces included in each section shall be limited as determined by the RS requirements. If the fire detection and fire alarm system is fitted with individually identifiable fire detectors, the sections may cover several decks and serve any number of enclosed spaces.

**4.2.1.4.4** In passenger ships, a section of detectors and manually operated call points shall not be situated in more than one main vertical zone except on cabin balconies.

**4.2.1.4.5** No section shall pass through a space twice. When this is not practical (e.g. for large public spaces), the part of the section which by necessity passes through the space for a second time shall be installed at the maximum possible distance from the other parts of the section.

**4.2.1.4.6** Detectors shall be located for optimum performance. Positions near beams and ventilation ducts or other positions where patterns of air flow could adversely affect performance and positions where impact or physical damage is likely shall be avoided.

Detectors which are located on the overhead shall be a minimum distance of 0,5 m away from bulkheads, except corridors, lockers and stairways.

**4.2.1.4.7** The maximum spacing of detectors shall be in accordance with Table 4.2.1.4.7.

The Register may permit deviation from the requirements of Table 4.2.1.4.7 based upon characteristics of detectors obtained during tests and agreed with the Register.

When heat-pulse detectors are used in machinery spaces, the deck area served by one detector shall be 50 m<sup>2</sup>, and distance between centres shall be not more than 6 m.

Table 4.2.1.4.7

Type of detector	Maximum floor area per detector, in m <sup>2</sup>	Maximum distance apart between centres, in m	Maximum distance away from bulkheads, in m
Heat	37	9	4,5
Smoke	74	11	5,5

**4.2.1.4.8** The smoke detectors on stairways shall be located at the top level of the stair and at every second level beneath.

**4.2.1.4.9** When fire detectors are installed in freezers, drying rooms, saunas, parts of galleys used to heat food, laundries and other spaces where steam and fumes are produced, heat detectors may be used.

**4.2.1.4.10** Except in spaces of restricted height and where their use is specially appropriate, fire detection and fire alarm systems using only heat detectors shall not be permitted.

**4.2.1.5** A sample extraction smoke detection system of a type approved by the Register and meeting the requirements of [4.2.1.6](#) may be provided in cargo spaces specified in [4.2.1.1.3](#) and [4.2.1.1.4](#), except spaces specified in [1.5.4.3.2](#), [1.5.4.4.2](#) and [1.5.9](#).

**4.2.1.6** A sample extraction smoke detection system shall consist of the following main components: smoke accumulators, sampling pipes, three-way valves, if the system is interconnected to a fixed gas fire extinguishing system, control panel, and shall meet the following requirements:

**.1** the system shall be capable of continuous operation at all times. Systems operating on a sequential scanning principle may be permitted on agreement with the Register provided that interval I between two scanings of the same space does not exceed 120 s and provides time T mentioned in [4.2.1.6.10](#). With a 20 % allowance the interval I is determined by the formula

$$I = 1,2 \times T \times N$$

where N = the number of scanning points;

**.2** the sampling pipe arrangements shall be such that the location of the fire can be readily identified;

**.3** the system shall be constructed and installed so as to prevent the leakage of any toxic or flammable substances or fire extinguishing media into any accommodation and service space, control station or machinery space, as well as to avoid the possibility of ignition of flammable gas-air mixture;

**.4** at least one smoke accumulator shall be located in every enclosed space for which smoke detection is required. However, where a space is designed to carry oil or refrigerated cargo, or other cargoes for which a smoke sampling system is required, means may be provided to isolate the smoke accumulators in such compartments on agreement with the Register. In cargo holds where non-gastight "tween deck panels" (movable stowage platforms) are provided, smoke accumulators shall be located in both the upper and lower parts of the holds;

**.5** smoke accumulators shall be located for optimum performance and shall be spaced so that no part of the overhead deck area is more than 12 m measured horizontally from an accumulator.

Where systems are used in spaces which may be mechanically ventilated, the position of the smoke accumulators shall be considered having regard to the effects of ventilation.

At least one additional smoke accumulator shall be provided in the upper part of each exhaust ventilation duct. An adequate filtering system shall be fitted at the additional smoke accumulator to avoid dust contamination.

Smoke accumulators shall be positioned where impact or physical damage is unlikely to occur;

**.6** the number of smoke accumulators connected to each sampling pipe shall ensure compliance with the requirements of [4.2.1.7](#);

**.7** smoke accumulators from more than one enclosed space shall not be connected to the same sampling point;

**.8** sampling pipes shall be self-draining and protected from impact or damage during cargo operations;

**.9** the sensing unit shall operate before the smoke density within the sensing chamber exceeds 6,65 % obscuration per meter;

**.10** at least two sample extraction fans, duplicating one another, shall be provided.

The fans shall be of sufficient capacity to operate with the normal conditions of ventilation in the protected area. The connected pipe size shall be determined with consideration of fan suction capacity and piping arrangement shall satisfy the requirements of [4.2.1.7](#). The fans, depending on capacity and length of piping, shall provide time T of total system operation delay not more than 15 s. The fan suction capacity shall be adequate to ensure the response of the most remote area within the required time criteria in [4.2.1.7](#);

.11 the switchboard shall have means permitting observation of smoke in the individual sampling pipe;

.12 means shall be provided to monitor the airflow through the sampling pipes so designed as to ensure equal quantities are extracted from each interconnected accumulator;

.13 sampling pipes shall be a minimum of 12 mm inside diameter. Where the pipes are used in conjunction with fixed gas fire extinguishing systems, the minimum size of pipe shall be sufficient to permit the fire extinguishing medium to be discharged within the appropriate time;

.14 sampling pipes shall be provided with arrangement for periodically purging with compressed air;

.15 control panel shall be located on the navigation bridge, in the central control station or carbon dioxide extinction station. The indicating unit shall be located on the navigation bridge if the control panel is located in the central control station or carbon dioxide extinction station.

Clear information shall be displayed on or adjacent to the control panel and indicating units designating the spaces covered.

Provision shall be made for checking the control panel of the smoke detection system in accordance with the procedure agreed with the Register;

.16 provision shall be made for testing for correct operation and restoring to normal surveillance without the renewal of any component;

.17 detection of smoke or other products of combustion shall initiate visual and audible signals at the control panel and indicating units;

.18 power supplies necessary for the system operation shall be monitored loss of power. The loss of power shall initiate a visual and audible fault signal at the control panel and navigation bridge which shall be distinct from a fire signal (refer also to 7.5.4, Part XI "Electrical Equipment");

.19 means to manually acknowledge all alarm and fault signals shall be provided at the control panel. The audible alarm sounders on the control panel and indicating units may be manually silenced. The control panel shall clearly distinguish between normal, alarm, acknowledged alarm, fault and silenced conditions;

.20 the system shall be arranged to automatically reset to the normal operating condition after alarm and fault conditions are cleared;

.21 suitable instructions and component spares shall be provided for the testing, maintenance and repair of the system.

**4.2.1.7** After installation, the system shall be functionally tested using smoke generating machines or equivalent as a smoke source. An alarm shall be received at the control panel in not more than 180 s for vehicle decks, and not more than 300 s for container and general cargo holds, after smoke is introduced at the most remote accumulator.

#### **4.2.2 Manual alarms.**

**4.2.2.1** Manual fire alarms shall be provided in the ships which in compliance with [4.2.1.1](#) are equipped with fixed fire detection and fire alarm system.

**4.2.2.2** Manually operated call points shall be installed to protect all accommodated spaces, service spaces and control stations, considering the requirements of [4.2.1.2.3.3](#). A manually operated call point fitting is not required in an individual space within the accommodation spaces, service spaces and control stations. A manually operated call point shall be located at each exit (inside or outside) to the open deck from the corridor such that no part of the corridor is more than 20 m from a manually operated call point.

**4.2.2.3** Service spaces and control stations which have only one access, leading directly to the open deck, shall have a manually operated call point not more than 20 m from the exit (measured along the access route using the deck, stairs and/or corridors).



**4.2.2.3.1** A manually operated call point is not required to be installed for spaces having little fire risk, such as carbon dioxide rooms, nor at each exit from the navigation bridge, in cases where the control panel is located in the navigation bridge.

**4.2.2.4** In special category spaces the manual call points shall be installed so that no part of the space is more than 20 m from the call point and one call point shall be installed close to each exits from such spaces.

**4.2.2.5** All buttons of manual fire alarms shall be painted red and adequately illuminated both in normal and emergency conditions. The button shall be protected with glass.

**4.2.2.6** Any required fixed fire detection and fire alarm system with manually operated call points shall be capable of immediate operation at all times.

On special agreement, particular spaces may be disconnected during specific work. In this case, the means for disconnecting the detectors shall be designed to automatically restore the system to normal surveillance after a predetermined time.

**4.2.3 Protection of unattended machinery spaces.**

**4.2.3.1** Unattended machinery spaces of category A, as well as heated air ducts and main boiler uptakes, essential auxiliary boilers with a steam capacity over 3 t/h and boilers with thermal liquids (including exhaust gas boilers) in such spaces shall be provided with an automatic fire alarm and fire detection system (refer also to 2.2.4, Part IX "Machinery").

**4.2.4 Multi-criteria fire detection and fire alarm systems.**

**4.2.4.1** Multi-criteria fire detection and fire alarm systems, which primary purpose is similar to the threshold fire alarm systems based on the threshold principle of automatic fire detectors' operation subject to dangerous factors of the fire, may be installed instead of the fire detection and fire alarm systems required in 4.2.1 and, in addition to the requirements of this Chapter, shall meet the applicable requirements of 7.5, Part XI "Electrical Equipment".

**4.2.4.2** Multi-criteria fire detection and fire alarm systems may operate under one of the signal processing algorithms:

- determined algorithm;
- selectable algorithm.

Determined algorithm is a method of processing the signals initiated by fire detectors that is independent of a category of the protected spaces and a class of potential fire and, consequently, may be treated as the universal algorithm. Contrary to the hard algorithm, the selectable algorithm depends on a category of the protected space and a class of potential fire.

Herewith, each selected algorithm of signal processing may be applied exclusively to the specific categories of spaces, e.g., machinery spaces, storerooms, cabins, etc.

Switching of the signal processing algorithms (for detectors with selectable algorithm) shall be provided via switchpoints located on the detectors or programming (via communication lines). Switchpoints and connectors of communication lines for detector programming shall be inaccessible after their installation.

**Note.** It is recommended that the switchpoint (microswitch, jumper (bridge), etc.) shall be used inaccessible after installation of detectors or other engineering solutions blocking communication lines intended for detector programming.

**4.2.4.3** Multi-criteria fire detectors interacting with the fire alarm control and indicating equipment shall meet the requirements 7.5.10.2 — 7.5.10.5 and 7.5.10.7, Part XI "Electrical Equipment".

The detectors, except for detectors with hard algorithm of signal processing, shall be able to switch on/off (block) each detection circuit via switchpoints or programming. This ability shall be unavailable after installation of the detectors. Performance of detectors with one activated detection circuit shall comply with the requirements for automatic fire detectors sensitive to the same physical environmental parameter as the activated circuit.



The detectors shall remain operational and maintain performance under all voltage and frequency variations specified in Table 2.1.3.1, Part XI "Electrical Equipment".

The detectors shall report on their failures to the fire alarm control and indicating equipment/panel.

**4.2.4.4** In ship's spaces without permanent operational, production, process or natural non-fire factors triggering false response of fire detectors, the multi-criteria detectors with a complete set of detection circuits shall be used.

*Note.* The above non-fire factors include, e.g., dust, steam, water mist, oil mist, condensate, non-fire-related smoke from operating engine, exhaust gases from operating engines in spaces for transportation of vehicles, different heat sources, etc.

**4.2.4.5** In ship's spaces with permanent or occasional non-fire factors specified in 4.2.4.4 and capable of triggering false response of fire detectors, fire detectors may be used with partially locked (disconnected) detection circuits sensitive to the specified factors.

In these spaces, the fire detectors with one relevant detection circuit non-sensitive to the permanent or occasional non-fire factors may be used. Herewith, fire alarms shall be generated with regard to requirements in 4.2.4.7.

**4.2.4.6** Multi-criteria system shall automatically generate a reliable fire alarm and terminate false responses caused by non-fire factors using processing of varying signals initiated by fire detectors located in one space (zone).

**4.2.4.7** Multi-criteria system shall automatically generate a fire alarm when one or several fire detectors detect(s) at least two dangerous factors of fire of different physical origin, herewith it is not important whether these factors are detected by one or several fire detectors. In both cases, the system shall generate a fire alarm.

At least two independent physical properties of a separate fire factor of the same physical origin may be also used as reliable justification for generation of a fire alarm.

For example, for flame detectors with two (IR and UV) detection circuits, a fire alarm shall be generated with mutual flame detection in IR and UV ranges.

**4.2.4.8** Fire alarm shall not be generated when one or several fire detectors detect(s) variation in one property of fire factor of the same physical origin.

**4.2.4.9** Equipment of multi-criteria fire detection and fire alarm system shall be tested in accordance with the requirements of 10.7.14, Part IV "Technical Supervision during Manufacture of Products" of the Rules for Technical Supervision during Construction of Ships and Manufacture of Materials and Products for Ships, considering requirements for fire tests of fire detectors specified in ISO/TS 7240-9:2012 "Fire detection and alarm systems – Part 9: Test fires for fire detectors".

For fire tests of multi-criteria fire detection and fire alarm systems with smoke and heat detection circuits, the following types of test fire points are used according to ISO/TS 7240-9:2012: TF1, TF2, TF3, TF4, TF5, TF8.

For fire tests of multi-criteria fire detection and fire alarm systems with gas and heat detection circuits, the following types of test fire points are used according to ISO/TS 7240-9:2012: TF2, TF3, TF4, TF5.

For fire tests of multi-criteria fire detection and fire alarm systems with smoke, gas and heat detection circuits, the following types of test fire points are used according to ISO/TS 7240-9:2012: TF1, TF2, TF3, TF4, TF5, TF8.

**4.2.4.10** Multi-criteria fire detectors with one detection circuit shall be installed in accordance with the requirements of Table 4.2.1.4.

**4.2.4.11** Multi-criteria fire detectors with two — four detection circuits shall be installed in accordance with the requirements of Table 4.2.1.4 for installation of smoke detectors.

**4.2.4.12** For multi-criteria system with determined algorithm generating a fire alarm based on delta-factor detection, the following normative threshold values shall be used:

by temperature — 5 °C;

by smoke — 0,5 % for 1 m;  
by carbon monoxide — 10 ppm;  
within the specified time period of 15 min.

Detection of delta-factor shall be automatically recorded by the fire alarm control and indicating equipment when the following condition is met:

$$\Delta\Phi \leq \Phi_2 - \Phi_1 \quad (4.2.4.12)$$

where  $\Delta\Phi$  — delta-factor;

$\Phi_2$  — current value of delta-factor;

$\Phi_1$  — retrospective value of delta-factor at the beginning of the specified time period in relation to the current value.

### **4.3 FIRE WARNING ALARMS**

**4.3.1** Means shall be provided for automatically giving audible and visual warning of the release of fire-extinguishing medium into any ro-ro spaces, container holds equipped with integral reefer containers, spaces accessible by doors or hatches, and other spaces in which personnel normally work or to which they have access.

Conventional cargo spaces and spaces with only a local release need not be provided with such an alarm.

**4.3.2** The signal warning of putting a total flooding system into action shall be given only within the space into which the extinguishing medium shall be discharged.

Means of audible alarm actuation shall be so arranged that the alarm can be heard throughout the protected space with all machinery in operation and be distinct from other audible alarms through adjustment of sound pressure or pattern.

**4.3.3** Fire warning alarm (the pre-discharge alarm) shall be automatically activated, when any starting control is actuated or when direct access thereto is provided (by opening the release cabinet door, switching off the interlocking, etc.). The alarm shall operate for the length of time needed to evacuate the space, but in no case less than 20 s before the fire-extinguishing medium is released.

**4.3.4** The signal shall be clear, distinct and readily audible in a noisy space, and shall be of a tone distinct from all other signals. In addition to the audible signal, there shall be a visible signal: "Gas! Go away!" and for the spaces protected by the aerosol fire extinguishing systems — "Aerosol! Go away!".

**4.3.5** Audible alarm in the cargo pump room of oil tankers shall be:

pneumatic, operated by dry and clean air; or

electrically-operated, intrinsically safe; or

electrically-operated, the electric actuating mechanism being located outside the pump room.

## 5 FIRE-FIGHTING OUTFIT, SPARE PARTS AND TOOLS

### 5.1 FIRE-FIGHTING OUTFIT

**5.1.1** Items of fire-fighting outfit shall comply with the FSS Code and be of approved type and ready for use at any time.

Fire-fighting outfit shall be located in a readily accessible place.

In passenger ships the location of fire-fighting outfit shall be marked by photoluminescent material or by lighting. Such photoluminescent markers or lighting shall meet the requirements of 8.5.5, Part III "Equipment, Arrangements and Outfit" of these Rules and the FSS Code.

**5.1.2** Depending on the purpose and size of the ship the standards for supplying portable firefighting appliances, apparatus and consumable materials shall be in compliance with [Table 5.1.2](#). Items of outfit in addition to those specified in [Table 5.1.2](#), shall be provided on ships carrying dangerous goods in accordance with [7.2.10](#), oil recovery ships according to [6.4.10](#), [6.4.11](#) and [6.4.13](#), ships with distinguishing marks **FF** and **FFWS** in the class notation according to [6.6.11](#) of this Part; ships equipped with helidecks according to 6.4.1.15, Part XVII "Distinguishing Marks and Descriptive Notations in the Class Notation Specifying Structural and Operational Particulars of Ships"; ships designed to carry containers on or above the weather deck in compliance with [6.7](#) of this Part.

**5.1.3** The couplings of all portable items of outfit (fire hoses, fire hose nozzles, portable foam generators, etc.) shall be of the standard quick-acting type and size adopted for the given ship. Unless one hose and nozzle is provided for each hydrant in the ship, there shall be complete interchangeability of hose couplings and nozzles. All couplings and items of outfit shall be made of a material resistant to marine environment.

Items of fire-fighting outfit installed in the dangerous areas, rooms and spaces as well as on the open decks of oil tankers and oil recovery ships, gas carriers and chemical tankers shall be of type preventing spark formation. Aluminium alloys may be used for hose couplings and nozzles except weather decks of oil tankers and chemical tankers.

**5.1.4** Fire hoses shall comply with the following requirements:

- .1** shall have a length not less than 10 m, but not more than:
  - .1.1** 15 m in machinery spaces;
  - .1.2** 20 m in spaces other than those specified in [5.1.4.1.1](#) and on weather decks;
  - .1.3** 25 m on weather decks of ships with maximum breadth more than 30 m.

In any case the fire hose length shall be sufficient to deliver a jet of water to any of the spaces where their use may be required;

**.2** they shall be made of approved materials resistant to wear and destruction by microorganisms (rotting);

**.3** fire hoses in assembly with nozzles shall be stowed at hydrants or on open places on reels or in baskets. On open decks they shall be kept in spray-proof ventilated lockers or enclosures. Stowage locations for fire hoses with nozzles (fire lockers and enclosures) shall be marked with fire control signs in accordance with IMO resolution A.952(23) as amended by IMO resolution A.1116(30);

**.4** in passenger ships, there shall be provided at least one fire hose for each of the hydrants and these hoses shall be used only for fire fighting or testing at fire drills and surveys. Additionally, in inner spaces in passenger ships carrying more than 36 passengers fire hoses shall be connected to hydrants at all times;

Table 5.1.2

Nos.	Description of items of outfit	Number of items of outfit to be available in each ship
<b>1</b>	Fire hoses with couplings ( <a href="#">refer to 5.1.4</a> ):	
	.1 for water	In accordance with the number of hydrants fitted on board ship
	.2 for foam solution	In accordance with the number of fire hydrants to which foam solution is supplied from fixed foam fire extinguishing system. If the size of the water hoses required by <a href="#">1.1</a> is suitable for handling foam solution, such hoses may be taken into account to complete the number of hoses to be coupled to the hydrants fitted on the upper decks
<b>2</b>	Fire hose nozzles:	
	.1 dual-purpose nozzles for producing a compact and a sprayed jet ( <a href="#">refer to 5.1.5</a> )	In accordance with the number of hydrants fitted on board ship
	.2 air-foam nozzles ( <a href="#">refer to 5.1.6</a> )	Not less than four air-foam nozzles, considering the requirements of <a href="#">3.7.2.2</a>
	.3 foam extension pipes ( <a href="#">refer to 5.1.7</a> )	In accordance with the number of air-foam nozzles for fire extinction in cargo tanks of oil tankers
	.4 portable foam generators or portable combination-foam production units ( <a href="#">refer to 5.1.19</a> )	Twice the rated number of foam generators
	.5 extension pipes ( <a href="#">refer to 5.1.7</a> )	50 % of the number of portable foam generators or combination-foam production units intended for fire extinction in the cargo tanks of oil tankers
<b>3</b>	Portable foam applicator ( <a href="#">refer to 5.1.8</a> )	<p><b>1</b> In machinery spaces at least one set in spaces containing internal combustion engines and one set in each boiler room or externally close to the entrance to the boiler room</p> <p><b>2</b> In each fuel distributing station and each cargo hose room, 1 set</p> <p><b>3</b> In working spaces referred to in <a href="#">1.5.8.1</a>, 1 set per fire hydrant fitted, but not more than 3 sets are required for each space. A space of less than 150 m<sup>2</sup> need not have more than 1 set</p> <p><b>4</b> In ships with spaces specified in <a href="#">1.5.4.3</a>, <a href="#">1.5.4.4</a> and <a href="#">1.5.9</a> not less than two sets for use in these spaces and additionally one set in each such space if vehicles with fuel in their tanks for self-propulsion are carried therein. There is no need to provide sets for weather decks used for the carriage of vehicles with fuel in their tanks, as well as for cargo spaces used for the carriage of vehicles with fuel in their tanks which are loaded in open or closed containers</p> <p><b>5</b> On open deck of container ships, 2 sets</p>
<b>4</b>	Portable foam fire extinguishers, dry powder fire extinguishers and carbon dioxide fire extinguishers ( <a href="#">refer to 5.1.9</a> ). The use of dry powder fire extinguishers is permitted in all spaces instead of foam and carbon dioxide fire extinguishers except for the spaces where the energized electrical and radio equipment is installed of over 1000 V	<p>Ships of gross tonnage 1000 and above shall have at least 5 portable fire extinguishers. The minimum number of fire extinguishers at control stations, accommodation and service spaces shall be determined on the basis of 2 fire extinguishers for every 25 m or part thereof, of the deck length on which such spaces are situated, but not less than the number required in accordance with the following provisions</p> <p><b>1</b> Control stations:</p> <p><b>1.1</b> 1 foam fire extinguisher for each space, 1 fire extinguisher being permitted to be fitted in the corridor for a group of small spaces with a total area of up to 50 m<sup>2</sup>, provided that the entrances to</p>

		<p>the spaces are adjacent and situated in the same corridor. One additional carbon dioxide fire extinguisher when main switchboards are arranged in the main machinery control room;</p> <p><b>1.2</b> 1 carbon dioxide fire extinguisher for each space or group of spaces (as specified in <a href="#">4.1.1</a> of this Table) containing electrical or radio equipment, as also for chart compartments;</p> <p><b>1.3</b> 1 foam fire extinguisher for each space containing an emergency diesel-generator or a fire diesel-driven pump;</p> <p><b>1.4</b> two dry powder fire extinguishers in the wheelhouse. If the wheelhouse is less than 50 m<sup>2</sup>, only 1 fire extinguisher is required. If the wheelhouse is adjacent with the chartroom and has a door giving direct access to the chartroom, no additional fire extinguisher is required. The same applies to the safety centres if they are within the boundaries of the wheelhouse in passenger ships</p> <p><b>2</b> Accommodation and service spaces:</p> <p><b>2.1</b> for each full or partial 25 m of length of corridors within each deck and main vertical zone, 1 foam fire extinguisher;</p> <p><b>2.2</b> for each full or partial 250 m<sup>2</sup> of area of public spaces, 1 foam fire extinguisher. For spaces less than 15 m<sup>2</sup> in area fire extinguishers fitted near them may be used;</p> <p><b>2.3</b> in galleys and bakeries with oil-fired equipment, 1 foam fire extinguisher for each space. For galleys with deep-fat fryers, 1 additional fire extinguisher fit for extinguishing cooking grease, fat and oil;</p> <p><b>2.4</b> in galleys and bakeries with electrical, steam, coal- or gas-fired equipment, having the area of more than 50 m<sup>2</sup>, 1 foam or carbon dioxide fire extinguisher;</p> <p><b>2.5</b> in other domestic service spaces, 1 foam fire extinguisher (where fire extinguishers are available in the corridor, at the entrance to the space, provision of fire extinguishers within the space is not compulsory);</p> <p><b>2.6</b> in each stairway enclosure and in each lobby, 1 foam fire extinguisher;</p> <p><b>2.7</b> in storerooms for readily flammable (refer also to <a href="#">3.1.3.4</a>) and combustible materials, 1 foam fire extinguisher for each space. Where the storeroom area is less than 50 m<sup>2</sup>, the fire extinguishers may be kept in the corridor in close vicinity of the entrance to the space concerned or group of small spaces (with a total area not more than 50 m<sup>2</sup>);</p> <p><b>2.8</b> in the hospital, 1 dry powder fire extinguisher</p> <p>In addition to the above number of fire extinguishers, within the other ship's spaces the number of fire extinguishers shall be determined as follows</p> <p><b>3</b> In machinery spaces containing internal combustion engines the portable foam fire extinguishers shall be located within 10 m from any point of the space. Each such space shall contain not less than 2 fire extinguishers</p> <p><b>4</b> In machinery spaces nearby each boiler front of oil-fired boiler and in each space where any part of oil fuel unit is located, at least 2 foam fire extinguishers or equivalent shall be provided. In enclosed spaces with oil-fired inert gas generators, incinerators and waste disposal units, 2 foam fire extinguishers</p>
--	--	---

		<p><b>5</b> In machinery spaces containing steam turbines or enclosed steam engines the number of fire extinguishers is determined in accordance with <a href="#">4.3</a>. However, such fire extinguishers shall not be required in addition to those specified in <a href="#">4.4</a></p> <p><b>6</b> In spaces containing electric machinery or equipment:</p> <p><b>6.1</b> 1 carbon dioxide fire extinguisher, for spaces containing main internal combustion or steam machinery, if the total power of the main machinery is less than 74 kW;</p> <p><b>6.2</b> 2 carbon dioxide fire extinguishers, for spaces containing main internal combustion or steam machinery, if the total power of the main machinery is equal to, or more than 740 kW;</p> <p>1 carbon dioxide fire extinguisher for each electric generator or group of generators, the total power being 500 to 1000 kW;</p> <p>1 carbon dioxide fire extinguisher for each space or group (not more than three) of small spaces containing auxiliary machinery with electrical drives and for special electrical spaces.</p> <p>The carbon dioxide fire extinguishers required by this sub-item shall be provided in the above spaces whether or not provision is made for foam extinguishers required by other sub-items of this Table</p> <p><b>7</b> In separate spaces containing switchboards, 2 carbon dioxide fire extinguishers per space. In space having an area of 15 m<sup>2</sup>, 1 carbon dioxide fire extinguisher, near the entrance to the space</p> <p><b>8</b> At the entrance to accumulator battery rooms, other than those for radio stations and emergency lighting, 1 carbon dioxide fire extinguisher per space</p> <p><b>9</b> In compartments for auxiliary machinery, 1 foam fire extinguisher, when the space area is 50 m<sup>2</sup> and more, otherwise the fire extinguisher placed near the entrance to such space may be sufficient</p> <p><b>10</b> For oil fuel tanks, other than those of double bottom, not less than 2 foam fire extinguishers in each space adjacent to the walls or decks of the tanks. If such adjacent spaces are already provided with fire extinguishers, no additional fire extinguishers are required</p> <p><b>11</b> In cargo pump rooms, 2 foam fire extinguishers; in other pump rooms, fuel oil distribution stations, in the fuel pipe trunks, hose spaces, 1 foam fire extinguisher for each 30 m<sup>2</sup> of the space floor</p> <p><b>12</b> In working spaces, 2 foam fire extinguishers, if the space area is under 100 m<sup>2</sup>, plus 1 foam fire extinguisher for every 250 m<sup>2</sup> or part thereof, if the space area is more than 100 m<sup>2</sup></p> <p><b>13</b> In welding shops and in storerooms for welding equipment, 1 foam fire extinguisher and one carbon dioxide fire extinguisher per space</p> <p><b>14</b> In special category spaces, cargo spaces for motor vehicles with fuel in their tanks and in ro-ro cargo spaces on each deck, 1 fire extinguisher for each 20 m of deck length on both sides. At entrances to such spaces from accommodation and machinery spaces, 1 foam fire extinguisher. There is no need to provide additional fire extinguishers for weather decks used for the carriage of vehicles with fuel in their tanks, as well as for cargo spaces used for the carriage of vehicles with fuel in their tanks which are loaded in open or closed containers</p> <p><b>15</b> At each entrance in the periodically unattended machinery spaces of category A, 1 foam fire extinguisher</p> <p><b>16</b> In workshops forming part of machinery spaces, 1 dry powder fire extinguisher</p>
--	--	--



		<p><b>17</b> During carriage of dangerous goods on deck, 2 fire extinguishers each having a capacity of not less than 6 kg of dry powder or equivalent</p> <p><b>18</b> On the weather deck of tankers, 2 fire extinguishers each having weight of not more than 23 kg in the charged condition</p> <p><b>19</b> 1 fire extinguisher for each BWMR. In BWMR containing UV-type BWMS, fire extinguisher shall be suitable for electrical fires (also refer to <a href="#">2.1.5.10.12</a>)</p>
<b>5</b>	Foam fire extinguishers of at least 45 l capacity or at least 16 kg carbon dioxide or dry powder fire extinguishers (refer to <a href="#">5.1.10</a> and <a href="#">5.1.11</a> )	<p><b>1</b> In machinery spaces containing internal combustion engines in number according to <a href="#">5.1.10.4</a></p> <p><b>2</b> In machinery spaces containing steam turbines or enclosed steam engines in number according to <a href="#">5.1.10.4</a>, however such fire extinguishers are not required if the space is protected by a fixed fire extinguishing system according to <a href="#">Table 3.1.2.1</a></p> <p><b>3</b> In the working spaces, referred to in <a href="#">1.5.8.1</a>, 1 fire extinguisher mentioned in <a href="#">5.1.11</a> for every 300 m<sup>2</sup> or part thereof, of each working space (bounded by watertight and gastight bulkheads)</p> <p><b>4</b> In spaces containing electric generators or propulsion motors with the total power output being 1000 to 5000 kW, 1 fire extinguisher according to <a href="#">5.1.11</a> for each space</p> <p><b>5</b> In separate spaces containing electric switchboards if the switchboard length is more than 5 m and the space is not protected by means of a fire smothering system, 1 fire extinguisher mentioned in <a href="#">5.1.11</a> for a space</p>
<b>6</b>	Foam fire extinguishers, at least 136 l capacity, or at least 45 kg carbon dioxide fire extinguishers or dry powder fire extinguishers (refer to <a href="#">5.1.10</a> and <a href="#">5.1.11</a> )	<p><b>1</b> In machinery spaces containing oil-fired boilers — one fire extinguisher per each space. In boiler rooms with domestic boilers of less than 175 kW and in case of boilers protected by fixed local application fire extinguishing systems, the fire extinguisher is not required</p> <p><b>2</b> In spaces containing electric generators and propulsion motors with the total power output 5000 kW and over, 1 fire extinguisher according to <a href="#">5.1.11</a> for a space.</p>
<b>7</b>	Metal receptacles containing sand or sawdust ( <a href="#">refer to 5.1.12</a> )	<p>Three fire extinguishers in accordance with <a href="#">item 5</a> of this Table may be used instead of one fire extinguisher prescribed by this item</p> <p>1 receptacle in each firing space in each boiler room with oil-fired boilers, and each space containing a part of the fuel oil unit, as well as near lamp and paint lockers, fuel filling and distributing positions and in other fire hazardous areas where fuel oil or other flammable liquids are liable to spread (except for machinery spaces)</p> <p>1 receptacle containing sand or dry sawdust impregnated with soda may be replaced by 1 portable foam fire extinguisher</p>
<b>8</b>	Blankets ( <a href="#">refer to 5.1.13</a> )	<p><b>1</b> 1 blanket for every 40 m, or part thereof, of open deck length of oil tankers and passenger ships</p> <p><b>2</b> In all other ships not referred to in <a href="#">8.1</a> of this Table, 1 blanket, if the ship is up to 1000 gross tonnage, and 2 blankets, if the ship is of 1000 gross tonnage and upwards</p> <p><b>3</b> In machinery spaces of category A in ships of more than 500 gross tonnage, 1 blanket for each space</p> <p><b>4</b> In working spaces indicated in <a href="#">1.5.8.1</a>, 1 blanket for each space</p>

9	Sets of fire fighting tools ( <a href="#">refer to 5.1.14</a> )	For ships of less than 2000 gross tonnage, 1 set For ships of 2000 to 4000 gross tonnage, 2 sets For ships of 4000 to 10000 gross tonnage, 3 sets For ships of 10000 gross tonnage and upwards, 4 sets. N o t e . Not required for pontoons for technological and dry cargo transportation services having no machinery spaces.
10	Fireman's outfit ( <a href="#">refer to 5.1.15</a> )	<b>1</b> In passenger ships, 2 sets and additionally for every 80 m, or part thereof, of the total length of all accommodation and service spaces on the deck they are situated, or if there are more than one such deck on the deck with the maximum total length of the above spaces 2 sets in accordance with <a href="#">5.1.15</a> and 2 sets of personal outfit in accordance with <a href="#">5.1.15.1.1–5.1.15.1.5</a> . In passenger ships carrying more than 36 passengers, two additional fireman's outfits shall be provided for each main vertical zone. However, for stairway enclosures which constitute individual main vertical zones and for the main vertical zones in the fore or aft end of the ship, which do not contain spaces of categories (6), (7), (8) or (12) ( <a href="#">refer to 2.2.1.3</a> ), no additional fireman's outfits are required. However, in passenger ships of 24 m in length and over and of less than 300 gross tonnage, 1 set of personal outfit in accordance with <a href="#">5.1.15.1.1–5.1.15.1.5</a> . <b>2</b> In oil tankers and combination carriers of 500 gross tonnage and upwards, 4 sets <b>3</b> In cargo ships of 150 gross tonnage and upwards, but less than 500 gross tonnage, as well as in fishing vessels of 24 m in length and over and of 150 gross tonnage and upwards, but less than 500 gross tonnage, 1 set of personal equipment, breathing apparatus and lifeline; in cargo ships and fishing vessels of 500 gross tonnage and upwards, 2 sets <b>4</b> In ships equipped with helidecks additional equipment according to 6.4.1.15.4, Part XVII "Distinguishing Marks and Descriptive Notations in the Class Notation Specifying Structural and Operational Particulars of Ships" shall be provided. N o t e . Not required for pontoons for technological and dry cargo transportation services having no machinery spaces.
11	Portable electric or pneumatic drills ( <a href="#">refer to 5.1.16</a> )	In all ships of 4000 gross tonnage and upwards, 1 drill per ship
12	Portable fire motor-pumps complete with suction and delivery hoses and fire hose nozzles ( <a href="#">refer to 5.1.17</a> and <a href="#">8.7.2.5</a> )	On the ships of less than 500 gross tonnage — in accordance with <a href="#">8.7.2.1</a> , <a href="#">8.7.2.6</a>
13	International shore connection ( <a href="#">refer to 5.1.18</a> )	In all ships of 500 gross tonnage and upwards, and on the floating cranes, 1 set
14	Foam concentrate	Full amount of foam concentrate required by <a href="#">3.7</a>
15	Gaz analyzers ( <a href="#">refer to 5.1.22</a> ):	
	.1 for vapours of flammable liquids and exhaust gases;	In ships carrying motor vehicles with fuel oil (other than diesel oil) in their tanks and in ships with spaces specified in <a href="#">1.5.4.3</a> , <a href="#">1.5.4.4.1</a> , <a href="#">1.5.9</a> – 1
	.2 for vapours of flammable liquids;	In oil tankers and combination carriers — 2 ( <a href="#">refer to 5.1.22</a> ) In oil tankers fitted with inert gas system — 2 portable gas analyzer capable to operate in the inert gas atmosphere in addition to the above
	.3 for oxygen content;	In oil tankers and combination carriers — 2 ( <a href="#">refer to 5.1.22</a> )

	.4 for oxygen content and gas detection	In ships carrying solid bulk cargoes which are liable to emit toxic or flammable gases or cause oxygen depletion in the cargo space — 1
	.5 for ozone	In ships fitted with ozone-based BWMS — 1 (refer to <a href="#">5.1.25.5</a> )
16	Fog applicator ( <a href="#">refer to 5.1.20</a> )	<p>1 In passenger ships carrying more than 36 passengers: in each machinery space of category A, 2 pcs</p> <p>2 In passenger ships carrying more than 36 passengers: for each pair of breathing apparatuses (<a href="#">refer to 5.1.15.2</a>), 1 pc</p> <p>3 In each space for the carriage of vehicles, ro-ro spaces and special category spaces intended for the carriage of vehicles with fuel in their tanks for self propulsion, 3 pcs. There is no need to provide applicators for weather decks used for the carriage of vehicles with fuel in their tanks as well as for cargo spaces used for the carriage of vehicles with fuel in their tanks which are loaded in open or closed containers</p>
17	Fire buckets ( <a href="#">refer to 5.1.21</a> )	In ships having no water fire main system, 3 buckets
18	Emergency Escape Breathing Devices (EEBD) ( <a href="#">refer to 5.1.23</a> )	<p>1 Within accommodation spaces:</p> <p>.1.1 in cargo ships, 2 pcs;</p> <p>.1.2 In passenger ships, 2 pcs in each main vertical zone. In passenger ships carrying more than 36 passengers, in addition to those required, two additional EEBD shall be provided in each main vertical zone. This requirement is not applied to stairway enclosures comprising separate main vertical zones and to main vertical zones at both ends of a ship which do not have spaces of categories (6), (7), (8) or (12) specified in <a href="#">2.2.1.3</a></p> <p>2 In machinery spaces EEBD shall be located at easily visible places, which can be easily accessed in case of fire. The location of EEBD shall take into account the arrangement of the equipment and the number of persons usually manning the space:</p> <p>.2.1 in machinery spaces of category A containing internal combustion engines used for main propulsion;</p> <p>.2.1.1 in the main machinery control room, if located within the machinery space, 1 pc;</p> <p>.2.1.2 in workshop area, 1 pc. If there is a direct exit from the workshops, not entering the engine room, an EEBD is not required;</p> <p>.2.1.3 close to each ladder constituting the means of escape from machinery space (refer to 4.5.5.2 and 4.5.10.2, Part VII "Machinery Installations"), 1 pc at each deck or platform;</p> <p>.2.2 in machinery spaces of category A other than those specified in <a href="#">18.2.1</a>, 1 pc, as a minimum, located in accordance with <a href="#">18.2.1.3</a>;</p> <p>.2.3 in other machinery spaces, the necessity, number and location of EEBD shall be determined on agreement with the Register;</p> <p>.2.4 in BWMR, except for BWMS of category 1 according to Table 8.7.2, Part VIII "Systems and Piping", 1 pc. (refer to <a href="#">5.1.25.6</a>)</p> <p>3 Provision shall be made for two spare EEBD for passenger ships and one spare EEBD for cargo ships</p> <p>4 Provision shall be made for at least one EEBD for training in every ship</p>

<b>19</b>	Water mist lance ( <a href="#">refer to 5.1.24</a> )	In container ships and other ships of 500 gross tonnage and upwards designed to carry containers on or above the weather deck — 1
<b>20</b>	Set of protection equipment for the crew members who are engaged in the servicing, maintenance and repair of BWMS ( <a href="#">refer to 5.1.25</a> )	In ships fitted with BWMS storing, introducing or generating chemicals, at least 3 sets ( <a href="#">refer to 5.1.25</a> )

**.5** on cargo ships:

**.5.1** of 1000 and more gross tonnage, the number of fire hoses is determined one fire hose per each 30 m of length and one spare fire hose, but not less than five hoses per ship. This number doesn't include any hoses required for machinery or boiler spaces. The Register may require to increase number of hoses in order to ensure sufficient number of hoses and their accessibility at any time, considering the type of ship and character of voyages made by the ship. A ship carrying dangerous goods shall be equipped with three additional hoses and nozzles in excess of those required above;

**.5.2** of less than 1000 gross tonnage, the number of fire hoses is calculated in accordance with [5.1.4.5.1](#). However, the number of hoses shall be not less than three.

**5.1.5** Standard nozzle sizes shall be 12, 16 and 19 mm or close thereto.

Nozzles sizes greater than 12 mm need not be used in accommodation, service and working spaces. In ships under 150 gross tonnage nozzles having 10 mm in diameter are permitted to be used. For machinery spaces and exterior locations, the nozzle size shall be such as to obtain maximum discharge possible from two jets at the pressure at each hydrant mentioned in [Table 3.2.1.1](#) from the smallest pump, but nozzles sizes greater than 19 mm need not be used.

Nozzles shall be of an approved dual-purpose type with a shut-off device. Fire hose nozzles made of plastic type material, e.g. polycarbonate, are considered acceptable provided capacity and serviceability are documented and the nozzles are found suitable for the marine environment.

**5.1.6** Air-foam nozzles for delivery of low-expansion foam ([refer to 3.7](#)) from fixed fire extinguishing system shall comply with the following requirements:

**.1** on cargo tank deck of oil tankers each nozzle shall be capable of delivering 400 l/min of foam, in this case, the length of jet delivered by the fire hose at still air shall be not less than 15 m ([refer also to 3.7.2.3](#));

**.2** in ship's spaces each nozzle shall be capable of delivering at least 2 l/min of foam solution per square meter of deck area;

**.3** prototype tests of the monitors and foam applicators shall be performed to ensure the foam expansion and drainage time of the foam produced does not differ more than  $\pm 10\%$  of that determined in [3.7.1.2](#).

**5.1.7** Foam extension pipes with a hook-shaped bell-mouth at the end (for low-expansion foam) and extension pipes fitted with light supports at the middle (for medium-expansion foam) shall be of about 4 m in length.

An extended air-foam nozzle having a hook-shaped bell-mouth may be used in addition to the usual air-foam nozzle instead of a foam extension pipe.

**5.1.8 Portable foam applicator unit.**

**5.1.8.1** A portable foam applicator unit shall consist of a foam nozzle/branch pipe, either of a self-inducing type or in combination with a separate inductor, capable of being connected to the fire main by a fire hose, together with a portable tank containing at least 20 l of foam concentrate and at least one spare tank of foam concentrate of the same capacity.

**5.1.8.2** The nozzle/branch pipe and inductor shall be capable of producing effective foam suitable for extinguishing an oil fire, at a foam solution supply rate of at least 200 l/min at the nominal pressure in the fire main.

**5.1.8.3** The foam concentrate shall be approved by the Register based on IMO circular MSC.1/Circ.1312.

**5.1.8.4** The values of the foam expansion and drainage time of the foam produced by the portable foam applicator unit shall not differ more than  $\pm 10\%$  of that determined in IMO circular MSC.1/Circ.1312.

**5.1.8.5** The portable foam applicator unit shall be designed to withstand clogging, ambient temperature changes, vibration, humidity, shock, impact and corrosion normally encountered on ships.

**5.1.8.6** The portable foam applicator units shall be located near hydrants.

**5.1.9** Portable fire extinguishers shall be of type and design approved by the Register taking into account the IMO Guidelines (refer to IMO resolution A.951(23)) and shall comply with the following requirements:

**.1** no fire extinguishing medium shall be used which, either by itself or under anticipated conditions of application, would give off toxic gases in amounts dangerous to human health;

**.2** fire extinguishers shall have safety devices preventing the pressure therein to rise above permissible limits;

**.3** for 100 % of the first ten fire extinguishers and 50 % of the remaining fire extinguishers capable of being recharged onboard shall be provided with spare chargers. No more than 60 pieces of spare charges of the total number of fire extinguishers are required;

**.4** for fire extinguishers which cannot be recharged onboard, additional portable fire extinguishers of the same quantity, type, capacity and number, as determined in [5.1.9.3](#) above, shall be provided in lieu of spare charges;

**.5** fire extinguishers shall be mounted in special brackets of quick-detachable type at places easily visible and accessible in case of fire, and in such a way that their serviceability is not impaired by the weather, vibration and other external factors.

They shall be located at the height of not more than 1,5 m from deck and not closer than 1,5 m from sources of heat;

**.6** one of the portable fire extinguishers intended for use in any space shall be stowed close to the entrance to that space;

**.7** each powder or carbon dioxide fire extinguisher shall have capacity not less than 5 kg, and each foam fire extinguisher — not less than 9 l.

Mass of any portable fire extinguisher shall not exceed 23 kg. Portable fire extinguishers shall have efficiency, which, in compliance with the recognized international or national standard, is at least equivalent to the efficiency of a 9-litre wetting agent fire extinguisher, which is determined when extinguishing model fire seat of A class, rating 2A;

**.8** powder fire extinguishers shall be selected with regard for the purpose of the powder extinguishing medium;

**.9** in the machinery spaces fire extinguishers shall be so located that an extinguisher is not more than 10 m walking distance from any point in the space;

**.10** carbon dioxide fire extinguishers shall not be located in accommodation spaces. In control stations and other spaces containing electrical or electronic equipment or facilities required for ship safety, fire extinguishers shall be provided, charged with the fire extinguishing medium, which does not conduct electricity and does not cause harm to equipment and facilities;

**.11** portable fire extinguishers shall be provided with a visual indication of discharge;

**.12** casing and other components of the fire extinguishers subject to internal pressure shall be tested by hydraulic pressure:

2,7 times exceeding the maximum working pressure, but not less than 5,5 MPa for the low pressure fire extinguishers (with working pressure not more than 2,5 MPa at environmental temperature of 20 °C);

determined in accordance with recognized national standard on safety of pressure vessels – for high pressure fire extinguishers (with working pressure more than 2,5 MPa at environmental temperature of 20 °C);

**.13** fire extinguishers shall be suitable for operation under exposure to ambient temperatures according to Table 2.3.1-2, Part VII "Machinery Installations" with due regard for the materials used and maximum degree of filling established by the manufacturer. The degree of filling for carbon dioxide fire extinguishers shall not exceed 0,75 kg/l;

**.14** materials used for the manufacture of fire extinguishers, which can be exposed to marine environment during operation shall be selected with consideration for their compatibility;

**.15** each fire extinguisher shall be clearly marked with at least the following information:

**.15.1** manufacturer;

**.15.2** types of fire for which the fire extinguisher is suitable and its fire-extinguishing capability (i.e. capability to extinguish a model fire seat under certain conditions);

**.15.3** type and nominal quantity of extinguishing medium with which the fire extinguisher is charged;

**.15.4** information on the Register approval;

**.15.5** instruction on actuating the fire extinguisher in the form of several pictograms with explanatory note in the language understandable to potential user, in general case, in Russian and in English;

**.15.6** year of manufacture;

**.15.7** range of temperatures within which the fire extinguisher is operable;

**.15.8** test pressure.

**5.1.10** Foam fire extinguishers of at least 45 and 135 l shall meet the following requirements:

**.1** fire extinguishers shall be located within the protected space, in regular fixed places near the exits.

Only fresh water shall be used for charging the fire extinguishers;

**.2** the air for an air-foam extinguisher shall be kept in a cylinder provided solely for that particular extinguisher. The quantity of air in the cylinder shall be at least 25 % in excess of the rated amount. The air cylinder shall be fitted with a pressure gauge;

**.3** fire extinguishers having capacity of not less than 135 l shall be provided with hoses wound on reels and provide access to any place of boiler room;

**.4** location of 45-litre fire extinguishers (or their equivalents) in machinery spaces, specified in [5.1](#) and [5.2](#) of Table 5.1.2, shall ensure the delivery of the fire extinguishing medium to any part of the fuel system, to pressure lubricating systems, drives casings covering turbine parts lubricated under pressure, engines and associated drives and other fire risk equipment. In cargo ships a fire extinguisher having a capacity of 45 l (or equivalent) may be located outside the space for which it is intended.

**5.1.11** Carbon dioxide or dry powder fire extinguishers of at least 16 kg, as well as carbon dioxide or dry powder fire extinguishers of at least 45 kg shall meet the following requirements:

**.1** carbon dioxide fire extinguishers shall not be used in spaces of such volume that the complete discharge of the carbon dioxide contained in the cylinders is liable to cause concentration of carbon dioxide in excess of 5 %;

**.2** an extinguishing medium shall be delivered to any part of the protected space through fire hoses of 10 – 15 m in length and through pipes if necessary;

**.3** fire extinguishers shall be placed near the exits in the spaces and shall be protected against mechanical damage.

**5.1.12** Metal receptacles containing sand or dry sawdust impregnated with soda shall comply with the following requirements:

**.1** the capacity of the receptacles shall be at least 0,1 m<sup>3</sup>;

**.2** each receptacle shall be provided with a readily opening watertight cover, a scoop and a device for holding the cover in the open position unless it is an easily removable cover.

**5.1.13** Fire smothering blankets shall comply with the following requirements:

**.1** they shall be sufficiently stout and durable;

**.2** as a rule, they are to be made of non-combustible material; clean unraised thick felt may be used;

**.3** blankets shall be stowed in special cases or lockers;

**.4** they shall have an area of at least 3 m<sup>2</sup> and be similar to a square or circle in shape.



**5.1.14** Complete sets of fire fighting tools shall comply with the following requirements:

- .1** one complete set shall include one fire axe and one light-weight fire crowbar;
- .2** the sets of fire fighting tools shall be stowed on regular boards. The fastening of the tools shall permit of ready availability of the tools for use;
- .3** in ships for the carriage of motor vehicles with fuel (other than diesel oil) in their tanks one set of tools shall be placed near the exits from the accommodation and machinery spaces to cargo spaces.

**5.1.15** The fireman's outfit shall include:

- .1** personal outfit consisting of:
  - .1.1** protective clothing of material approved by the competent bodies to protect the skin from the heat radiating from the fire and from burns and scalding by steam. The outer surface shall be water-resistant; tarpaulin and polyvinylchloride clothes are not allowed for the outer material of the fireman's outfit;
  - .1.2** boots and mittens of rubber or of some other dielectric material;
  - .1.3** a rigid helmet ensuring effective protection against impacts;
  - .1.4** a portable safe manual lantern with a minimum burning period of 3 h.

In ships carrying dangerous goods, in oil tankers and other ships having cargo spaces and spaces where a flammable gas, vapour or dust/air mixture is present or may arise, provision shall be made for explosionproof lamps with explosion group 1Exd or 1Exp. The explosion group and temperature class shall be consistent with the category of the cargo carried. For example, they are 1Exd IIA T3 and 1Exp IIT3 for oil, kerosene and a number of gasolines;

**.1.5** a fire axe with a helve made of hard wood; if the helve is made of some other material, it shall be insulated with some suitable dielectric material;

**.2** a self-contained compressed air-operated breathing apparatus, the volume of air contained in the cylinders of which shall be at least 1200 l or other self-contained breathing apparatus which shall be capable of functioning for at least 30 min. Compressed air breathing apparatus shall be fitted with an audible alarm and a visual or other device which will alert the user before the volume of the air in the cylinder has been reduced to no less than 200 l.

Each breathing apparatus shall be provided with a flexible fire resisting lifeline, not less than 30 m in length. The lifeline shall be subjected to a test by statical load of 3,5 kN for 5 min and withstand this load without damage. The lifeline shall be fastened to the harness of the apparatus or to a separate belt by means of a snap hook to preclude spontaneous separation of the line from the apparatus.

Provision shall be made for two spare charges or two spare breathing apparatuses per each required self-contained breathing apparatus. All air cylinders for the apparatus shall be interchangeable.

Passenger ships carrying not more than 36 passengers and cargo ships equipped with suitably located means for fully recharging breathing air cylinders by clean air may have only one spare charge for each breathing apparatus or one spare breathing apparatus per each required self-contained breathing apparatus.

In passenger ships carrying more than 36 passengers, two spare charges or two spare breathing apparatus shall be provided per each required self-contained breathing apparatus.

Passenger ships carrying more than 36 passengers shall be fitted with a suitably located means for fully recharging breathing air cylinders, free from contamination.

For fire drills, all ships shall be provided with an onboard means of recharging breathing apparatus cylinders or a suitable number of spare cylinders — at least one set of cylinders for each mandatory breathing apparatus, unless additional spare cylinders are required by the shipboard safety management system (SMS). No additional cylinders are required for fire drills for breathing apparatus sets required by Section 7 of this Part, the IMSBC Code, the IBC Code or the IGC Code. The means for recharging shall be either:

breathing air compressors supplied from the main and emergency switchboard, or independently driven, with a minimum capacity of 60 l/min per required breathing apparatus, not to exceed 420 l/min; or

self-contained high-pressure storage systems of suitable pressure to recharge the breathing apparatus used on board, with a capacity of at least 1200 l per required breathing apparatus, not to exceed 50 000 l of free air;

**.3** minimum of two two-way portable radiotelephone apparatus of an explosion-proof type or intrinsically safe suitable for use in zone 1 hazardous areas as defined in IEC 60079 for each fire party. The minimum requirements in respect to the apparatus group and temperature class of portable apparatuses shall be consistent with the most restrictive requirements for the hazardous area zone on board which is accessible to fire party.

Fireman's outfit and personal equipment shall be ready for use and stored in readily accessible locations that are permanently and clearly marked and where more than one fireman's outfit or more than one set of personal equipment is carried on board they shall be stored in widely separated places.

In passenger ships at least two fireman's outfits and, in addition, one set of personal equipment shall be available at any such place. At least two fireman's outfits shall be stored in each main vertical zone.

**5.1.16** Portable electric drills shall be provided with an electric cable of sufficient length. The use of pneumatic drills instead of electric ones is permitted. The electric or pneumatic drills specified in [item 11](#) of Table 5.1.2 may be reckoned in the number of the items prescribed for other types of ship's outfit.

**5.1.17** Portable diesel fire motor-pumps shall comply with the following requirements:

**.1** the pump shall ensure simultaneous operation of at least two fire hose nozzles with an outlet diameter of at least 12 mm at a pump discharge pressure of at least 0,2 MPa and at vacuum in suction piping not less than 0,05 MPa; centrifugal pumps shall be fitted with a self-priming device

**.2** the pump motor shall be capable of being readily started either by hand or by special starter both at above-zero and below-zero ambient temperatures. The motor shall be provided with a quantity of fuel to ensure the operation of the pump for 1,5 h without refuelling; the ship shall carry an additional reserve of fuel for refuelling;

**.3** each motor-pump shall be provided with suction hoses, to a total length of 8 m, fitted with a suction strainer and a non-return valve, two delivery hoses, each 10 m long, two-dual purpose fire hose nozzles with an outlet diameter of at least 12 mm and a branch coupling for connecting two hoses;

**.4** the dimensions and type of coupling for the delivery hoses and nozzles shall correspond to those used in the fixed water fire extinguishing systems fitted in the ship;

**.5** the motor-pumps shall be provided with tools and accessories in compliance with the manufacturer's specification;

**.6** motor-pumps for use in ships navigating under northern latitudes shall be placed in heated spaces, together with the suction and delivery hoses and nozzles.

**5.1.18** The international shore connection ([refer to Fig. 5.1.18](#)) for water supply from shore shall be in accordance with the following specification:

outside diameter of flange — 178 mm;

inside diameter of flange — 64 mm;

bolt circle diameter — 132 mm;

holes — 4 equispaced holes 19 mm diameter equidistantly placed, slotted to the flange periphery;

flange thickness — at least 14,5 mm;

bolts — 4 pcs, each 16 mm in diameter and 50 mm in length;

bolt nuts — 4 pcs, 16 mm in diameter;

washers for bolts — 8 pcs.

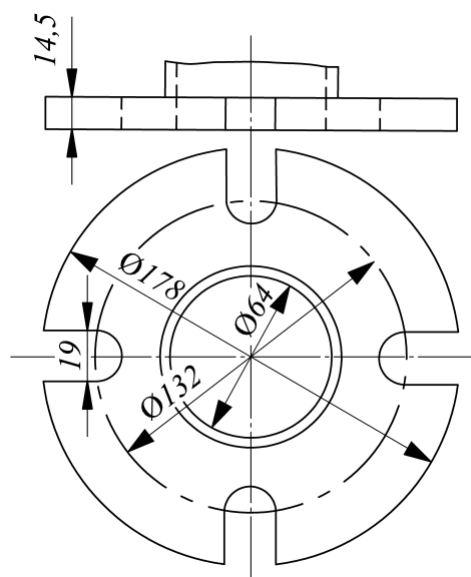


Fig. 5.1.18  
International shore connection (ship)

On one side the shore connection shall have a flat-faced flange with dimensions as above, and on the other a quick-acting coupling which shall correspond to the ship's hydrants and hoses both in dimensions and design.

The shore connection, gasket, bolts and nuts shall be made of materials suitable for 1,0 MPa.

The shore connection complete with gasket, four bolts, four nuts and eight washers shall be stowed together with other items of fire fighting outfit in an easily accessible position.

**5.1.19** Portable medium expansion mechanical foam generators and portable combination-foam production units shall comply with the following requirements:

- .1 concentrate solution discharge at a pressure of 0,6 MPa, not less than 360 l/min (refer also to [3.7.2.2](#));
- .2 foam jet range, at least 8 m;
- .3 rated number of foam generators/units shall be determined by the formula

$$N = Q/q \quad (5.1.19.3)$$

where  $Q$  = solution capacity of the system, in l/min;  
 $q$  = solution capacity of a foam generator/unit, in l/min.

50 % of the foam generators/units and extension pipes required by items [2.4](#) and [2.5](#) of Table 5.1.2 shall be placed in the poop, the remainder, in the forecastle and midship superstructure, if any.

**5.1.20** Fog applicator shall consist of L-shaped pipe with long side of about 2 m fitted for connection to fire hoses and short side of about 0,25 m equipped with fixed nozzle for producing water fog or fitted for connecting water-spraying nozzle.

These applicators shall be located near the fire hydrants and those for breathing apparatus near the latter.

**5.1.21** Fire buckets shall be provided with the hemp rope of sufficient length and shall be stowed on the open decks in easily accessible places. The buckets shall be painted red and bear inscription "fire".

**5.1.22** In oil tankers and combination carriers gas analyzers shall meet the following requirements:

- .1 provision shall be made for use of gas analyzers with gas sampling pipes as specified in 9.14.2, Part VIII "Systems and Piping";
  - .2 suitable means shall be provided for the calibration of gas analyzers;
  - .3 gas analyzers shall be provided with a set of spares supplied by the manufacturer;
- and
- .4 gas analyzers shall measure lower flammable limit (LFL).

Alternatively, ship may be equipped with two gas analyzers, each capable of measuring both oxygen and flammable vapour concentrations.

**5.1.23** In all passenger and cargo ships of 500 gross tonnage and over provision shall be made for emergency escape breathing devices (EEBD) of a Register-approved type which shall be only used for emergency escape from a compartment with a hazardous atmosphere. EEBD shall not be used by crew for fighting fires, entering oxygen deficient void spaces or tanks. In such cases a self-contained breathing apparatus specified in [5.1.15.2](#) shall be used.

EEBD shall meet the following requirements:

- .1 EEBD shall provide service duration of at least 10 min;
- .2 EEBD shall protect eyes, nose and mouth during escape and consist of a helmet fully covering head, neck and may cover portions of the shoulders, or a mask fully covering the face so as to form a complete seal around the eyes, nose and mouth, which is secured by suitable means. The helmets and masks shall be manufactured of flame resistant materials and include a clear window for viewing;
- .3 an inactivated EEBD shall be carried hands-free;
- .4 EEBD shall be designed so that to enable quick and easy dressing. Brief instructions or diagrams clearly illustrating their use shall be clearly printed on each EEBD.

An EEBD, when stored, shall be suitably protected from weather exposure.

Maintenance requirements, manufacturer's trademark and serial number, shelf life and date of manufacture shall be printed on each EEBD. EEBD intended for training shall have appropriate distinct marking.

The number and location of EEBD shall be indicated on fire control plans ([refer to 1.4](#)).

**5.1.24** The water mist lance shall, as a rule, consist of an L-shaped tube with a piercing nozzle capable to penetrate a container wall impacted at its back side intended for hammer impact and producing a low pressure water mist (at the main pressure 1,2 MPa and less) inside a confined space of the container.

The water mist lance shall be fitted for connection to fire hoses and equipped with a closing arrangement.

The water mist lance set may include the following:

- a lance consisting of a tube fitted for connection to fire hoses with the closing arrangement and a mist nozzle; and
- a hammer with the cylinder-pointed tip capable of making with a single blow a hole of the required diameter in a container wall or a portable drill with the metal bit of the appropriate diameter.

**5.1.25** Sets of protection equipment for the crew members who are engaged in the servicing, maintenance and repair of BWMS storing, introducing or generating chemicals, as recommended by the product manufacturers shall meet the following requirements:

- .1 set of protection equipment shall consist of large aprons, special gloves with long sleeves, suitable footwear, coveralls of chemical-resistant materials, and tight fitting goggles or face shields or both. The protective clothing and equipment shall cover all skin. This chemical-resistant equipment shall not be used for any other purposes;

**.2** work clothes and protective equipment shall be kept in easily accessible places and in special lockers. Such equipment shall not be kept within accommodation spaces, with the exception of new, unused equipment and equipment which has not been used since undergoing a thorough cleaning process. Notwithstanding the above, storage rooms for such equipment may be located within accommodation spaces if adequately segregated from living spaces such as cabins, passageways, dining rooms, bathrooms, etc. by divisions of fire integrity specified in accordance with [Tables 2.2.1.3-1](#), [2.2.1.3-2](#), [2.2.1.5-1](#), [2.2.1.5-2](#), [2.3.3-1](#), [2.3.3-2](#), [2.4.2-1](#), [2.4.2-2](#), [2.5.3-1](#), [2.5.3-2](#), [2.6.3-1](#), [2.6.3-2](#) depending on the ship purpose;

**.3** decontamination showers and an eyewash marked with emergency equipment signs (EES) (EES003 and EES004 accordingly) in accordance with IMO resolution A.1116(30) shall be available in a convenient location in close proximity to the BWMS and the chemical store rooms;

**.4** for the crew members engaged in the servicing, maintenance and repair of BWMS, a two-way portable radiotelephone apparatus shall be provided, in addition to those required by [5.1.15.3](#). This two-way radiotelephone apparatus shall be properly identified in order to avoid mix-up with the apparatus intended for other purposes.

Where the BWMS may release explosive gases, this two-way radiotelephone apparatus shall be of an explosion-proof type or intrinsically safe suitable for use in zone 1 hazardous areas as defined in IEC 60079.

This two-way radiotelephone apparatus is not required for maintenance of BWMS of category 1 according to Table 8.7.2, Part VIII "Systems and Piping";

**.5** a personal ozone detector, calibrated as per the manufacturer's specifications, shall be provided for each person engaged in the servicing, maintenance and repair of BWMS utilizing ozone;

**.6** BWMS shall be provided with Emergency Escape Breathing Devices (EEBD) complying with the requirements of [5.1.23](#). EEBD is not required for BWMS of category 1 according to Table 8.7.2, Part VIII "Systems and Piping".

Requirements of [5.1.25.1](#), [5.1.25.2](#), [5.1.25.3](#) may be reduced if the BWMS does not use or generate any toxic chemical substances. Herewith the risk assessment of the used substances shall be carried out based on data from the IMO reports issued during the basic and final approval procedures of the BWMS that make use of active substances (G9 Guidelines adopted by IMO resolution MEPC.169(57)), and "safety hazard" as listed in Chapter 17 of the IBC Code for the used substances.

## 5.2 SPARE PARTS AND TOOLS

**5.2.1** A ship shall carry spare parts and tools, the number of which shall be not less than that specified in [Table 5.2.1](#). The quantities prescribed in the Table apply to fixed fire extinguishing systems only.

**5.2.2** The spare parts and tools for the systems shall be kept in the fire extinction stations. Spare parts shall be suitably marked.

Table 5.2.1

Nos.	Description of spare parts and tools	Number per ship
<b>1</b>	Water fire main system:	
	.1 a fire hose of each length and diameter fitted complete with couplings	1 pc of each
	.2 connection couplings for each size fitted (if the ship is provided with hydrants of various diameters)	2 pcs
	.3 quick-acting couplings (hose couplings)	2 pcs (of each diameter)
	.4 quick-acting couplings (hose couplings) for ships of 4000 gross tonnage and upwards	4 pcs (of each diameter)
	.5 rubber rings for packing of joints between couplings, hoses and apparatuses	5 % of total number, but not less than 10 pcs
	.6 hose clamps	4 pcs (for ships of less than 300 gross tonnage, as many as the number of hoses, but not more than 4)
	.7 wrenches for engaging or disengaging couplings (where nozzles are fitted by means of a special wrench)	according to the number of hydrants.
	.8 fire hydrant of each size fitted, in assembly	1 pc of each size
	.9 handwheel to fire hydrant of each size fitted	1 pc of each size
	.10 valve disks with packing rings to fire hydrants of each size fitted	1 pc of each size
<b>2</b>	Sprinkler system:	
	.1 sprinkler heads, in assembly	The number of spare sprinkler heads shall be determined proceeding from their type and number already fitted on board: 6 — for systems having less than 300 heads; 12 — for systems having 300 to 1000 heads; 24 — for systems having more than 1000 heads
	.2 wrenches for sprinkler heads (where heads are fitted by means of a special wrench)	1 pc per section
	.3 parts for control valve	1 set, according to delivery specification
<b>3</b>	Pressure water-spraying, water-screen, drenching systems:	
	.1 spray nozzles of various types fitted in the system	5 % of total number of spray nozzles fitted
	.2 wrench for spray nozzles (where nozzles are fitted by means of a special wrench)	1 pc
<b>4</b>	Foam fire extinguishing system:	
	.1 hydrant of each size fitted, in assembly	1 pc
	.2 fixed air-foam nozzle or foam generator	1 pc
	.3 gauge glasses for tanks	1 pc
	.4 rubber rings for joints	10 pcs
<b>5</b>	Carbon dioxide smothering system:	
	.1 cylinder valves, assembled; for the number of cylinders:	
	below 50	1 pc
	50 to 100	2 pcs
	100 and over	3 pcs
	.2 wrenches for assembling and disassembling cylinder valves and other special valves	1 set per station

	.3 plugs to be fitted on pipes leading from cylinder valves, when cylinders are removed	25 % of the number of cylinders
	.4 protective diaphragms	In accordance with the number of cylinders
	.5 thrust bushes and washers for protective devices	10 % of the number of cylinders
	.6 non-return valves	5 % of total number, but not less than 1 pc
	.7 discharge nozzles of each type and size fitted	2 pcs
	.8 scales for weighing cylinders or carbon dioxide level gauge	1 pc
	.9 parts of tank carbon dioxide contents gauges	In accordance with delivery specification
<b>6</b>	Dry powder system:	
	.1 parts of release devices for hand hose lines and monitors	1 set of each
	.2 nozzles of each type and size	1 — 2 pcs
	.3 wrenches for assembling and disassembling valves, hand hose lines, nozzles	1 set
<b>7</b>	Aerosol system:	
	.1 generator of fire extinguishing aerosol	One generator of each type used
<b>8</b>	Miscellaneous items, for all systems:	
	.1 instruments and gauges: pressure gauges, vacuum gauges, thermometers of each type fitted in systems	1 pc of each
	.2 adequate quantity of packing material for onboard repairs	1 set
	.3 fuses for automatic closing of fire doors and dampers	In accordance with number of doors and dampers thus controlled
	.4 spare parts for pumps, fans, compressors and engines serving fire extinguishing systems	In accordance with Appendix 1 to Part VII "Machinery Installations"
	.5 spare parts for electrical equipment of fire extinguishing systems	In accordance with Section 21, Part XI "Electrical Equipment"



## **6 REQUIREMENTS FOR FIRE PROTECTION OF SPECIAL PURPOSE SHIPS AND SPECIAL FACILITIES ON SHIPS**

### **6.1 SHIPS EQUIPPED WITH HELIDECKS**

**6.1.1** Fire protection of ships equipped with helidecks shall comply with the requirements of 6.4, Part XVII "Distinguishing Marks and Descriptive Notations in the Class Notation Specifying Structural and Operational Particulars of Ships".

## 6.2 SPECIAL PURPOSE SHIPS

### 6.2.1 General.

**6.2.1.1** The fire protection of special purpose ships shall be arranged depending on the number of persons carried on board:

.1 not more than 60 persons — equivalent to that of cargo ships of more than 500 gross tonnage;

.2 more than 60, but not more than 240 persons — equivalent to that of passenger ships carrying not more than 36 passengers;

.3 more than 240 persons — equivalent to that of passenger ships carrying more than 36 passengers.

**6.2.1.2** Fire protection of working spaces specified in [1.5.8](#) shall be arranged with due regard for the purpose of the working space and equipment located therein. As a rule the fire protection of working spaces shall be equivalent to that of service spaces specified in [1.5.3](#).

### 6.2.2 Storerooms for explosives (magazines).

**6.2.2.1** In special purpose ships the arrangement of storerooms for explosives (magazines) may be permitted. The magazines shall be of the following types:

.1 integral magazines forming an integral part of the ship;

.2 portable magazines that are non-integral, portable magazines with a capacity of 3 m<sup>3</sup> or greater;

.3 magazine boxes that are non-integral, portable magazines with a capacity of less than 3 m<sup>3</sup>.

**6.2.2.2** Integral magazines shall be located in the forward or after portion of the ship and be located not less than one watertight space apart from the propeller shaft, propeller and rudder. They shall not be located below accommodation spaces, control stations and be adjacent to them.

**6.2.2.3** Integral magazines shall not be adjacent to machinery spaces of category A, galleys and other dangerous spaces. If it is necessary to locate the magazine in proximity to these areas, a cofferdam of at least 0,6 m shall be provided separating two spaces. Such a cofferdam shall not be used for stowage and shall be provided with ventilation. One of the bulkheads forming the cofferdam shall be of "A-15" class, if it is adjacent to machinery space of category A it shall be "A-30" class.

**6.2.2.4** Access to integral magazines shall preferably be from the weather deck, but in no case through spaces specified in [6.2.2.2](#) and [6.2.2.3](#).

**6.2.2.5** Portable magazines and magazine boxes shall be located on a weather deck in a location protected from direct impact of the sea. The location shall provide sufficient protection against warm air and hazardous vapours being emitted from galleys, pump rooms, etc. Due regard shall be paid to possible risk of subjecting certain explosives to radio emissions.

**6.2.2.6** Magazine boxes shall be located on a weather deck at least 0,1 m from the deck and any deckhouse and in a position suitable for jettisoning the contents.

**6.2.2.7** Bulkheads and decks bounding integral magazines shall be of watertight construction of "A-15" class. If the spaces adjacent to the magazines contain no combustible materials the construction may be of "A-0" class. Insulation shall be provided to prevent condensation of moisture.

**6.2.2.8** Piping of fresh or salt water and drainage systems and piping of systems installed in the magazines themselves may be routed through magazines. Piping of other systems shall be permitted only if they are enclosed in a watertight trunk.

**6.2.2.9** The magazines shall be provided with means to ensure their effective closing and to prevent unauthorized access.

**6.2.2.10** Racks, supports and other means shall be installed, the construction and capacity of which shall provide safe stowage of explosives in their approved containers with minimum dunnage and to prevent them from shifting and falling when the ship is rolling.

The upper rack shall not be located higher than 1,8 m above the deck. The racks shall have holes for water flowing from the upper to the lower racks during operation of the drenching system.

**6.2.2.11** Decks of magazines shall be covered with a permanent non-slip, non-sparking covering.

**6.2.2.12** A free volume of the magazine, when loaded, shall be at least 70 % of the entire magazine volume. Not more than 100 kg of explosives or 1000 detonators shall be placed for each 1 m<sup>2</sup>.

**6.2.2.13** Integral magazines shall be provided with natural or mechanical ventilation fitted with flame arresters sufficient to maintain the magazine temperature not higher than 38 °C.

**6.2.2.14** Portable magazines shall have watertight metal construction insulated with non-combustible materials on the inside as a construction of "A-15" class.

**6.2.2.15** Portable magazine shall bear a label indicating mass in light condition and maximum permissible mass of explosives.

**6.2.2.16** Portable magazines shall be provided with efficient natural ventilation fitted with flame arresters.

**6.2.2.17** Magazines shall be fitted with automatic heat detectors operating at temperatures rising above 40 °C. An appropriate visible and audible alarms actuated by this detector shall be provided in the wheelhouse and in the chief mate's cabin.

**6.2.2.18** Integral and portable magazines shall be fitted with drenching systems in accordance with 3.6. The controls shall be clearly marked with indication of their purpose.

**6.2.2.19** Magazines shall be fitted with scuppers. The scupper pipes shall be provided with valves which shall be kept permanently closed under normal service conditions. The valves shall be controlled from outside the magazines.

**6.2.2.20** Integral and portable magazines shall be clearly marked:

"The space is a magazine";

"Open lights and flame shall be kept away";

"The magazine door shall be locked";

"Matches and lighters shall be removed prior to entering";

"Do not lift with contents" (in case of portable magazines).

**6.2.2.21** Magazine boxes shall have watertight metal construction with walls and lids not less than 3 mm thick. Boxes exposed to sunrays shall be protected with solar screens.

**6.2.2.22** Magazine boxes shall be clearly labeled:

"The container is a magazine box";

"Open lights and flame shall be kept away";

"The box shall be locked".

**6.2.2.23** Electrical equipment in magazines shall comply with the requirements of 19.4.3, Part XI "Electrical Equipment" and other applicable requirements of the above Part.

**6.2.2.24** Detonators shall be stowed separately from other explosives.

**6.2.2.25** Charging of cartridges and other preparatory operations for using explosives shall be made in charging rooms which shall be specially provided for that purpose. Charging rooms shall be arranged in steel enclosures and located on the weather deck apart from control stations, accommodation and service spaces. Bulkheads, decks and equipment of the charging rooms shall be faced with non-sparking materials.

### **6.2.3 Carriage of dangerous goods.**

Dangerous goods on special purpose ships shall be carried in accordance with the provisions of Chapter 7 "Dangerous Goods" of the SPS Code, 2008 (IMO resolution MSC.266(84)).

### **6.3 OIL TANKERS (> 60 °C)**

**6.3.1** The fire protection of oil tankers (> 60 °C) shall be equivalent to that of cargo ships having regard of the following:

- .1** a fixed deck foam fire extinguishing system complying with the requirements of [3.7](#) shall be fitted;
- .2** the water fire main system shall additionally meet the requirements of [3.2.5.4](#);
- .3** two additional sets of fireman's outfit in accordance with [item 10.2](#) of Table 5.1.2 shall be provided.

**6.3.2** In addition to the requirements of [6.3.1](#) the following shall be provided:

- .1** cargo tanks shall not be adjacent to accommodation spaces;
- .2** air intakes and other openings leading to accommodation spaces shall not be faced to cargo area. Entrance doors in bulkheads of superstructures and deckhouses facing cargo area may be installed only in cases if they do not lead to accommodation spaces;
- .3** a continuous coaming not less than 150 mm high extending from side to side shall be fitted on the upper deck at a distance of about 2 m from a superstructure where accommodation and service spaces are arranged;
- .4** machinery spaces of category A shall be in general arranged aft beyond cargo and slop tank area.

**6.3.3** Where cargo heating arrangements are fitted, provision shall be made to prevent cargo from heating up to the temperature which is not less than 15 °C lower than the flash temperature.

## 6.4 OIL RECOVERY SHIPS AND BILGE WATER REMOVING SHIPS

**6.4.1** The fire protection of oil recovery ships shall be equivalent to that of oil tankers to the extent applicable for the individual ship project and, in addition, meet the requirements of [6.4.4 – 6.4.10](#).

On ships with tanks intended for storage of recovered oil and located forward of the superstructure in lieu of "A-60" class exterior boundaries of superstructures and deckhouses required in [2.4.3](#), "A-0" class constructions protected with a fixed water spraying system in accordance with [6.4.6](#) may be accepted.

Windows and portholes fitted with permanently hinged inside deadlights may be accepted in lieu of "A-0" class, provided that these deadlights are closed during oil recovery operations. Water-/weathertight doors constructed of steel may be accepted in lieu of "A-0" class. If these doors are fitted with portholes, deadlights shall be fitted.

The requirements of [2.4.3](#) for fire insulation of "A-60" class exterior boundaries, as well as the requirements of [2.4.4](#) and [2.4.5](#) for openings in these boundaries are applicable to the ships with tanks intended for storage of recovered oil aft of the superstructure, provided the exterior boundaries of superstructures and deckhouses enclosing accommodation, including any overhanging decks which support such accommodation, are situated 10 m and less of the nearest hazardous area ([refer to Fig. 6.4.1](#) of the present Part and 19.2.3 of Part XI "Electrical Equipment") when the ship is outside the oil spill.

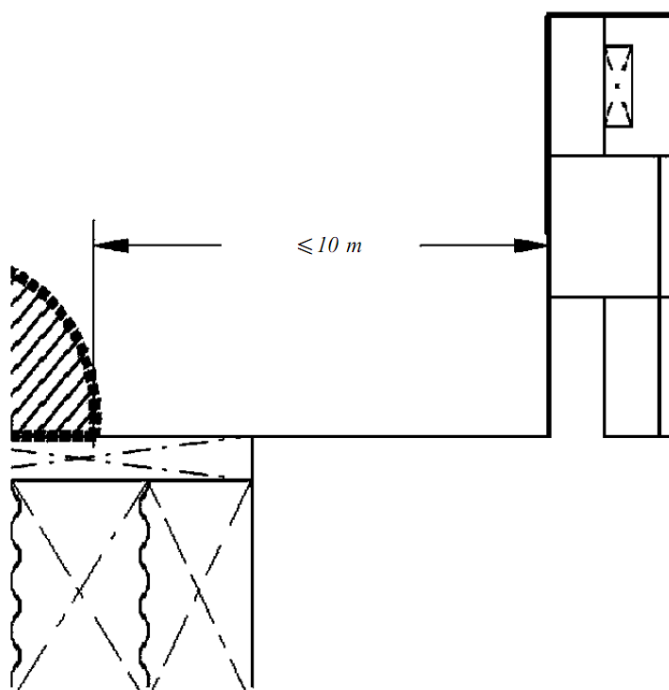


Fig. 6.4.1

When exterior boundaries of superstructures and deckhouses enclosing accommodation and including any overhanging decks, which support such accommodation, are protected by a steel bulkhead screening them from the cargo area and installed at a distance of minimum 3 m from them from side to side, compliance with the requirements of [2.4.3](#), as well as of [2.4.4](#) and [2.4.5](#) is not required. Openings for free passage of people, ship systems piping, mooring and towing lines etc., the total area of which at each tier of a superstructure or a deckhouse shall not exceed 10 % of the area equal to the width of the side multiplied by the height of the tier of the superstructure or deckhouse, are permitted in the screening bulkhead.

**6.4.2** The fire protection of oil recovery ships ( $> 60\text{ }^{\circ}\text{C}$ ) shall be equivalent to that of oil tankers ( $> 60\text{ }^{\circ}\text{C}$ ) and in addition meet the requirements of [6.4.4](#) and [6.4.10](#).

**6.4.3** The fire protection of bilge water removing ships shall be equivalent to that of oil tankers ( $> 60\text{ }^{\circ}\text{C}$ ) and in addition meet the requirements of [6.4.10](#).

**6.4.4** The hull, superstructures, structural bulkheads, decks and deckhouses shall be manufactured of steel. The use of aluminium alloys for this purpose is not permitted.

**6.4.5** The spaces intended for removable equipment which is used for oil recovery shall meet the following requirements:

.1 fire integrity of their structures shall meet the requirements of [2.4.2](#) for service spaces of category (9);

.2 they shall be protected by fire extinguishing system according to [item 6](#) of Table 3.1.2.1;

.3 may be regarded as cofferdams specified in [2.4.7](#).

**6.4.6** The "A-0" class exterior boundaries of superstructures and deckhouses referred to in [6.4.1](#) shall be protected by a fixed water spraying system with the rate of water discharge  $10\text{ l/min per }1\text{ m}^2$  remotely controlled from the navigating bridge.

**6.4.7** The water fire main system and pressure water-spraying system specified in [6.4.6](#) shall use sea water coming only from the bottom valves.

**6.4.8** Remote starting of fire pumps, fixed fire extinguishing systems designed for protection of machinery space of category A and pressure water-spraying system specified in [6.4.6](#) shall be provided from navigation bridge.

**6.4.9** The high expansion foam system shall not be used for protection of spaces specified in [6.4.5](#).

**6.4.10** The ship shall be provided with a fixed or portable oil flash point tester.

**6.4.11** For small ships of up to 1000 t deadweight periodically engaged in recovery of oil products at the sea surface, the fixed automatic system for atmosphere monitoring may be replaced, on agreement with the Register, by a monitoring system with portable analyzers specified in [item 15.1](#) of Table 5.1.2. Atmosphere monitoring shall be applied during the whole period of stay of the ship within oil spot in locations specified in 9.14.5, Part VIII "Systems and Piping".

**6.4.12** In ships of less than 150 gross tonnage with the main propulsion machinery of power output less than 220 kW, the fire pump driven by the main engine may be used provided that the propulsion unit (engine – shaft – propeller) is so designed as to permit this pump operation when the ship is not under way.

**6.4.13** Oil recovery ships ( $> 60\text{ }^{\circ}\text{C}$ ) of less than 6000 t deadweight with tanks used for oil recovery with the maximum total capacity of  $700\text{ m}^3$ , in lieu of fitting the deck foam fire extinguishing system, may be fitted with two portable foam applicators with the length of air-foam jet not less than 15 m. The amount of foam concentrate for portable foam applicators shall be sufficient to provide joint operation for at least 10 min.

On the ships having a distinguishing mark for a ship carrying equipment for fire fighting aboard other ships, for fire-fighting on the deck parts located above oil recovery tanks, as well as at location of oil spills response (OSR) equipment, monitors of a special foam fire extinguishing system or air-foam nozzles connected to distribution valve manifolds, to which foam supply is provided, may be used.

**6.4.14 Requirements for arrangement of tanks intended for storage of recovered oil.**

**6.4.14.1** Tanks intended for storage of recovered oil shall be separated from the accommodation, service spaces as well as from machinery spaces of category A by means of:

cofferdams;

fuel oil tanks;

ballast tanks or tanks for other purposes;

dry compartments, access openings to which are not located in control stations, accommodation or service spaces.

**6.4.14.2** Tanks intended for storage of recovered oil ( $> 60\text{ }^{\circ}\text{C}$ ) adjacent to machinery space of category A may be accepted, provided the tank bulkhead is fully accessible for inspection from the side of machinery space.

**6.4.14.3** Access openings to the tanks intended for storage of recovered oil and other openings leading thereto shall be located on open deck.



## **6.5 BERTH-CONNECTED SHIPS**

**6.5.1** The fire protection of berth-connected (non-self-propelled) ships used as floating hotels, hostels, offices, and restaurants, museums, etc. shall be designed depending on the number of residents or persons who sojourn therein during working hours:

**.1** up to 60 persons — equivalent to that of cargo ships of more than 500 gross tonnage;

**.2** from 60 up to 240 persons — equivalent to that of passenger ships carrying not more than 36 passengers;

**.3** more than 240 persons — equivalent to that of passenger ships carrying more than 36 passengers.

The requirements of [2.2.6](#) and [2.2.7](#) do not apply to the ships where the fire protection is designed in accordance with [6.5.1.2](#) and [6.5.1.3](#).

**6.5.2** The fire protection of floating docks, cranes, power plants, workshops, warehouses and other ships not specified in [6.5.1](#) shall be equivalent to that of cargo ships of more than 500 gross tonnage.

However, in case of 60 and more residents or persons who sojourn therein during working hours, other than crew members, the fire protection shall comply with the requirements of [6.5.1.2](#) or [6.5.1.3](#).

**6.5.3** For berth-connected ships operating at shore quay wall the Register may revise the requirements specified in [6.5.1](#) and [6.5.2](#), taking into account operating conditions of the ship and its fire protection determined by the ship designer on agreement with the customer.

## 6.6 SHIPS HAVING A DISTINGUISHING MARK FOR A SHIP CARRYING EQUIPMENT FOR FIRE FIGHTING ABOARD OTHER SHIPS

**6.6.1** The fire protection of ships having a distinguishing mark for a ship carrying equipment for fire fighting aboard other ships shall be equivalent to that of other ships with due regard for the following:

**.1** hull, superstructures, deckhouses and decks shall be made of steel. In ships having distinguishing marks **FF1WS**, **FF2WS**, **FF3WS** in class notation, the superstructures and deckhouses may be manufactured of aluminum alloys, provided they are protected with fire protection systems in compliance with [6.6.6](#) or [6.6.7](#);

**.2** structural fire protection shall be made in compliance with the method IC.

**6.6.2** Ships shall be provided with a fire and rescue operations control station. The control station shall be placed so that the ship structures do not impair, as far as practicable, the vision of the water around the ship.

**6.6.3** The ships shall have:

special systems and equipment, the minimum number of which is indicated in Tables [6.6.3-1](#) and [6.6.3-2](#);

Table 6.6.3-1

Special systems	Distinguishing mark in the class notation					
	FF1	FF1WS	FF2	FF2WS	FF3	FF3WS
Water-screen system, pressure water-spraying system <sup>1</sup>	—	+	—	+	— <sup>5</sup>	+
Water fire main system	+	+	+	+	+	+ <sup>2</sup>
Foam fire extinguishing system	+	+	+	+	+	+
Dry powder system	+ <sup>3</sup>	+ <sup>3</sup>	+ <sup>3</sup>	+ <sup>3</sup>	+	+ <sup>3</sup>
Bilge system <sup>4</sup>	+	+	+	+	+	—
<sup>1</sup> Refer to <a href="#">6.6.6.6</a> . <sup>2</sup> Refer to <a href="#">6.6.8.2</a> . <sup>3</sup> Refer to <a href="#">6.6.10.1</a> . <sup>4</sup> Refer to 7.1.10, Part VIII "Systems and Piping". <sup>5</sup> All outer hull surfaces located above the lowest possible load waterline, superstructures, deckhouses, and open decks shall be insulated to "A-60" class.						

Table 6.6.3-2

Special equipment	Distinguishing mark in the class notation		
	FF1 FF1WS	FF2 FF2WS	FF3 FF3WS
Pumps, in pcs	2 — 4	2 — 3	1
Monitors:			
water monitors, in pcs	4	3	2
with supply rate of each monitor, in m <sup>3</sup> /hour,	2500	1200	100 <sup>1)</sup> /500/1000
jet range, in m	150	120	80 <sup>1)</sup> /100/120
foam monitors, in pcs	2	— <sup>2)</sup>	— <sup>2)</sup>
Dry powder monitors <sup>3)</sup> , in pcs	1	1	1
Distribution valve manifolds, in pcs	4	4	2
<sup>1)</sup> The smaller value is for ships referred to in <a href="#">6.6.8.2</a> . <sup>2)</sup> A necessity in installation and characteristics to be indicated by the customer in accordance with the requirements of <a href="#">6.6.9.2</a> . <sup>3)</sup> For ships referred to in <a href="#">6.6.10.1</a> .			

items of fire-fighting outfit in compliance with [6.6.11.1](#);

additional bilge arrangements (systems) and additional reserve of fuel in accordance with 7.1.10 and 13.7.7, Part VIII "Systems and Piping";

additional internal service communications in compliance with 7.2.2, Part XI "Electrical Equipment".

**6.6.4** Special systems installed on board ships for fire-fighting on other objects and for their own protection (water-screen, pressure water-spraying, water fire main, foam fire extinguishing, dry powder systems) shall also comply with the requirements of Section 3 of this Part and Sections 2, 4, 5, Part VIII "Systems and Piping".

Where special systems other than specified in this Section are installed, they shall comply with the requirements of these Rules to the extent agreed with the Register in each particular case.

**6.6.5** The equipment of special systems (pumps, fittings, monitors) may be remote-controlled from the fire and rescue operations control station.

Air-operated and hydraulic control systems shall be supplied from two independent sources of power.

Electrically driven items shall comply with the requirements of 5.1 to 5.3, Part XI "Electrical Equipment".

**6.6.6 Water-screen system.**

**6.6.6.1** In ships having distinguishing marks **FF1WS**, **FF2WS** and **FF3WS** in the class notation, outer vertical hull surfaces, including superstructures and deckhouses, shall be protected with the water-screen system.

The water-screen system shall totally cover the ship and not impede visibility from the wheelhouse, fire and rescue operations control stations and manually operated monitor platforms.

**6.6.6.2** Doors and side scuttles of ships having distinguishing marks **FF1**, **FF2** or **FF3** in the class notation, which are not fitted with the above system, shall comply with the requirements of 7.2.1.10, Part III "Equipment, Arrangements and Outfit".

**6.6.6.3** The capacity and pressure of pumps serving the system shall be sufficient to supply water through spray nozzles at a rate indicated in [3.5.2](#).

**6.6.6.4** Where the system is subdivided into sections, manual operation shall be provided from the place of their installation in spite of the provision of the remote control.

**6.6.6.5** The water-screen system shall protect also the manually operated monitor platforms; the system shall be put into operation directly at each monitor.

**6.6.6.6** The ship shall be fitted with water-screen system in combination with the pressure water-spraying system, or pressure water-spraying system with water discharge rate specified in [6.6.7.2](#), provided they are capable to ensure adequate protection of all the outer surfaces of the ship. In any case, the letters **WS** shall be retained in the class notation

**6.6.7 Pressure water-spraying system.**

**6.6.7.1** The pressure water-spraying system in ships having distinguishing marks **FF1WS**, **FF2WS** or **FF3WS** in the class notation shall protect outer vertical surfaces of the hull, superstructures and deckhouses as well as horizontal surfaces of the hull where it is appropriate with regard to [6.6.6.6](#) and in oil recovery ships — with regard to [6.4.6](#).

**6.6.7.2** The rate of water discharge to the protected surface shall be:

10 l/min per 1 m<sup>2</sup> for vertical areas (non-insulated) and 5 l/min per 1 m<sup>2</sup> for vertical areas insulated to "A-60" class, as well as for vertical hull surfaces in way of ballast tanks, cofferdams and dry compartments;

5 l/min per 1 m<sup>2</sup> for horizontal areas (non-insulated); no requirement for exposed deck insulated to "A-60" class;

10 l/min per 1 m<sup>2</sup> for wood sheathed steel decks.

**6.6.7.3** For protection of superstructures and deckhouses the sections of the system shall be arranged on each tier; the arrangement of spray nozzles shall ensure uniform discharge of water onto the protected outer surface.

Where the system is subdivided into sections, the requirements of [6.6.6.4](#) shall be met.

### 6.6.8 Special water fire extinguishing system

**6.6.8.1** The system is generally intended for water supply to water monitors, distribution valve manifolds, as well as for supply of water-screen system and pressure water-spraying system. The system may be used for pumping out the water from compartments of a ship in distress (refer to 7.1.10, Part VIII "Systems and Piping").

The requirements for installation of pumps, laying of pipes, water intake arrangements, fittings and tests shall comply with the provisions of the present Part and Part VIII "Systems and Piping", as far as they are applicable and reasonable with regard to the requirements given below.

**6.6.8.2** The special water fire extinguishing system in ships having distinguishing marks **FF1**, **FF1WS**, **FF2** or **FF2WS** in the class notation shall be independent.

In ships having distinguishing marks **FF3** and **FF3WS** in the class notation, the ship water fire main system may be used as part of the special water fire extinguishing system.

**6.6.8.3** Availability of remote starting and control of the system shall not prevent starting of the pumps, control of monitors and fittings from the place of their installation (refer to Section 5, Part XI "Electrical Equipment").

Remote-controlled fittings shall have devices for their opening/closing during the time allowing to prevent water hammers.

**6.6.8.4** Provision shall be made for operation of pumps without overheating in case of no or small supply of water to consumers.

**6.6.8.5** The number of monitors shall be not less than that indicated in [Table 6.6.3-2](#) and their arrangement shall:

- provide supply of water from each monitor to both sides of the ship;
- prevent water from being discharged to the ship's own deck and its equipment;
- provide the water jet range in accordance with [Table 6.6.3-2](#).

**6.6.8.6** Each monitor shall have an independent connection to the main of the system.

**6.6.8.7** Distribution valve manifolds shall be arranged on the weather deck. The number of valves on the manifold shall be determined by the designer upon agreement with the customer.

**6.6.8.8** The capacity of the pumps shall be calculated so that water can be simultaneously delivered to monitors, the number of which shall comply with [Table 6.6.3-2](#) depending on the distinguishing mark in the class notation.

### 6.6.9 Special foam fire extinguishing system.

**6.6.9.1** The special foam fire extinguishing system shall be provided in ships having distinguishing marks for a ship carrying equipment for fire fighting aboard other ships.

The system may use totally or partly the equipment of the special water fire extinguishing system (pumps, pipes, monitors). The number and type of the equipment of the foam fire extinguishing system shall be determined by the designer on agreement with the customer.

**6.6.9.2** Ships having distinguishing marks **FF2**, **FF2WS**, **FF3** or **FF3WS** in the class notation may have the system fitted with air-foam nozzles, foam generators or combination foam units, in this case foam monitors may be omitted.

**6.6.9.3** Ships with distinguishing marks **FF1** or **FF1WS** in the class notation shall be fitted with foam monitors or foam nozzles for monitors of the special water fire extinguishing system. The number of foam monitors shall be not less than that indicated in [Table 6.6.3-2](#); the requirements for their installation shall be in line with those for monitors of the special water fire extinguishing system.

**6.6.9.4** The reserve of foam concentrate shall be calculated on the basis of the operating time of a specified number of foam generators or one monitor during at least 30 min.

**6.6.9.5** The type of foam concentrate shall be chosen with regard for water salinity in the prescribed ship service area, and class of liquids, materials or goods the concentrate is intended to extinguish (oil and petroleum products, alcohols, ketons, aldehydes, etc.).

**6.6.10 Special dry powder system.**

**6.6.10.1** The system shall be generally installed on ships servicing the operation area of gas carriers and chemical tankers.

**6.6.10.2** Applicable requirements of [3.10](#) also cover the special dry powder system.

**6.6.10.3** The powder rate through the monitor shall be not less than 40 kg/s.

The monitor shall be placed on a special platform fitted with devices for remote starting of the system ([refer to 6.6.6.5](#)).

**6.6.10.4** The quantity of the extinguishing powder shall be determined by the designer on agreement with the customer.

**6.6.11 Fire-fighting outfit.**

**6.6.11.1** In addition to the fire-fighting outfit specified in [Table 5.1.2](#), the following outfit shall be provided on board ships:

- fireman's outfits;
- fire hoses;
- dual-purpose manual fire nozzles;
- portable air-foam nozzles, foam generators or combination foam units;
- international shore connections;
- complete sets of fire-fighting tools;
- gas analyzers for flammable vapours and gases;
- induced-draught fans.

The number and composition of the additional fire-fighting outfit and spare parts thereto shall be determined by the designer on agreement with the customer.

**6.6.11.2** Additional fire-fighting outfit shall be kept in special storerooms.

Part of the fire-fighting outfit (hoses, hand nozzles, foam generators, air-foam nozzles, hose wrenches) may be placed at the fire stations near each distribution valve manifold.

**6.6.11.3** For charging cylinders of self-contained compressed air breathing apparatus ships shall be provided with compressors approved by competent authorities.

The capacity and the number of simultaneously charged cylinders shall be specified by the customer. There shall be at least four charged cylinders on board the ship. The need for a compressor to be provided on board ship may be specially considered by the Register depending on the main purpose of the ship and number of crew.

**6.6.11.4** Ships shall have two searchlights in accordance with 9.2.12, Part III "Equipment, Arrangements and Outfit".

## 6.7 CONTAINER SHIPS AND SHIPS DESIGNED TO CARRY CONTAINERS ON OR ABOVE THE WEATHER DECK

**6.7.1** For open-top container holds and on deck container stowage areas on container ships and other ships designed to carry containers on or above the weather deck, fire protection arrangements shall be provided for the purpose of containing a fire in the space or area of origin and cooling adjacent areas to prevent fire spread and structural damage.

Hatchcoverless cargo holds of container ships and ships equipped for the carriage of containers shall be fitted with a fixed water-spraying system in compliance with 24.10.1 — 24.10.3 of Part XVII "Distinguishing Marks and Descriptive Notations in the Class Notation Specifying Structural and Operational Particulars of Ships".

**6.7.2** Container ships and other ships designed to carry containers on or above the weather deck shall carry, in addition to the equipment and arrangements required for cargo ships by Sections 3 and 5, at least one water mist lance ([refer to 1.2](#)).

**6.7.3** Ships designed to carry five or more tiers of containers on or above the weather deck shall carry, in addition to the requirements of [6.7.2](#), mobile water monitors as follows:

.1 mobile water monitors shall be of an approved type and shall comply with the requirements of IMO circular MSC.1/Circ.1472;

.2 mobile water monitors with all necessary hoses, fittings and required fixing hardware shall be kept ready for use in a location outside the cargo space area not likely to be cut-off in the event of a fire in the cargo spaces;

.3 the mobile water monitor can be securely fixed to the ship structure ensuring safe and effective operation, and the jet reaches the top tier of containers with all required monitors and water jets from fire hoses operated simultaneously, that shall be tested during initial survey on board the ship.

**6.7.4** The number and arrangement of mobile water monitors shall comply with the following requirements:

.1 for ships with breadth less than 30 m: at least two mobile water monitors, or ships with breadth of 30 m or more: at least four mobile water monitors;

.2 all provided mobile water monitors can be operated simultaneously for creating effective water barriers forward and aft of each container bay;

.3 fire hydrants for connecting mobile water monitors shall be so arranged that two jets of water required by [3.2.6.2](#) shall be supplied at the pressure required by [3.2.1.1](#);

.4 each of the required mobile water monitors can be supplied by separate hydrants at the pressure necessary to reach the top tier of containers on deck.

**6.7.5** In cases where the mobile water monitors are supplied by separate pumps and piping system, the total capacity of the main fire pumps and the diameter of the fire main and water service pipes shall be determined in accordance with [3.2.1.7](#) and [3.2.5.1](#).

**6.7.6** in cases where the mobile water monitors are supplied by the main fire pumps; the total capacity of main fire pumps and the pipework diameter shall be sufficient for simultaneously supplying both the required number of fire hoses and mobile water monitors. However, the total capacity shall not be less than the following values, whichever is smaller:

.1 required under [3.2.1.5.2](#);

.2 180 m<sup>3</sup>/h.

**6.7.7** In cases where the mobile water monitors and the water spraying system required for carriage of dangerous goods by [7.2.5.3](#), are supplied by the main fire pumps, the total capacity of the main fire pumps and the pipework diameter need only be sufficient to supply whichever of the following is the greater:

.1 the mobile water monitors and the four nozzles required by [7.2.5.2](#); or

.2 the four nozzles required by [7.2.5.2](#) and the water spraying system required by [7.2.5.3](#).

The total capacity, however, shall not be less than [6.7.6.1](#) or [6.7.6.2](#), whichever is smaller.

**6.7.8** On board container ships designed to carry five or more tiers of containers on or above the weather deck, the total capacity of the emergency fire pump need not exceed 72 m<sup>3</sup>/h.



## **7 SPECIAL REQUIREMENTS FOR SHIPS CARRYING PACKAGED DANGEROUS GOODS AND DANGEROUS GOODS IN BULK**

### **7.1 GENERAL**

**7.1.1** The requirements of the present Section are aimed at providing additional safety measures in respect of ships carrying packaged dangerous goods and dangerous goods in bulk.

**7.1.2** For the purpose of the present Section, the following additional definitions and abbreviations have been adopted.

**ADN** is the European Agreement concerning the International Carriage of Dangerous Goods by Inland Waterways adopted by the ADN Administrative Committee including the AND Regulations, applicability of which is specified directly in the current version of the AND Regulations (ADN 2021 Regulations (ECE/TRANS/301) applicable as from 1 January 2021).

**BC Rules** are the Rules for Safe Carriage of Bulk Cargoes by Sea (STO 318.1.38-2009) means national rules of the Russian Federation for safe carriage of bulk cargoes.

**Bulk Cargoes of Group A** consist of cargoes which may liquefy if shipped at a moisture content in excess of their transportable moisture limit.

**Bulk Cargoes of Group B** consist of cargoes which possess a chemical hazard which could give rise to a dangerous situation on a ship.

**Bulk Cargoes of Group C** consist of cargoes which are neither liable to liquefy (Group A) nor to possess chemical hazards (Group B).

**Dangerous goods** are substances, materials and products covered by the IMDG Code.

**Dangerous goods in bulk** are any materials other than liquid or gas, consisting of mixture of particles, granules or larger pieces of material, generally homogenous, covered by the IMSBC Code, and which are loaded directly into cargo spaces without the use of any intermediate package, including the same materials loaded into shipborne barge on a lighter carrier.

**High-level radioactive wastes** are liquid wastes resulting from the operation of the first stage extraction system or the concentrated wastes from subsequent extraction stages, in a facility for reprocessing irradiated fuel, or solids into which such liquid wastes have been converted.

**IMDG Code** is the International Maritime Dangerous Goods (IMDG) Code adopted by IMO resolution MSC.122(75), as amended by IMO resolutions MSC.157(78), MSC.205(81), MSC.262(84), MSC.294(87), MSC.328(90), MSC.372(93), MSC.406(96), MSC.442(99), MSC.477(102).

**IMSBC Code** is the International Maritime Solid Bulk Cargoes Code adopted by IMO resolution MSC.268(85), as amended by IMO resolutions MSC.318(89), MSC.354(92), MSC.393(95), MSC.426(98) and MSC.462(101).

**INF cargo** is packaged irradiated nuclear fuel, plutonium and high-level radioactive wastes carried as cargo in accordance with Class 7 of the IMDG Code.

**INF Code** is the International Code for the Safe Carriage of Packaged Irradiated Nuclear Fuel, Plutonium and High-Level Radioactive Wastes on Board Ships adopted by IMO resolution MSC.88(71), as amended.

**Irradiated nuclear fuel** is material containing uranium, thorium and/or plutonium isotopes which has been used to maintain a self-sustaining nuclear chain reaction.

**Materials hazardous only in bulk (MHB)** are materials which may possess chemical hazards when carried in bulk other than materials classified as dangerous goods in the IMDG Code.

**Package** is cargo container established by the IMDG Code.

Plutonium is the resultant mixture of isotopes of that material extracted from irradiated nuclear fuel from reprocessing.

Potential sources of ignition are open fires, machinery exhausts, galley uptakes, electrical outlets and electrical equipment unless they are of certified safe type.

Sources of heat are heated ship structures, where the surface temperature is liable to exceed 55 °C (examples of such heated structures are steam pipes, heating coils, top or side walls of heated fuel and cargo tanks, and bulkheads of machinery spaces).

## **7.2 SHIPS CARRYING PACKAGED DANGEROUS GOODS OR DANGEROUS GOODS IN BULK**

**7.2.1** The requirements of the present Chapter apply to the following types of ships and cargo spaces:

**.1** ships and cargo spaces not specially designed for the carriage of freight containers but intended for the carriage of packaged dangerous goods including goods in freight containers and portable tanks;

**.2** purpose-built container ships and cargo spaces intended for the carriage of dangerous goods in freight containers and portable tanks (refer to 8.4.8, Part III "Equipment, Arrangements and Outfit");

**.3** ro-ro ships and ro-ro cargo spaces, spaces for vehicles and special category spaces intended for the carriage of dangerous goods. A ro-ro cargo space completely open from above and on both sides may be treated as the weather deck;

**.4** ships and cargo spaces intended for the carriage of dangerous goods in bulk;

**.5** ships and cargo spaces intended for the carriage of dangerous goods other than liquids and gases in bulk in shipborne barges.

**7.2.2** Cargo and passenger ships including cargo and passenger ships of less than 500 gross tonnage intended for the carriage of packaged dangerous goods shall meet the requirements of this Chapter considering applicable provisions of IMO resolution MSC.269(85), Annex 2.

**7.2.2.1** Cargo ships with cargo spaces intended for the carriage of dangerous goods in bulk shall meet the requirements of this Chapter; however, these requirements for cargo ships of less than 500 gross tonnage may be reduced by the Register with an appropriate note in the Certificate of Compliance with the Special Requirements for Ship Carrying Dangerous Goods, issued by the Register.

**7.2.3** In addition to the requirements of the present Chapter, the applicable provisions of the IMDG Code and the IMSBC Code shall be met. The carriage of packaged dangerous goods shall comply with the appropriate provisions of the IMDG Code, the carriage of dangerous goods in bulk shall comply with the appropriate provisions of the IMSBC Code/BC Rules.

International carriage of dangerous goods by seagoing vessels on inland waterways not forming part of maritime waterways shall comply with the provisions of ADN.

**7.2.3.1** A ship engaged in the carriage of dangerous goods in any cargo spaces shall be provided with a fixed carbon dioxide or inert gas fire-extinguishing system complying with the provisions of the FSS Code or with a fire-extinguishing system which gives equivalent protection for the cargoes carried.

**7.2.4** Depending on the modes of carriage of dangerous goods in ships and cargo spaces specified in [7.2.1](#) the requirements of [Table 7.2.4-1](#) shall apply; depending on the class of dangerous goods carried in bulk the requirements of [Table 7.2.4-2](#) shall apply; depending on the class of dangerous goods other than those carried in bulk the requirements of [Table 7.2.4-3](#) shall apply.

Table 7.2.4-1

Ships and cargo spaces Requirements of paragraphs	Weather deck of ships and cargo spaces listed in <a href="#">7.2.1.1 – 7.2.1.5</a>	Ships not specifically designed ( <a href="#">refer to 7.2.1.1</a> )	Container cargo spaces ( <a href="#">refer to 7.2.1.2</a> )	Closed cargo spaces as given in <a href="#">1.5.4.3.1</a> ( <a href="#">refer to 7.2.1.3</a> )	Open cargo spaces as given in 1.5.4.3.2 ( <a href="#">refer to 7.2.1.3</a> )	Ships for the carriage of solid dangerous goods in bulk ( <a href="#">refer to 7.2.1.4</a> )	Shipborne barges ( <a href="#">refer to 7.2.1.5</a> )
<a href="#">7.2.5.1</a>	+	+	+	+	+	For application of the requirements of <a href="#">7.2</a> to different classes of dangerous goods, refer to <a href="#">Table 7.2.4-2</a>	+
<a href="#">7.2.5.2</a>	+	+	+	+	+		—
<a href="#">7.2.5.3</a>	—	+	+	+	+		+
<a href="#">7.2.5.4</a>	—	+	+	+	+		+
<a href="#">7.2.6</a>	—	+	+	+	+		+ <sup>2</sup>
<a href="#">7.2.7</a>	—	+	+	+	—		+ <sup>2</sup>
<a href="#">7.2.8.1</a>	—	+	+ <sup>3</sup>	+	—		+ <sup>2</sup>
<a href="#">7.2.8.2</a>	—	+	+ <sup>3</sup>	+	—		+ <sup>2</sup>
<a href="#">7.2.9</a>	—	+	+	+	—		—
<a href="#">7.2.10.1</a>	+	+	+	+	+		—
<a href="#">7.2.10.2</a>	+	+	+	+	+		—
<a href="#">7.2.11</a>	+	+	—	—	+		—
<a href="#">7.2.12</a>	+	+	+ <sup>4</sup>	+	+		—
<a href="#">7.2.13</a>	—	—	—	+ <sup>5</sup>	+		—
<a href="#">7.2.14</a>	—	—	—	+	—		—
<a href="#">7.2.15</a>	—	—	—	+	—		—

<sup>1</sup> Special category spaces shall be treated as closed ro-ro cargo spaces when dangerous goods are carried.

<sup>2</sup> In special cases where the barges are capable of containing flammable vapours or alternatively if they are capable of discharging flammable vapours to a safe space outside the barge carrier compartment by means of ventilation ducts connected to the barges, these requirements may be reduced or waived, which is subject to special consideration by the Register.

<sup>3</sup> For classes 4 and 5.1 solids not applicable to closed freight containers. For classes 2, 3, 6.1 and 8 when carried in closed freight containers, the ventilation rate may be reduced to not less than two air changes per hour. For classes 4 and 5.1 liquids when carried in closed freight containers, the ventilation rate may be reduced to not less than two air changes per hour. For the purpose of this requirement, a portable tank is a closed freight container.

<sup>4</sup> Applicable to decks only.

<sup>5</sup> Applies only to closed cargo spaces as given in [1.5.4.3.1](#), not capable of being sealed.

Note. Wherever + appears in the table, it means that this requirement is applicable to all classes of dangerous goods as given in the appropriate line of [Table 7.2.4-3](#), except as indicated in the footnotes.

Table 7.2.4-2

Class of dangerous goods	4.1	4.2	4.3 1	5.1	6.1	8	9
Requirements of paragraphs							
<a href="#">7.2.5.1</a>	+	+	—	+	—	—	+
<a href="#">7.2.5.2</a>	+	+	—	+	—	—	+
<a href="#">7.2.6</a>	+	+ <sup>2</sup>	+	+ <sup>3</sup>	—	—	+ <sup>3</sup>
<a href="#">7.2.8.1</a>	—	+ <sup>2</sup>	+	—	—	—	—
<a href="#">7.2.8.2</a>	+ <sup>4</sup>	+ <sup>2</sup>	+	+ <sup>2, 4</sup>	—	—	+ <sup>2, 4</sup>
<a href="#">7.2.8.3</a>	+	+	+	+	+	+	+
<a href="#">7.2.10</a>	+	+	+	+	+	+	+
<a href="#">7.2.12</a>	+	+	+	+ <sup>2</sup>	—	—	+ <sup>5</sup>

<sup>1</sup> The hazards of substances in this class which may be carried in bulk are such that special consideration shall be given to the construction and equipment of the ship involved in addition to meeting the requirements of this table.

<sup>2</sup> Only applicable to oilcake containing solvent extractions, ammonium nitrate and ammonium nitrate fertilizers.

<sup>3</sup> Only applicable to ammonium nitrate and ammonium nitrate fertilizers. However, the degree of protection in accordance with the standards contained in the International Electrotechnical Commission, publication 79 — Electrical Apparatus for Explosive Gas Atmospheres, is sufficient.

<sup>4</sup> Only suitable wire mesh guards are required.

<sup>5</sup> The requirements of IMSBC Code/BC Rules are sufficient.

Table 7.2.4-3

Class of dangerous goods Requirements of paragraphs	1.1 to 1.6	1.4S	2.1	2.2	2.3		3		4.1	4.2	4.3		5.1	5.2.1	6.1				8				9
					flammable gases <sup>2</sup>	non-flammable gases	liquids (<23 °C) <sup>3</sup>	liquids (≥ 23 °C ≤ 61 °C) <sup>3</sup>			liquids <sup>4</sup>	solids			liquids (< 23 °C) <sup>3</sup>	liquids (≥ 23 °C ≤ 61 °C) <sup>3</sup>	liquids	solids	liquids (< 23 °C) <sup>3</sup>	liquids (≥ 23 °C ≤ 61 °C) <sup>3</sup>	liquids	solids	
<a href="#">7.2.5.1</a>	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+
<a href="#">7.2.5.2</a>	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	—
<a href="#">7.2.5.3</a>	+	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
<a href="#">7.2.5.4</a>	+	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
<a href="#">7.2.6</a>	+	—	+	—	+	—	+	—	—	—	+ <sup>5</sup>	—	—	—	+	—	—	—	+	—	—	—	+ <sup>6</sup>
<a href="#">7.2.7</a>	+	+	+	+	—	+	+	+	+	+	+	+	+	—	+	+	+	+	+	+	+	+	—
<a href="#">7.2.8.1</a>	—	—	+	—	—	+	+	—	+ <sup>7</sup>	+ <sup>7</sup>	+	+	+ <sup>7</sup>	—	+	+	—	+ <sup>7</sup>	+	+	—	—	+ <sup>7</sup>
<a href="#">7.2.8.2</a>	—	—	+	—	—	—	+	—	—	—	—	—	—	—	+	—	—	—	+	—	—	—	+ <sup>6</sup>
<a href="#">7.2.9</a>	—	—	—	—	—	—	+	—	—	—	—	—	—	—	+	+	+	—	+	+ <sup>8</sup>	+ <sup>8</sup>	—	—
<a href="#">7.2.10</a>	—	—	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+ <sup>9</sup>
<a href="#">7.2.11</a>	—	—	—	—	—	—	+	+	+	+	+	+	+	—	+	+	—	—	+	+	—	—	—
<a href="#">7.2.12</a>	+ <sup>10</sup>	—	+	+	+	+	+	+	+	+	+	+	+ <sup>11</sup>	+	+	+	—	—	+	+	—	—	—
<a href="#">7.2.13</a>	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+
<a href="#">7.2.14</a>	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+
<a href="#">7.2.15</a>	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+	+

<sup>1</sup> Stowage of class 5.2 dangerous goods under deck or in enclosed ro-ro spaces is prohibited.

<sup>2</sup> According to provisions of the IMDG Code, stowage of class 2.3 cargoes featuring additional dangerous properties of class 2.1 goods under deck or in enclosed ro-ro spaces is prohibited.

<sup>3</sup> Refer to the flash point.

<sup>4</sup> According to provisions of the IMDG Code, stowage of class 4.3 liquid cargoes having a flash point lower than 23.8 °C under deck or in enclosed ro-ro spaces is prohibited.

<sup>5</sup> Applicable only to cargoes specified in the IMDG Code and having a flash point lower than 23.8 °C.

<sup>6</sup> Applicable only to cargoes specified in the IMDG Code and releasing flammable vapours.

<sup>7</sup> When "mechanically ventilated" spaces are required by the IMDG Code.

<sup>8</sup> Applicable only to cargoes featuring additional dangerous properties of class 6.1 goods.

<sup>9</sup> As appropriate to the goods being carried.

<sup>10</sup> In all cases cargoes shall be stowed 3 m horizontally away from the machinery space boundaries.

<sup>11</sup> Refer to the IMDG Code.

**7.2.5** The following additional measures shall be taken to ensure supply of water:

**.1** the water fire main system shall ensure immediate availability of water supply at the required pressure either by permanent pressurization in the fire main or by suitably placed remote starting arrangements for the fire pumps from the locations referred to in [3.2.3.9](#);

**.2** the water fire main system shall ensure the delivery of the quantity of water capable of supplying four nozzles with applicators provided on board under the pressure as specified in [3.2.1.1](#) to any part of the cargo space when empty. Upon agreement with the Register, this amount of water may be applied by equivalent means. The number and arrangement of fire hydrants shall be such that at least two water jets out of four required can be delivered through fire hoses of standard length to any part of the empty cargo space and that all the four jets can be delivered through hoses of standard length to any part of cargo ro-ro space;

**.3** the water fire main system shall effectively cool a cargo space by a pressure water-spraying system with a rate of water supply specified in [3.4.2.1](#) or by flooding ([refer to 3.6.4](#)).

Hoses capable to ensure the delivery of the required quantity of water may be used for this purpose in small spaces and in small areas of larger cargo spaces on agreement with the Register.

The drainage and pumping arrangements shall be such as to prevent the build-up of free surfaces as specified in 7.14.2, Part VIII "Systems and Piping". If this is impossible a calculation shall be made to prove that the ship with the cargo space flooded with water complies with the requirements of Sections 2 and 3, Part V "Subdivision";

**.4** in lieu of compliance with the requirements of [7.2.5.3](#) the high expansion foam system may be used in accordance with [3.7.3](#) using a supply rate and time of continuous supply according to [Table 3.7.1.3](#) for machinery or by other special suitable extinguishing media;

**.5** the total required quantity of water shall satisfy the requirements of [7.2.5.2](#) and [7.2.5.3](#), if applicable, simultaneously calculated for the largest designated cargo space. The requirements of [7.2.5.2](#) shall be met by the total capacity of the main fire pumps not including the capacity of the emergency fire pump, if fitted. If a drencher system is used to satisfy the requirements of [7.2.5.3](#), the drencher pump shall also be taken into account in this total capacity calculation;

**.6** the pressure water-spraying system required in accordance with 9.2, 9.3 and 9.4 of IMO circular MSC/Circ.608/Rev.1 "Interim Guidelines for Open-Top Containerships" also satisfies the requirements for dangerous goods. The quantity of water required to fire fighting in the largest cargo space shall be capable to ensure simultaneous operation of the pressure water-spraying system and four jets from fire nozzles.

**7.2.6** Electrical equipment shall comply with the requirements of 2.9.2, 2.9.3, 2.9.9, 2.9.10, 2.9.12, 16.8.1.6, 16.8.4.5, 16.8.6.1 and 19.11, Part XI "Electrical Equipment".

Any other equipment which may constitute a source of ignition of explosive mixtures of vapours, gases or dust with air shall not be permitted in cargo spaces.

**7.2.7** Ro-ro cargo spaces shall be fitted with a fixed fire detection and fire alarm system complying with the requirements of [4.2.1](#). All other types of cargo spaces shall be fitted either with a fixed fire detection and fire alarm system complying with the requirements of [4.2.1](#) or sample extraction smoke detection system complying with the requirements of [4.2.1.6](#). If a sample extraction smoke detection system is fitted, particular attention shall be given to the requirements of [4.2.1.6.3](#) to prevent leakage of toxic smoke into areas where people stay.

**7.2.8** Ventilation of cargo spaces shall comply with the following requirements of Part VIII "Systems and Piping":

**.1** arrangement of the ventilation system, with the requirements of 12.1.7, 12.1.8, 12.7.1, 12.7.3 and 12.7.5. For bulk cargoes of class 4.2 ([refer to Footnote 2](#) to Table 7.2.4-2), class 4.3, as well as MHB of Groups A and B emitting flammable gas when wet and self-heating, additionally with the requirements of 12.7.7; when cargoes emitting flammable



gases are carried in sufficient quantities to constitute a fire or explosion hazard that shall be indicated in Annex 1 to the IMSBC Code or by the cargo information provided by the shipper, the cargo spaces shall be effectively ventilated and atmosphere in the cargo spaces shall be monitored by means of the appropriate gas detectors; due consideration shall be given to the ventilation and monitoring of the atmosphere in the enclosed spaces adjacent to the cargo spaces;

**.2** construction of ventilation fans, with the requirements of 12.7.4;

**.3** natural ventilation system in compliance with the requirements of 12.7.2 shall be provided in enclosed cargo spaces intended for the carriage of dangerous goods in bulk unless not fitted with mechanical ventilation; cargo spaces with natural ventilation shall not be used for the carriage of bulk cargoes of Group B which are self-heating (SH), emitting flammable gas when wet (WF), emitting toxic gas when wet (WT).

**7.2.9** The bilge system of cargo spaces shall comply with the requirements of 7.14, Part VIII "Systems and Piping".

**7.2.10** Ships shall be provided with the following outfit:

**.1** four full sets protective clothing resistant to chemical exposure and intended for use in emergency situations. The protective clothing shall cover all skin so that no part of the body is unprotected and, subject to cargo characteristics, shall meet the recommendations of the IMDG Code, the IMSBC Code/BC Rules;

**.2** at least two self-contained breathing apparatus in addition to those required by [item 10](#) of Table 5.1.2. Two spare charges or two spare breathing apparatus shall be provided in addition to those required for the fireman's outfit ([refer to 5.1.15.2](#)).

**7.2.11** Portable fire extinguishers with a total capacity of at least 12 kg of dry powder or equivalent shall be provided for cargo spaces. These extinguishers shall be in addition to any portable fire extinguishers required by the present Part.

**7.2.12** Bulkheads forming boundaries between cargo spaces and machinery spaces of category A shall be of "A-60" class, unless dangerous goods are stowed at least 3 m horizontally away from such bulkheads. Other boundaries between such spaces shall be of "A-60" class.

When a cargo space is partially located above the machinery space of category A and bounding structures do not have the required insulation, such cargo space is unfit for carriage of dangerous goods. The same refers to areas of bare weather deck located above the machinery space of category A.

**7.2.13** Each open ro-ro space having a deck above it and each space considered to be a closed ro-ro space not capable of being sealed shall be fitted with an approved manually operated fixed pressure waterspraying system which shall protect all parts of any deck and vehicle platform in such space. The Register may permit the use of any other fixed fire extinguishing system that has been shown by full-scale tests to be not less effective ([refer to 1.3.3](#)). However, the drainage and pumping arrangements shall be such as to prevent free surfaces as specified in 7.14.2, Part VIII "Systems and Piping". If this is impossible, a calculation shall be made to prove that the ship with flooded cargo space meets the requirements of Sections 2 and 3, Part V "Subdivision".

**7.2.14** In ships having ro-ro spaces, subdivision shall be provided between a closed ro-ro space and an adjacent open ro-ro space. The subdivision shall be such as to minimize the passage of dangerous vapours and liquids between such spaces. Alternatively, such subdivision need not be provided if the ro-ro space is considered to be a closed cargo space over its entire length and shall fully comply with the relevant special requirements of the present Chapter.

**7.2.15** In ships having ro-ro spaces, subdivision shall be provided between a closed ro-ro space and the adjacent weather deck. The subdivision shall be such as to minimize the passage of dangerous vapours and liquids between such spaces. Alternatively, such subdivision need not be provided if the arrangements of the closed ro-ro spaces are in accordance with the requirements for the carriage of dangerous goods on the adjacent weather deck.

**7.2.16** Cargo spaces in ships other than ro-ro ships shall not be adjacent to accommodation and service spaces, except service spaces of low fire risk referred to in [1.5.3.2.3](#).

**7.2.17** Hatch covers of dry-cargo holds shall comply with the requirements of Part III "Equipment, Arrangements and Outfit".

**7.2.18** On all ships, vehicles with fuel in their tanks for their own propulsion may be carried in cargo spaces other than vehicle, special category or ro-ro spaces, provided that all the following conditions are met:

- .1 the vehicles do not use their own propulsion within the cargo spaces;
- .2 the cargo spaces are in compliance with the appropriate requirements of [7.2.4](#); and
- .3 the vehicles are carried in accordance with the IMDG Code, as defined in [7.2.3](#).

### 7.3 SHIPS CARRYING PACKAGED IRRADIATED NUCLEAR FUEL, PLUTONIUM AND HIGH-LEVEL RADIOACTIVE WASTES (INF CARGO)

**7.3.1** The requirements of the present Chapter are based on the provisions of the INF Code and apply to all ships regardless of their date of build and size, including cargo ships of less than 500 gross tonnage, engaged in the carriage of INF cargo.

**7.3.2** For the purpose of the present Chapter, ships carrying INF cargo are assigned to the following three classes, depending on the total activity of INF cargo which is carried on board.

Class **INF1** ship is a ship, having certificate to carry INF cargo with an aggregate activity less than 4000 TBq.

Class **INF2** ship is a ship, having certificate to carry irradiated nuclear fuel or high-level radioactive wastes with an aggregate activity less than  $2 \times 10^6$  TBq and ship which is certified to carry plutonium with an aggregate activity less than  $2 \times 10^5$  TBq.

Class **INF3** ship is a ship, having certificate to carry irradiated nuclear fuel or high-level radioactive wastes and ship which is certified to carry plutonium with no restriction of the maximum aggregate activity of the materials.

The compliance of the ship with the requirements of this Chapter shall be certified by the appropriate distinguishing mark added to the class notation in accordance with 2.2.14, Part I "Classification" and by the International Certificate of Fitness for Carriage of INF Cargo issued by the Register.

**7.3.3** In addition to the requirements of the present Chapter, the applicable provisions of the IMDG Code shall be complied with.

**7.3.4** The INF cargo which is required to be carried on Class **INF3** ships shall not be carried on passenger ships.

**7.3.5** The damage trim and stability shall comply with the requirements of 3.4.9, Part V "Subdivision".

**7.3.6** In addition to the requirements of the present Part, the ship shall be fitted with a fixed pressure water-spraying system to protect cargo spaces which shall ensure the rate of water discharge as indicated in [3.4.2.1](#). In Class **INF1** ships the pressure water-spraying system need not be installed provided the requirements of [7.2.5.1](#) and [7.2.5.2](#) are complied with.

**7.3.7** In Class **INF3** ships accommodation spaces, service spaces, control stations and machinery spaces of category A shall be fitted forward or aft of the cargo spaces, due regard being paid to the overall safety of the ship.

**7.3.8** The cargo spaces of the ship shall be fitted with temperature control systems complying with the requirements of 12.7.8, Part VIII "Systems and Piping".

**7.3.9** The ship hull structure shall comply with the requirements of Part II "Hull".

**7.3.10** Permanent devices shall be provided to secure packages of INF cargo within the cargo spaces. The devices shall meet the requirements of the Guidelines for the Development of the Cargo Securing Manual.

**7.3.11** The electrical equipment of systems and arrangements referred to in [7.3.6](#) and [7.3.8](#) shall comply with the requirements of Part XI "Electrical Equipment".

The requirements for the emergency source of electrical power to supply these systems are set forth in Section 9, Part XI "Electrical Equipment".

**7.3.12** Depending upon the characteristics of the INF cargo to be carried and upon the design of the ship, additional arrangements and equipment for radiological protection meeting the requirements of the competent state authorities on radiological safety shall, if necessary, be provided.

**7.3.13** Every ship shall carry on board an approved shipboard emergency plan based on the Guidelines for Developing Shipboard Emergency Plans for Ships Carrying Materials Subject to the INF Code adopted by IMO resolution A.854(20).

**7.3.14** Every ship shall carry on board equipment (individual personnel protection outfit, apparatus, etc.) for use in emergency. The type and amount of such equipment depend upon the INF cargo to be carried and is specified by the shipboard emergency plan referred to in [7.3.13](#).

## **8 REQUIREMENTS FOR FIRE PROTECTION OF CARGO SHIPS OF LESS THAN 500 GROSS TONNAGE**

### **8.1 GENERAL DEFINITIONS AND APPLICATION**

**8.1.1** The requirements of the present Section are aimed at ensuring the safety of cargo ships of less than 500 gross tonnage (except fishing vessels, chemical tankers and gas carriers) as regards their fire protection.

**8.1.2** The following definition has been adopted in the present Section.

Gross tonnage is as defined in IMO resolution A.493(XII), calculated in accordance with the International Convention on Tonnage Measurement of Ships, 1969.

**8.1.3** The requirements of the present Section are intended to apply to new and — as far as reasonable and practicable — to existing cargo ships of less than 500 gross tonnage.

**8.1.3.1** For ships of restricted service, the Register may reconsider the requirements specified in the present Section taking into account the service conditions of the ship and the measures for its fire safety stipulated by the ship designer on agreement with the customer.

**8.1.3.2** As to fire protection documentation, requirements of these Rules shall be complied with considering the provisions of [8.1.3.1](#).

## **8.2 FIRE CONTROL PLANS**

**8.2.1** In all ships in the wheelhouse or in conspicuous positions in corridors, general arrangement plans shall be permanently exhibited, using graphical symbols that are in accordance with IMO resolution A.952(23), as amended by IMO resolution A1116(30), which show clearly for each deck the control stations, the fire-resistant and fire-retarding divisions, together with particulars of:

- fire detection and fire alarm systems;
- fire extinguishing appliances;
- position of the fireman's outfits;
- location and arrangement of the emergency stop for oil fuel unit pumps and for closing the valves on the pipes from oil fuel tanks;
- means of access to different compartments and decks;
- ventilating system, including particulars of the fan control positions, the position of dampers and identification numbers of ventilating fans.

**8.2.2** Alternatively, the details required by [8.2.1](#) may be set out in a booklet, a copy of which shall be supplied to each officer, and one copy is at all times to be available on board in an accessible position.

**8.2.3** General arrangement plans and booklets shall be kept up to date, any alterations to the fire protection being recorded thereon.

**8.2.4** In all cargo ships greater than or equal to 150 gross tonnage, a duplicate set of general arrangement plans shall be permanently stored, and the booklet containing such plans shall be kept in a weathertight enclosure outside the deckhouse, painted red in accordance with the applicable requirements of [1.4.3](#).

In ships of less than 150 gross tonnage, the duplicate set of the plans or the booklet may be omitted and the position of the booklet for the assistance of shore-side fire-fighting personnel shall be agreed with the Register.

**8.2.5** Description in general arrangement plans and booklets shall be in the official language of the flag state and in the language as shown below:

- for ships of unrestricted service — English;
- for ships of restricted service — language recognized by the flag state.

For ships engaged in domestic service only, the plans and booklets may not be translated into English.

**8.2.6** In all ships in addition to the above general arrangement plans and booklets the instructions concerning the maintenance and operation of all the equipment and installations on board for the fighting and containment of fire shall be kept under one cover, readily available in an accessible position.

### **8.3 ALTERNATIVE DESIGN AND ARRANGEMENTS**

**8.3.1** Alternative design and arrangements which may be applied on ships shall comply with provisions of [1.7](#) (except [1.7.2.1.4](#)) considering the requirements of [8.3.2](#) and [8.3.3](#).

**8.3.2** The required fire safety performance criteria for the ship or the space(s) concerned shall:

.1 be based on fire safety objectives and the functional requirements of the present Section;

.2 provide a degree of safety not less than that achieved when using the prescribed requirements;

.3 be quantifiable and measurable.

**8.3.3** The engineering analysis of alternative design and arrangements shall be evaluated and approved by the Register. A copy of the Register-approved documentation shall be carried on board the ship.



## 8.4 STRUCTURAL FIRE PROTECTION

**8.4.1** The minimum fire integrity of bulkheads and decks separating adjacent spaces shall meet the requirements of [Table 8.4.1](#).

Table 8.4.1

Nos.	Space	Separation by	From space
<b>1</b>	Machinery space category	A-60	1. accommodation spaces 2. control stations 3. corridors 4. stairways 5. service spaces of high fire risk 6. ro-ro spaces 7. vehicle spaces
<b>2</b>	Machinery space category	A-0	Other than above ( <a href="#">item 1</a> )
<b>3</b>	Galley	A-0	Unless specified otherwise
<b>4</b>	Service spaces of high fire risk	B-15	Unless specified above ( <a href="#">item 1</a> )
<b>5</b>	Corridor. Staircase	B-0	Unless specified above ( <a href="#">item 1</a> )
<b>6</b>	Cargo spaces (other than ro-ro spaces and vehicle spaces)	A-0	Unless specified above ( <a href="#">item 1</a> )
<b>7</b>	Ro-ro spaces and vehicle spaces (except weather deck)	A-60	1. control stations 2. machinery spaces of category
<b>8</b>	Ro-ro spaces and vehicle spaces (except weather deck)	A-0	Unless specified above ( <a href="#">item 1</a> )

**8.4.1.1** Divisions used to separate spaces not mentioned in [Table 8.4.1](#) shall be of non-combustible material.

In ships of less than 500 gross tonnage it is allowed to install non-combustible bulkheads, linings and ceilings with combustible covering at most 2 mm thick except corridors, stairway enclosures as well as control stations where thickness of covering shall not exceed 1,5 mm.

**8.4.1.2** The hull, superstructure, structural bulkheads, decks and deckhouses shall be constructed of steel or other equivalent material. For the purpose of applying the definition of steel or other equivalent material, the applicable fire exposure shall be one hour.

Ships built of materials other than steel shall be considered compliant to [8.3](#).

**8.4.1.3** Stairways shall be enclosed, at least at one level, by divisions and self-closing doors or hatches.

**8.4.1.4** Stairways serving machinery spaces, accommodation spaces, service spaces or control stations shall be of steel or other equivalent material.

The floor plating of normal passageways in machinery spaces of category A shall be of steel or other equivalent material.

**8.4.1.5** Openings in "A" class divisions shall be provided with means of closing which shall be at least as effective for resisting fires as the divisions in which they are fitted which is determined in accordance with the FTP Code.

**8.4.1.6** In "A" class divisions, arrangements shall be made to prevent the transmission of heat to uninsulated boundaries at the intersections and terminal points of other structural members and penetrations by insulating the horizontal and vertical boundaries or penetrations for a distance of 450 mm either side.

**8.4.1.7** Doors shall be self-closing in way of machinery spaces of category A and galleys, except where they are normally kept closed.

**8.4.1.8** In cargo ships of less than 300 gross tonnage, storerooms for flammable materials and substances may be arranged in way of accommodation spaces, but not adjacent thereto. Where a separate storeroom for flammable liquids is impeded, it is permissible to store them in steel ventilated lockers or cases. Such lockers or cases shall not be adjacent to the accommodation spaces and their doors shall open outwards.

All electrical equipment shall be intrinsically safe.

**8.4.2** Structural fire protection of cargo ships constructed from composite materials shall comply with the applicable requirements of Section 2, Part VI "Fire Protection" of the Rules for the Classification and Construction of High-Speed Craft.

## **8.5 REQUIREMENTS FOR MATERIALS**

**8.5.1** Except in cargo spaces or refrigerated compartments of service spaces, insulating materials shall be non-combustible.

**8.5.2** Insulating materials shall not contain asbestos.

**8.5.3** In spaces where penetration of oil products is possible, the surface of the insulation shall be impervious to oil or oil vapours.

**8.5.4** Vapour barriers and adhesives used in conjunction with insulation, as well as the insulation of pipe fittings, for cold service systems need not be of non-combustible materials, but they shall be kept to the minimum quantity practicable and their exposed surfaces shall have low flame spread characteristics.

**8.5.5** Paints, varnishes and other finishes used on exposed interior surfaces shall comply with the requirements of [2.1.1.7](#), [2.1.1.8.2.1](#), [2.1.1.8.2.2](#) and [2.1.1.8.3](#) accordingly as regards producing excessive quantities of smoke, toxic gases or vapours and shall be of the low flame spread type in accordance with the FTP Code.

**8.5.6** Pipes conveying oil or combustible liquids through accommodations and service spaces shall be of steel or other approved materials having regard to the fire risk.

**8.5.7** Where pipes penetrate "A" or "B" class divisions, the pipes or their penetration pieces shall be of steel or other approved materials.

**8.5.8** Primary deck coverings within accommodation spaces, service spaces and control stations shall be of an approved material which will not readily ignite or give rise to toxic or explosive hazards at elevated temperatures, as defined by the FTP Code.

**8.5.9** Materials readily rendered ineffective by heat shall not be used for overboard scuppers, sanitary discharges and other outlets where the failure of the material would give rise to the danger of flooding.

## **8.6 FIRE-FIGHTING EQUIPMENT AND SYSTEMS**

**8.6.1** Fixed fire extinguishing systems where required, shall meet the requirements of the FSS Code.

**8.6.2** Machinery spaces of category A on ships with gross tonnage greater than or equal to 150 and operating in unrestricted or restricted waters, except ships for port, roadstead and coastal navigation shall be provided with an approved fixed fire extinguishing system, as specified in [8.6.1](#).

**8.6.3** Fixed fire extinguishing systems not mandatory under the requirements of the present Section, but installed on board ships of less than 500 gross tonnage shall be of an approved type.

**8.6.4** Protection of paint lockers and flammable liquid lockers shall be agreed with the Register.

**8.6.5** Spare parts and instruments for fixed fire extinguishing systems shall be available on board. The number of spare parts and instruments shall be determined and agreed with the Register.

**8.6.6** In ships of less than 150 gross tonnage where arranging a fire extinction station outside the protected spaces is hardly feasible, as well as in special cases, on ships of less than 500 gross tonnage where the volume of individual protected spaces does not exceed 100 m<sup>3</sup>, cylinders containing the fire extinguishing medium may be fitted within the protected space on condition that such stations are provided with efficient remote control for immediately starting the system from outside the protected space. The remote starting control position shall be distinctly indicated and lighted both from the main and emergency sources of electrical power.

**8.7 WATER FIRE MAIN SYSTEM**

**8.7.1** Fire pumps, pipelines, hydrants and hoses required by the present Section shall be provided in all ships.

**8.7.2 Number and capacity of fire pumps.**

**8.7.2.1** One main fixed fire pump with an independent power source and one portable fire pump shall be provided, and the latter shall be located considering the requirements of [8.7.2.7.1](#). For ice class ships the main fixed fire pump with an independent power source and the fire pump shall be provided, and the latter shall be fixed in compliance with the requirements of [8.7.2.7](#).

**8.7.2.2** The total capacity of the main fixed fire pump, in m<sup>3</sup>/h, shall not be less than

$$Q = (0,145\sqrt{L(B + D)} + 2,17)^2 \quad (8.7.2.2)$$

where L = length of ship (refer to 1.1.3, Part II "Hull"), in m;  
 B = greatest moulded breadth of ship, in m;  
 D = moulded depth to bulkhead deck amidships, in m.

The main fixed fire pump capacity need not exceed 25 m<sup>3</sup>/h.

**8.7.2.3** Relief valves shall be provided in conjunction with main fixed fire pump if the pump is capable of developing a pressure exceeding the design pressure of the water service pipes, hydrants and hoses.

A pressure gauge shall be fitted on the discharge end of the main fixed fire pump.

**8.7.2.4** Sanitary, ballast, bilge or general service pumps may be accepted as fire pumps, provided that they are not normally used for pumping fuel oil.

**8.7.2.5** Portable fire pumps shall comply with the following requirements:

- .1** the pump shall be self-priming;
- .2** the pump shall be capable of maintaining a pressure sufficient to produce a jet throw of at least 12 m, or that required to enable a jet of water to be directed on any part of the engine room, whichever is the greater;
- .3** arrangements shall be provided to secure the pump at its anticipated operating position;
- .4** the pump set shall be stored in a secure, safe and enclosed space, accessible from open deck and clear of the machinery space of category A. The room where the pump set is stored shall be illuminated from the emergency source of electrical power;
- .5** the pump set shall be easily moved and operated by two persons and be readily available for immediate use;
- .6** the pump set shall operate the pump for at least three hours. For electric pumps, their batteries shall have sufficient capacity for three hours. If the fuel type used for the pump set has a flash point below 60 °C, further consideration to the fire safety aspects of fuel oil storage on board shall be given.

A diesel motor pump may be used as the pump set.

The power source for the pump shall be capable of being readily started in its cold condition by hand (manual) cranking or by special heating arrangements.

The diesel motor pump shall comply with the requirements of [5.1.17](#) (except [5.1.17.2](#));

**.7** the overboard suction hose shall be non-collapsible and of sufficient length, to ensure suction under all operating conditions. A suitable strainer shall be fitted at the inlet end of the hose.

**8.7.2.6** In ships of less than 150 gross tonnage fitted with a fixed fire extinguishing system in the engine room, portable pumps may be omitted.

**8.7.2.7** Alternatively to portable fire pumps ([refer to 8.7.2.5](#)), fixed fire pumps may be fitted, which shall comply with the following requirements:

.1 the pump, its source of power and sea connection shall be located in accessible positions, outside the compartment housing the main fixed fire pump required by [8.7.2.1](#);

.2 the sea valve shall be capable of being operated from a position near the pump and be fitted below the lightship waterline;

.3 the pressure of water delivered by the pump shall be sufficient to produce a jet of water of not less than 12 m in length, at any hose nozzle of 12, 16 and 19 mm size or as near thereto as possible.

For ships of less than 150 gross tonnage, the jet of water shall be agreed with the Register in each particular case;

.4 pump is required to supply water for the fire extinguishing system in the space where the main fixed fire pump is situated, it shall be capable of simultaneously supplying water to this system and the fire main at the required rates;

.5 the pump may also be used for other suitable purposes on agreement with the Register;

.6 the room where the fire pump prime mover is located shall be illuminated from the emergency source of electrical power, and shall be well ventilated.

#### **8.7.3 Fire hoses and nozzles.**

**8.7.3.1** For fire hoses, the nozzle sizes shall be 12, 16 or 19 mm or as near thereto as possible.

**8.7.3.2** For accommodations and service spaces, the nozzle size need not exceed 12 mm.

**8.7.3.3** The size of nozzles used in conjunction with a portable fire pump need not exceed 12 mm.

**8.7.3.4** All nozzles shall be of an approved type incorporating a shut-off. Plastic fire hose nozzles may be used in accordance with [5.1.5](#).

#### **8.7.4 Fire main.**

**8.7.4.1** The diameter of the fire main shall be based on the required capacity of the main fixed fire pump and the diameter of the water service pipes shall be sufficient to ensure an adequate supply of water for the operation of at least one fire hose. Water fire main pipes shall be designed for working pressure of at least 1 MPa.

**8.7.4.2** Pipes of the water fire main system shall comply with all the requirements of [3.2.5.2](#).

**8.7.4.3** The valves of water fire main pipes shall be located where they will not be damaged by cargo.

**8.7.4.4** Where a fixed fire pump is fitted outside the engine room, in accordance with [8.7.2.7](#):

.1 an isolating valve shall be fitted on the fire main so that at all the hydrants in the ship, except that or those in the machinery space of category A, can be supplied with water;

.2 the isolating valve shall be located in an easily accessible position outside the machinery space of category A.

#### **8.7.5 Pressure in the fire main.**

**8.7.5.1** When the main fixed fire pump or the fixed fire pump specified in [8.7.2.7](#) is delivering water through the fire main, fire hoses and nozzles specified in [8.7.3](#), the pressure maintained at any hydrant shall be sufficient to produce a jet throw at any nozzle of not less than 12 m in length.

#### **8.7.6 Number and position of fire hydrants.**

**8.7.6.1** For ships equal to or greater than 150 gross tonnage the number and position of hydrants shall be such that at least two jets of water not emanating from the same hydrant, one of which shall be from a single length of hose, as specified in [5.1.4.1](#), may reach any part of the ship normally accessible to the crew while the ship is being navigated and any part of any cargo space when empty.

Furthermore, such hydrants shall be positioned near the accesses to the protected spaces.

**8.7.6.2** For ships less than 150 gross tonnage the number and position of the hydrants shall be such that at least one jet of water from a single length of hose, as specified in [5.1.4.1](#), may reach any part normally accessible to the crew, while the ship is being navigated and any part of any cargo space when empty.

Furthermore, such hydrants shall be positioned near the accesses to the protected spaces.

**8.7.6.3** At least one hydrant shall be provided in each machinery space of category A.

**8.7.6.4** An isolating valve and a standard quick-acting coupling shall be fitted at each fire hydrant.

**8.7.6.5** All exposed hydrants shall comply with the requirements of [3.2.6.1](#) and [3.2.6.5](#).

**8.7.6.6** The hydrants shall be so placed that the fire hoses may be easily coupled to them.

**8.7.6.7** All the hydrants shall be painted red.

**8.7.7 Fire hoses.**

**8.7.7.1** Fire hoses shall be of approved non-perishable material resistant to destruction by microorganisms (rotting).

**8.7.7.2** The hoses shall be sufficient in length to project a jet of water to any of the spaces, but their length, in general, shall not exceed 18 m.

**8.7.7.3** Fire hoses in assembly with nozzles shall be stowed at hydrants or in conspicuous positions on reels or in baskets.

**8.7.7.4** Ships equal to or greater than 150 gross tonnage shall be provided with fire hoses the number of which shall be one for each 30 m length of the ship and one spare, but in no case less than three in all.

**8.7.7.5** For ships less than 150 gross tonnage, one hose shall be provided for each hydrant. In addition, one spare hose shall be provided on board.

**8.7.7.6** Unless one hose and nozzle is provided for each hydrant in the ship, there shall be complete interchangeability of hose couplings and nozzles.

## **8.8 FIXED FIRE DETECTION AND FIRE ALARM SYSTEMS**

**8.8.1** An approved fixed fire detection and fire alarm system shall be installed in all machinery spaces of category A and cargo pump rooms.

**8.8.2** On agreement with the Register, buttons of manual fire alarms may be provided on board.



## **8.9 FIRE-FIGHTING OUTFIT**

### **8.9.1 Portable fire extinguishers.**

**8.9.1.1** All fire extinguishers shall be of type approved by the Register and shall comply with the requirements of [5.1.9](#), except [5.1.9.3](#) and [5.1.9.4](#).

**8.9.1.2** The extinguishing media employed shall be suitable for extinguishing fires in the compartments in which they are intended to be used.

**8.9.1.3** The extinguishers required for use in machinery spaces shall be of a type discharging foam, carbon dioxide gas, dry powder or other approved media suitable for extinguishing oil fires.

**8.9.1.4** The number of portable fire extinguishers and spaces where they shall be stowed is determined as follows:

**.1** accommodations and service spaces of ships greater than or equal to 150 gross tonnage – not less than 3 (three) fire extinguishers;

**.2** accommodations and service spaces of ships less than 150 gross tonnage — not less than 1 (one) fire extinguisher considering the applicable requirements of [8.9.1.5](#);

**.3** machinery spaces — 1 (one) fire extinguisher per every 375 kW of internal combustion engine power; however, their number shall be not less than 2 (two) and not more than 6 (six).

**8.9.1.5** Accommodation spaces, service spaces and control stations shall be provided with a sufficient number of portable fire extinguishers to ensure that at least 1 (one) extinguisher will be easily available for use in every compartment of the crew spaces. In any case, on ships greater than or equal to 150 gross tonnage their number shall be not less than 3 (three), except where this is impractical for very small ships, in which case 1 (one) extinguisher shall be available at each deck having accommodation or service spaces, or control stations.

**8.9.1.6** The extinguishers shall be stowed in readily accessible positions and shall be spread as widely as possible and not be grouped.

**8.9.1.7** One of the portable fire extinguishers intended for use in any space shall be stowed near the entrance to that space.

**8.9.1.8** A spare charge shall be provided for each required portable fire extinguisher that can be readily recharged on board. If this cannot be done, the same number of duplicate (additional) extinguishers of the same capacity, type and fire extinguishing capability shall be provided.

**8.9.2** 1 (one) fire blanket complying with the requirements of [5.1.13](#) shall be provided.

**8.9.3** All ships greater than or equal to 150 gross tonnage shall carry at least one firefighter's outfit consisting of a set of personal equipment, breathing apparatus and lifeline complying with the requirements of IMO resolution MSC.98(73).

## **8.10 ADDITIONAL FIRE SAFETY MEASURES FOR OIL TANKERS**

**8.10.1** The requirements for tankers of SOLAS Chapter II-2 shall apply to oil tankers carrying crude oil and petroleum products, having a flash point not exceeding 60 °C and a Reid vapour pressure which is below atmospheric pressure.

**8.10.2** Oil tankers carrying petroleum products having a flash point exceeding 60 °C shall comply with the requirements of [6.3](#), except [6.3.1.1](#), and of [8.10.3](#) and [8.10.4](#).

The flash point shall be determined by a closed cup test using an approved flash point apparatus.

**8.10.3** Cargo area deck protection shall be carried out considering the following:

**.1** at least one mobile foam appliance shall be provided for use on the cargo tank deck including the cargo manifolds. Where the appliance is of the inductor type it shall comply with [5.1.8](#). The nozzle shall be capable of producing effective foam, suitable for extinguishing an oil fire, at the rate of at least 1,5 m<sup>3</sup>/min. Self-contained appliances shall have a foam solution capacity of at least 135 l;

**.2** use shall be made of foam concentrate of types approved by the Register considering the requirements of [3.7.1.2](#).

**8.10.4** The type of foam used shall be suitable for the cargoes to be carried.

## **8.11 SHIPS NOT FITTED WITH PROPELLING MACHINERY**

**8.11.1** Arrangements for fire protection, detection and extinction in ships not fitted with propelling machinery shall be considered by the Register taking into account the size and purpose of the ship, its operation conditions and the presence of accommodation spaces, machinery and combustible materials on board.

**8.12 SHIPS CARRYING PACKAGED DANGEROUS GOODS  
OR DANGEROUS GOODS IN BULK**

**8.12.1** Ships carrying packaged dangerous goods or dangerous goods in bulk shall comply with the requirements of [7.2](#).

**8.12.2** Ships carrying packaged irradiated nuclear fuel, plutonium and high-level radioactive wastes (INF cargo) shall comply with the requirements of [7.3](#).

### **8.13 OIL RECOVERY SHIPS AND BILGE WATER REMOVING SHIPS**

**8.13.1** The fire protection of oil recovery ships and bilge water removing ships shall comply with the requirements of [6.4](#), except the requirements for fitting of fixed deck foam fire extinguishing system, and of [8.10.2 – 8.10.4](#).

#### **8.14 SPECIAL PURPOSE SHIPS**

**8.14.1** The fire protection of special purpose ships shall be in compliance with the requirements of [6.2](#).

Russian Maritime Register of Shipping

**Rules for the Classification and Construction of Sea-Going Ships**  
**Part VI**  
**Fire Protection**

FAI "Russian Maritime Register of Shipping"  
8, Dvortsovaya Naberezhnaya,  
191186, St. Petersburg,  
Russian Federation  
[www.rs-class.org/en/](http://www.rs-class.org/en/)